โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258 https://www.add-furnace.com E-mail: <u>sales@add-furnace.com</u>

Honeywell

Gas Burner Safety Control DKG 972

For 2-stage atmospheric gas burners

Flame detection:

- Ionisation probe
- Infrared-flicker detector IRD 1020.1
- UV flame sensor UVD 971

INTRODUCTION

The burner control box DKG 972 controls and supervises atmospheric burners for gas. They are approved and certified according to the applicable European standards and regulations.

The microprocessor-based programming sequence ensures extremely stable timings independent of voltage variations, ambient temperature and/or switch-on cycles. The built-in information system not only provides a continuous monitoring of the actual state of the box (very helpful especially for monitoring the start-up phase) but also informs about the cause of a possible lock out. The lock out cause is stored in such a way that it can be retrieved even after a power failure.

The control box is designed for maximum safety in case of fluctuations in the voltage supply. If the mains voltage drops below the permitted level, operation is interrupted and the control box automatically prevents the start sequence from being repeated. In this way, the safety of the system is not put at risk by a drop in the mains voltage. This low-voltage protection works not only during start-up but also permanently during operation.

CONSTRUCTIONAL FEATURES

The control box circuitry is protected by a flame resistant, transparent plug-in type plastic housing. A central fixing screw locks the control box to the wiring base.

The plug-in control box incorporates the microprocessor based timer, flame check and reset circuits.

Manual reset from lock out and set to lock out is provided by a push button with an integrated LED information system. A variety of cable entry points provides complete flexibility for electrical wiring.

The wiring base S98 is equipped with spare- and extraterminals and allows together with a variety of cable entry points utmost flexibility of electrical wiring.

The DKG 972 are compatible with the TFI 812.

Different are only the pre- and post-ignition times.

Max. heating power according the limits in the Gas

Appliance

Directive.



TECHNICAL DATA

Operating voltage 220 / 240 V (-15... +10%)

50 Hz (±5%)

or 110 / 120 V (-15... +10%)

60 Hz (±5%)

Fuse rating 10 A fast, 6 A slow

Power consumption ca. 12 VA

Max. load per output

- term. 3 ignition trafo 1.0 A, $\cos \phi$ 0.2 - term. 5 + 6 solenoid valves - term. 7 alarm indicator 1.0 A, $\cos \phi$ 0.4 0.5 A, $\cos \phi$ 0.4 0.5 A, $\cos \phi$ 0.4 1.0 A, $\cos \phi$ 0.5 A, $\cos \phi$

4.0 A, cos φ 0.4 max. 16 A during 0,5 sec

Reset time from lock out none

Re-cycling / repetition (max. 4x) after a loss-of-flame during operation

 $\begin{array}{lll} \text{Sensitivity} & 1 \ \mu\text{A} \\ \text{min. ionisation current required} & 1.5 \ \mu\text{A} \\ \text{Sensitivity for stray light} & 0.4 \ \mu\text{A} \\ \text{Ionisation probe insulation} & \text{probe-} \end{array}$

probe - earth greater than 50 M Ω probe- earth less then 1000 pF

max. cable length Flame detectors

Stray capacitance

IRD 1020.1 side-on or end-on viewing

< 3 m

UVD 971 end-on viewing

Weight incl. Wiring base 190 g Mounting position any Protection class IP 40

Approved ambient parameter

for control and flame detector max. 95% at 30° C
- for operation -20° C... +60° C
- for storage -20° C... +80° C

Build-up of ice, penetration of

to European standards

water and condensing water are inadmissible Approvals according

EN 298 and EN 230, as well as all other relevant Directives and standards

Classified acc. to EN 298 ATLLXN

Table of timings (sec.)

Model	waiting time start	pre-ignition time	Stray light monitoring	safety time	post-ignition time	delay 2nd-stage
	tw	tvz	tf	ts	tn	tv2
05	12	3	5	5	4	25
10	12	3	5	10	9	25

ADD

บริษัท เอดีดี เฟอร์เนส จำกัด

ADD FURNACE CO.,LTD.

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258 https://www.add-furnace.com E-mail: <u>sales@add-furnace.com</u>

APPLICATION FEATURES

1. Information system

The information system is microprocessor based and reports on all aspects of burner control box operation and flame supervision. It informs continuously about the actual programming sequence the unit is just performing. Besides monitoring of the programming sequence it also allows to identify errors during start-up of operation without any additional testing devices. The automatically performed diagnosis is a valuable tool which facilitates service/maintenance work and therefore saves costs. The analyses of the error cause can be done directly on stage or if not possible afterwards as the lock out reason is stored in a nonvolatile lock out mode memory.

The information system communicates with the outside world using a LED (the used Flash-Code is similar to the Morse-Code). The messages are optically transmitted by a appropriately flashing LED. Using an additional terminal (optional), the messages can be recorded and displayed in easy readable form.

1.1 Programming sequence display

The built-in microprocessor controls not only the programming sequence but the information system too. The individual phases of the programming sequence are displayed as Flash-Code.

The following messages can be distinguished:

<u>Message</u>	<u>Flash-Code</u>		
waiting time	111.		
tw			
pre-ignition	111.		
tvz			
safety time ts	■ 1.		
post ignition tn			
delay time to valve V2	I .		
tv2			
running	Ι_		
low mains voltage	│ ■ ■ _		
Internal fuse defect			
> control box defect			

Description

- = short pulse
- = long pulse
- . = short pause
- _ = long pause

1.2 Lock-out diagnoses

In case of a failure the LED is permanently illuminated. Every 10 seconds the illumination is interrupted by a flash code, which indicates the cause of the error. Therefore the following

sequence is performed which is repeated as long as the unit is not reset.

Sequence:

illuminated phase dark phase Flash-Code dark phase for 10 sec for 0.6 sec for 1.2 sec

Error diagnosis		
Error message	Flash-Code	Possible fault
lockout		within lock out safety
		time no flame
		establishment
stray light		stray light
		during monitored phase detector may be faulty

2. Flame detection

The following types of flame detectors are suitable:

- lonisation probe, temperature resistant material, well insulated (material and insulation same as for ignition electrode).
- Infrared-flicker detector type IRD 1020.1 with mounting flange M 93 or the UV solid state flame sensor UVD 971.
 Flame detection using an ionisation probe is only possible in conjunction with mains supplies which provides a neutral earth connection.

Connecting the IRD 1020.1 or UVD 971 the correct wiring has to be observed.

2.1 Stray light monitoring

The stray light check is performed at the end of the prepurge time for thr duration as mentioned in the table of timings.

บริษัท เอดีดี เฟอร์เนส จำกัด ADD FURNACE CO.,LTD. 44 ชอยบรมราชชนนี 70 ถนนบรมราชง

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพ ช 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

https://www.add-furnace.com E-mail: sales@add-furnace.com

3. Lock out and reset

The unit can be reset or brought into lock out mode in two different ways:

Internal

In the lock out case the unit can be reset by pushing the builtin button meaning a new start-up cycle is performed.

External

Instead of using the built-in lock out button the same function can be achieved by using an external button which connects terminal 9 with A (see also circuit and block diagram).

If the pushputton (internal or external) is pressed during normal operation or during the start sequence for more then 3 sec. and afterwards released, the control box will perform a shutdown.



Please note

The unit can only be brought to lockout mode or be reseted if power is applied to the unit.

4. Low-voltage protection

at 220 / 240V (110 / 120V) nominal voltage

The mains voltage has to be more than 187 Veff (94 Veff) in order to allow the unit to perform a start-up.

The mains voltage is not only monitored in the start-up phase but also permanently during operation. If the voltage drops below < 160 Veff (80 Veff) during start-up or run time the control box proceed to safety shut-down and goes into a waiting status. If the voltage rises again, the control box performs automatically a start-up as soon as the mains voltage is > 187 Veff (94 Veff) .

5. Safety

The design and control sequence of the DKG 972 controls will comply with the currently applicable standards and regulations (see also TECHNICAL DATA).

6. Mounting and electrical wiring

Wiring base:

- 3 earth terminals with additional terminal for burner earthing
- 3 neutral terminals with internal permanent connection to neutral terminal 8
- 2 independant spare terminals (S1 and S2)
- extra terminals A, B and C are standard (wiring base S98 12-pin)
- 2 slide-in plates and 2 easy knock out holes plus 2 knock out holes in the base bottom faciliate the base wiring



Please note

To assist trouble-free operation the main neutral connection terminal 8 in the wiring base must be fully tightened. The terminal screws are already in the undone position. To connect a wire to the terminal, the screw only needs to be fastened.

General: The control box and detector probes should not be subjected to excessive vibration.

บริษัท เอดีดี เฟอร์เนส จำกัด ADD FURNACE CO.,LTD. 44 ขอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกร์: 02-888-3258 https://www.add-furnace.com E-mail: sales@add-furnace.com

INSTALLATION INSTRUCTIONS AND MAINTENANCE

1. Important notes

- The controls must be installed by qualified personnel only. The relevant national regulations have to be observed.
- On commissioning the wiring has to be carefully checked according the appropriate diagram, Incorrect wiring can damage the unit and endanger the installation.
- The fuse rating has to ensure that the limits specified in TECHNICAL DATA will not be exceeded. If these precautions are not observed, the effect of a short circuit can cause severe damage to the control and installation.
- For safety reasons a minimum of one control shutdown every 24 hours has to be observed.
- Disconnect the mains before the control box is plugged in or out.
- The control box is a safety device and must not be opened!

2. Function control

For safety reasons the flame detection system should be tested on commissioning the installation as well as after a service or longer shut-down.

- a) Attempt to start with gas valve closed:
 - At the end of the safety interval
 - -> Lockout
- b) After a normal start, with the burner in operation, close the gas valve:
 - After restart at the end of the safety interval
 - -> Lockout

3. Fault finding

The built-in information system facilitate the trouble shooting in the case of problems occurring during start-up or during operation.

A list of possible lock out messages can be found in APPLICATION FEATURES chapter 1.2.



Please note:

The control box is locked in lock out mode and the reasen for the lock out is displayed until the control box is reset, either by an internal or external reset (see also subject "3 Lock out and reset").

Removing the control box from its wiring base or by interrupting the supply line may not reset a lock out. Therefore, by applying power, it needs 2-3 secs. before the control box goes to lock out again and the cause of the last lock out.

Error	Possible fault		
Burner not working	- Thermostat circuit open		
_	- Faulty electrical wiring		
	- Mains voltage < 187 V (< 80 V)		
	- Terminal A continuously on		
	power (e.g. terminal A is used as		
	a support terminal)		
After 2-3 secs. after app	olying - Control box has not been		
reseted power. the unit	goes to		
lock out			
Burner starts,	- stray light signal during waiting		
flame not established,	time		
lock out	- no ignition or no fuel		
Burner starts,	- no or too low flame signal (min.		
flame established,	valves see TECHNICAL DATA)		
after safety time,	- wrongly wired, phase and neutral		
lock out	reversed		
	- Ionisation probe dirty, broken or		
	has contact to frame ground		
	- too little light on flame senslor		
	(IRD)		


ADD


บริษัท เอดีดี เฟอร์เนส จำกัด

ADD FURNACE CO.,LTD.

44 ชอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258 https://www.add-furnace.com E-mail: <u>sales@add-furnace.com</u>

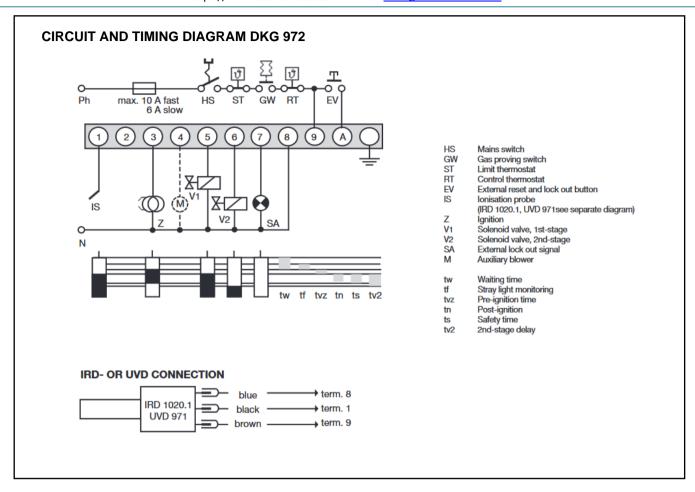

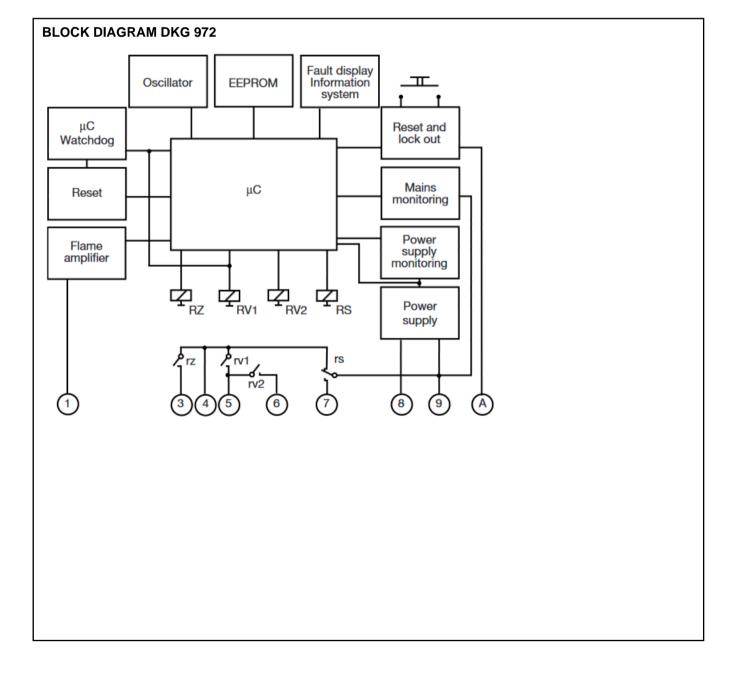

บริษัท เอดีดี เฟอร์เนส จำกัด


ADD


ADD FURNACE CO.,LTD.


44 ชอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

https://www.add-furnace.com E-mail: sales@add-furnace.com

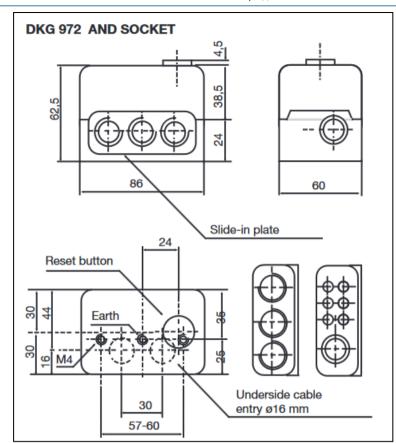

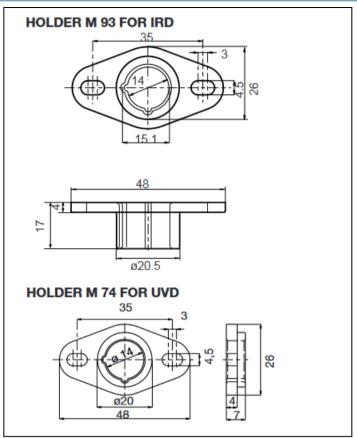

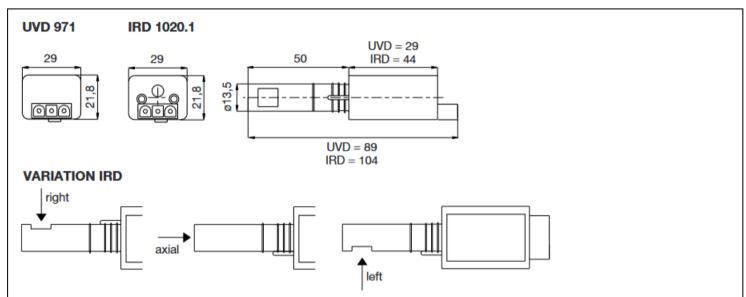

ORDERING INFORMATION		
ITEM	DESIGNATION	ITEM NO.
Control box	DKG 972 Mod. 5	0332010
Control box	DKG 972 Mod. 10 110 / 120V 50Hz	0332310
Control box	DKG 972 Mod. 10 110 / 120V 60Hz	0332410
Socket	Wiring base S98 12-pin	75310
Insert plate	PG-Plate	70502
optional	Cable entry plate	70503
Flame detector	IRD 1020.1 end-on	16532
Flame detector	IRD 1020.1 left	16533
Flame detector	IRD 1020.1 right	16531
optional	UVD 971	16722
Support for IRD	Holder M93 for IRD 1020	59093
Support for UVD	Holder M74 for UVD	59074
Connection cable	Plug type, 3 core cable, 0.6 m with tag wire ends	7236001
The above ordering information re		
Special versions are also included	in our product range. Specifications subject	ct to change without notice