


How to set azbil sdc25/26 input type


2=0-1200°C
3=0-800°C

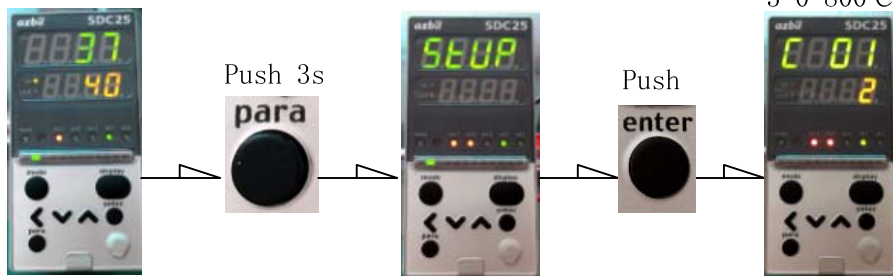


How to set azbil sdc25/26 Event 1(Alarm) and Event NO to NC When power default ON

1: PV high limit

0001: Reverse NC

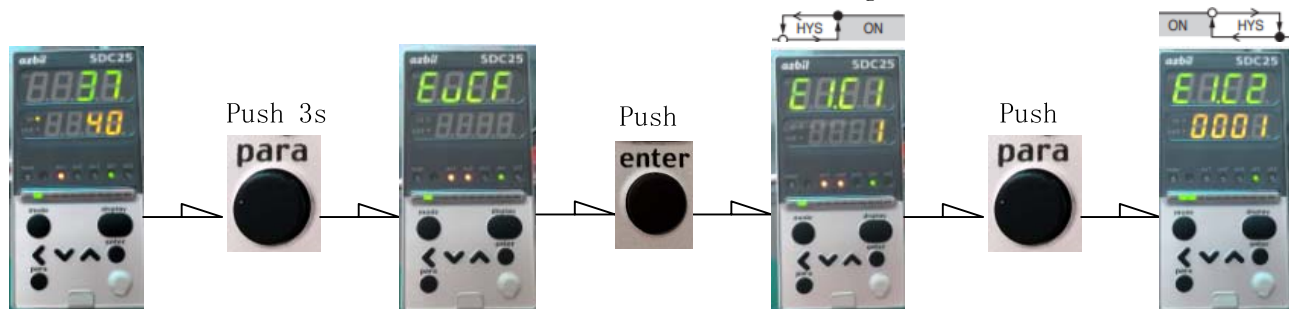

How to set azbil sdc25/26 Event 1(Alarm) Limit Temp 40°C When Less 4°C alarm off

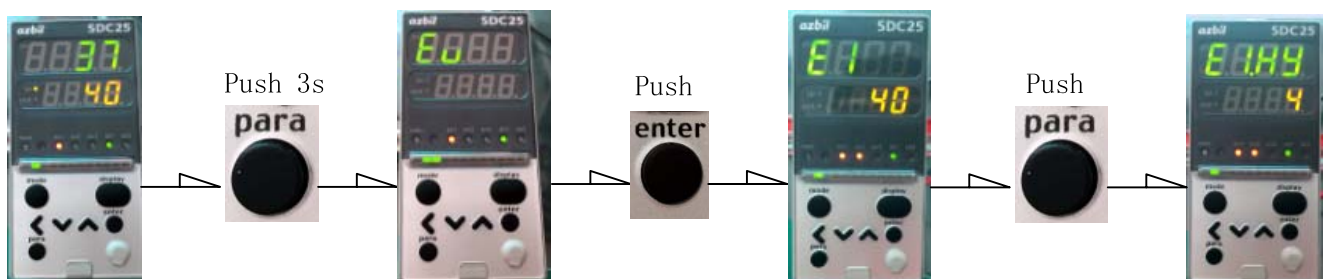

Itemref	Quantity	Title/Name, designation, material, dimension etc	Article No./Reference	
Designed by XIE	Checked by HAI	Approved by - date FENG-01/01/17	File name AZBIL-SDC25-26	TITLE AZBIL-SDC25/26-STANDARD-SETTING



บริษัท เอดดี เฟอร์เนส จำกัด
ADD FURNACE CO.,LTD.
https://www.add-furnace.com sales@add-furnace.com
Tel:02-888-3472 Fax:02-888-3258

CUSTOMER

xxx

Scale(A4)

1:x

Edition

0

Sheet

1/1

View(Third)

