44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170 โทร: 02-888-3472 โทร: ออกแบบ.08-08-170-170 แฟกซ์: 02-888-3258 https://www.add-furnace.com E-mail: sales@add-furnace.com

GasMultiBloc®
Combined regulator and safety shut-off valves
Two-stage function

MB-ZRD(LE)415-420B01



7.26



#### **Technical description**

The DUNGS Gas MultiBloc® integrates filter, regulator, valves and pressure switches in one compact fitting.

- Dirt trap: microfilter
- One regulator and two main valves: B01
- One one-stage valve and one two-stage valve
- One valve is fast opening, one valve is slow or fast opening
- Solenoid valves up to 360 mbar (36 kPa) as per DIN EN 161 Class A Group 2
- Sensitive setting of output pressure by proportional regulator as per DIN EN 88 Class A Group 2
- High flow rates with low pressure drop
- DC solenoid drive interference degree N
- Main volume restrictor and partial volume restrictor at valveV2
- Hydraulic opening delay
- Flange connections with pipe threads as per ISO 7/1
- Simple mounting, compact, light-weight

The modular system permits individual solutions by using external ignition gas tap in connection with separately controlled valves, by adding a valve proving system, mini/maxi pressure switches, pressure limiters, limit switch at valve V2.

### **Application**

The modular system permits individual solutions in gas safety and regulator engineering. Suitable for gases of families 1, 2, 3 and other neutral gaseous media.

### **Approvals**

EU type testing certificate as per:

- EU-Gas Appliances Regulation
- EU-Pressure Equipment Directive Approvals in other important gas consuming countries.

# บริษัท เอดีดี เฟอร์เนส จำกัด add furnace co.,Ltd.

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170 โทร: 02-888-3472 โทร: ออกแบบ.08-08-170-170 แฟกซ์: 02-888-3258 https://www.add-furnace.com E-mail: sales@add-furnace.com

Solenoid V1

#### Functional description of gas flow

- 1. When the valves V1 and V2 are closed, chamber A is under inlet pressure.
- A hole D in the filter housing connects min. pressure switch with chamber A. If the inlet pressure applied to the pressure switch exceeds the incoming reference value, it switches through to the automatic burner control.
- 3. After release by the automatic burner control, valves V1 and V2 open. The gas flows through chambers A, B and C of the GasMultiBloc.
- 4. On request, the second stage of valve V2 opens.

# Operating method of valve-regulator combination on valve V1

A regulator, compensating for residual pressure is integrated in valve V1 (pressure regulating part). Armature 8 is not connected to valve plate unit 3. When it opens, armature 8 pretensions compressions pring (V1) 5 and releases the valve plate unit. When the valve closes, the armature acts directly on the valve plate unit. The output pressure upstream of valve V2 is defined by pretensioning regulating spring 7 (tension spring) via setting screw 19.

The output pressure acts via opening E on the working diaphragm 23 of the regulator part. In regulated state, setting spring inlet pressure and pressure of working diaphragm are in force equilibrium.

The compensating diaphragm 24 ensures the fast closing function of valve V1 and a high regulating quality.

#### Operating method of valve V2


Armature 14 of valve V2 is connected to valve plate unit 11. When it opens, armature 14 pretensions closing spring 13. The valve opening of stage 1 can be set by limiting the armature stroke by means of main volume restrictor 20.


# Min. opening (residual stroke) of valve (0.5 to 1.0 mm)

If the second stage of valve 2 opens, closing spring 13 is continuously pretensioned. The maximum valve opening of stage 2 can be set by limiting the armature stroke of armature 16 by means of the main volume restrictor. Main volume restrictor 21 is set by rotating the adjusting plate or the hydraulic brake. The fast and/or slow opening characteristic acts on both stages. It is influenced by setting the fast stroke at the hydraulic brake under the cover.

## **Closing function**


When the supply voltage to the solenoid coils of valves V1 and V2 is interrupted, they are closed within < 1 s by the compression springs.

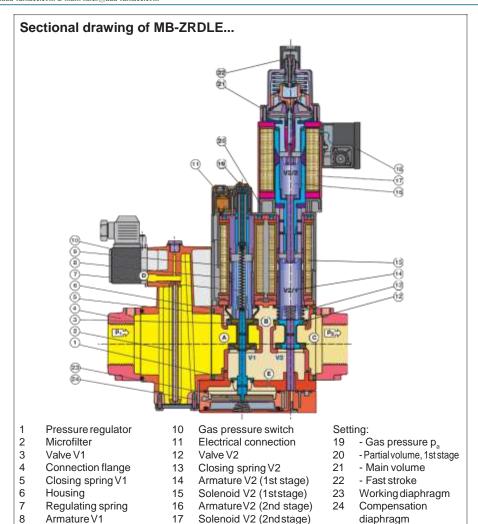

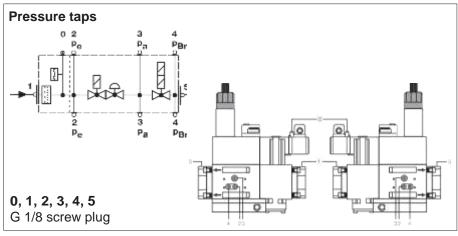

Electrical connection

18

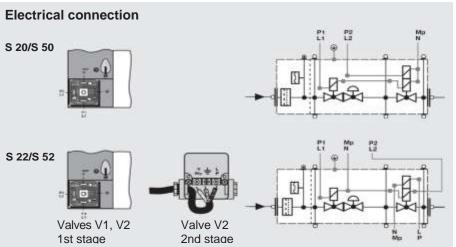



44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170 โทร: 02-888-3472 โทร: ออกแบบ.08-08-170-170 แฟกซ์: 02-888-3258 https://www.add-furnace.com E-mail: sales@add-furnace.com


## **Specifications**


Nominal diameters Flange with pipe threads as per ISO 7/1 (DIN 2999)	MB-ZR415 B01 Rp 1, 1 1/4, 1 1/2, 2 and their combinations			MB-ZR420 B01 Rp 1, 1 1/4, 1 1/2, 2 and their combinations				
Max. operating pressure	360 mbar (36 kPa)							
Output pressure ranges	MB-ZR S20/S22 p <sub>a</sub> : 4 mbar (0.4 kPa) to 20 mbar (2 kPa) MB-ZR S50/S52 p <sub>a</sub> : 20 mbar (2 kPa) to 50 mbar (5 kPa)							
Media	Gases of families 1, 2, 3 and other neutral gaseous media							
Ambient temperature	-15 °C to +70 °C (Do not operate MB-ZR below 0 °C in liquid gas systems. Only suitable for gaseous liquid gas, liquid hydrocarbons destroy sealing materials.)							
Dirt trap	Sieve, microfilter, changing the filter is possible without removing the valve.							
Pressure switches	Types GWA5, ÜBA2 / NBA2 to DIN EN 1854 may be attached. For further information, refer to Datasheets 5.02 and 5.07 "Pressure Switches for DUNGS Multiple Actuators"							
Pressure regulator	Pressure regulator compensated for residual pressure, leakproof seal when switched off by means of valve V1 asper DIN EN 88 Class A. Setpoint spring permanently installed (ospring exchange possible). A vent line above roof is not required. Internal pulse tap provided.							
Solenoid valve V1	Valve as per DIN EN 161 Class A Group 2, fast closing, fast opening							
Solenoid valve V2	Valve as per DIN EN 161 Class A Group 2, fast closing							
	MB-ZRD MB-ZRDLE MB-ZRLE	Valve V2 design fast opening slowly opening slowly opening	Partial with with with	alvolumerestrictor	Main volume restrictor with with without			
Measuring / Ignition gas connection	For G 1/8 as per DIN ISO 228, refer on page 4							
Burner pressure monitor p <sub>Br</sub>	Connection downstream of valve V2, pressure switch mountable on adapter laterally							
Voltage / Frequency	50 - 60 Hz, 220 - 230 V AC, -15 % +10 %							
Electrical connection	Plug connection as per DIN EN 175301-803 for valves and pressure switches							
Rating / Power consumption Switch-on duration Degree of protection Radio interference	Refer to Dimensions on page 5 100 % IP 54 as per IEC 529 (EN 60529) Interference degree N							
Materials of gas conveying parts	Housing Diaphragms, seals Solenoid drive		aluminium die casting NBR basis, Silopren (silicone rubber) steel, brass, aluminium					
Installation position	Solenoid vertically upright or lying horizontally as well as its intermediate positions.							
Closed position signal contact	Closed position signal contact, type K01/1 (DIN-tested), mountable to V2							

# บริษัท เอดีดี เฟอร์เนส จำกัด ADD FURNACE CO.,LTD.


44 ชอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170 โทร: 02-888-3472 โทร: ออกแบบ.08-08-170-170 แฟกซ์: 02-888-3258 https://www.add-furnace.com E-mail: sales@add-furnace.com

Equipment variants GasMultiBloc®B01 Two-stage function	415 B01	420 B01	
MB-ZRD	•	•	
MB-ZRDLE	•	•	
MB-ZRLE	•	•	
Microfilter (standard) with sieve	•	•	
Gas pressure switch			Filter element can be removed. A suitable GF/1 gas
downstream of filter	•	•	filter must then be fittedupstream.
downstream of valve V2 on adapter laterally	•	•	
Pressure regulator	•	•	
Valve V1, double seat	•	•	
Valve V2, double seat	•	•	
Valves opening together	•	•	S 20, S 50
Valves opening separately	•	•	S 22, S 52
Flange Rp 1	•	•	
Rp 1 1/4	•	•	• = possible
Rp 1 1/2	•	•	(•) = on request
Rp 2	•	•	- = not possible

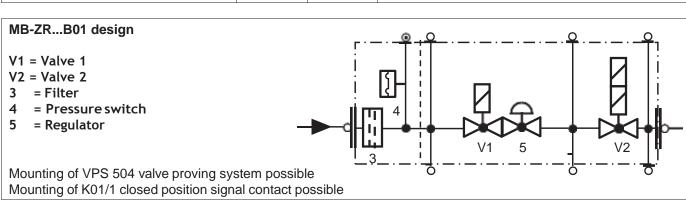

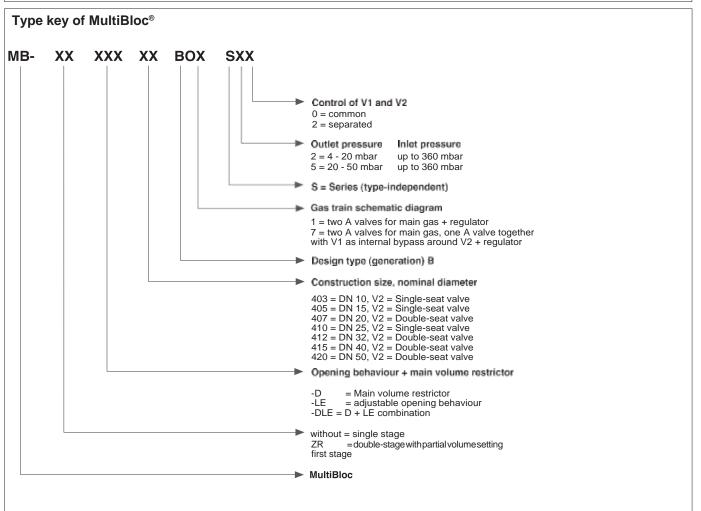

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170 โทร: 02-888-3472 โทร: ออกแบบ.08-08-170-170 แฟกซ์: 02-888-3258 https://www.add-furnace.com E-mail: sales@add-furnace.com

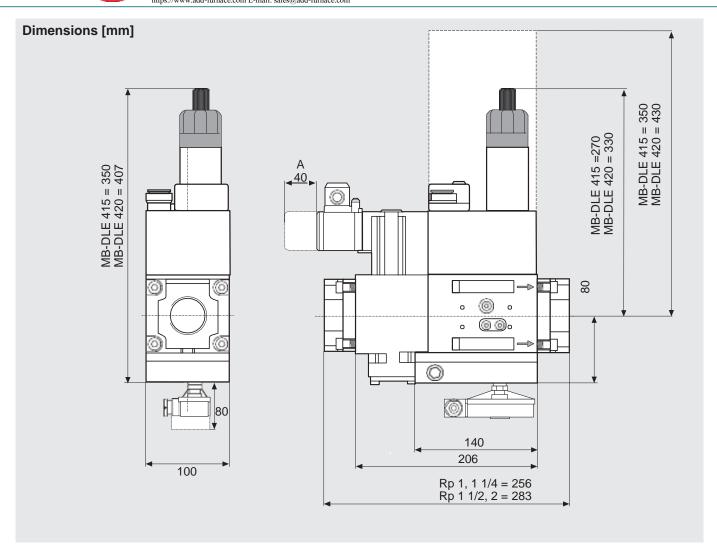


Туре	Rp	Opening time	Nominal rating [VA] 230 V AC; +20 °C			_
			S20	S50	S22 S52	
MB-ZRD 415 B01	Rp 1 - 2	< 1 s	80	80	120 120	8.0
MB-ZRDLE 415 B01	Rp 1 - 2	< 20 s	80	80	120 120	8.1
MB-ZRD 420 B01	Rp 1 - 2	< 1 s	115	115	135 135	5 10,1
MB-ZRDLE 420 B01	Rp 1 - 2	< 20 s	115	115	135 138	5 10.2

GasMultiBloc®
Combined regulator and safety shut-off valves
Two-stage function

MB-ZRD(LE) 415 - 420 B01



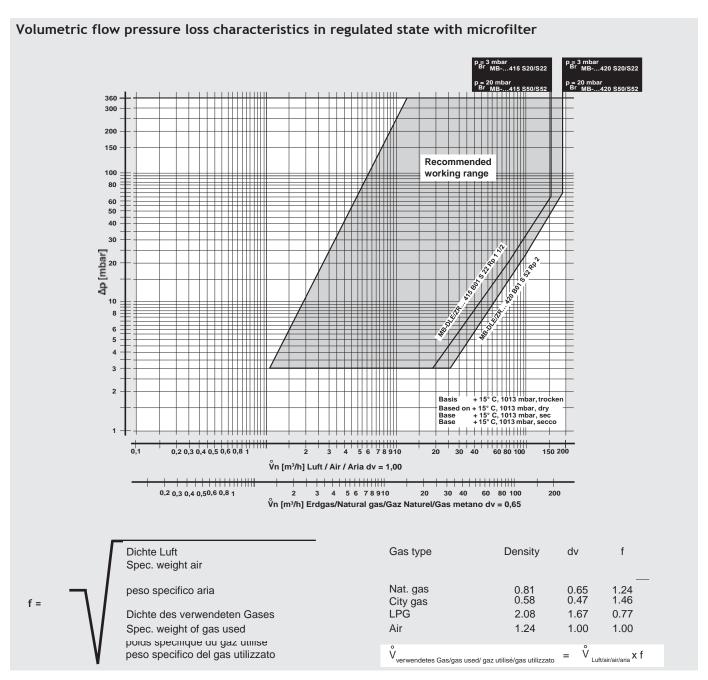

We reserve the right to make any changes in the interest of technical progress.