44 ซ.บรมราชชนนี 70 ถ.บรมราชชนนี ศาลาธรรมสพน์ ทวีวัฒนา กทม. 10170.

Line ID: @add11 e-mail: add028883472@gmail.com

GasMultiBloc® Combined regulator and safety shut-off valves Two-stage function

MB-ZRD(LE)415-420B01





Technical description

The DUNGS GasMultiBloc®integrates filter, regulator, valves and pressure switches in one compact fitting.

- Dirt trap: microfilter
- One regulator and two main valves:
- One one-stage valve and one two-stage
- One valve is fast opening, one valve is slow or fast opening
- Solenoid valves up to 360 mbar (36 kPa) as per DIN EN 161 Class A Group 2
- Sensitive setting of output pressure by proportional regulator as per DIN EN 88 Class A Group 2
- High flow rates with low pressure drop
- DC solenoid drive interference degree N
- Main volume restrictor and partial volume restrictor at valve V2
- Hydraulic opening delay
- Flange connections with pipe threads as per ISO 7/1
- Simple mounting, compact, light-weight

The modular system permits individual solutions by using external ignition gas tap in connection with separately controlled valves, by adding a valve proving system, mini/maxi pressure switches, pressure limiters, limit switch at valve V2.

Application

The modular system permits individual solutions in gas safety and regulator engineering. Suitable for gases of families 1, 2, 3 and other neutral gaseous media.

Approvals

EC type test approval as per EC Gas Appliance Directive:

MB-ZR...415-420 B01 CE-0085 AP 3156

EC type test approval as per EC Pressure **Equipment Directive:**

MB-ZR...415-420 B01 CE0036

Approvals in other important gas consuming countries.

บริษัท เอดีดี เพอร์เนส จำกัด website: https://www.add-furnace.com/ โทร: 02-888-3472 Add Furnace Co.,Ltd.

44 ซ.บรมราชชนนี 70 ถ.บรมราชชนนี ศาลาธรรมสพน์ ทวีวัฒนา กทม. 10170.

Line ID: @add11 e-mail: add028883472@gmail.com

Functional description of gas flow

- 1. When the valves V1 and V2 are closed, chamber A is under inlet pressure.
- 2 A hole D in the filter housing connects min. pressure switch with chamber A. If the inlet pressure applied to the pressure switch exceeds the incoming reference value, it switches through to the automatic burner control.
- 3. After release by the automatic burner control, valves V1 and V2 open. The gas flows through chambers A, B and C of the GasMultiBloc.
- 4. On request, the second stage of valve V2 opens.

Operating method of valve-regulator combination on valve V1

A regulator, compensating for residual pressure is integrated in valve V1 (pressure regulating part). Armature 8 is not connected to valve plate unit 3. When it opens, armature8pretensionscompressionspring (V1) 5 and releases the valve plate unit. When the valve closes, the armature acts directly on the valve plate unit. The output pressure upstream of valve V2 is defined by pretensioning regulating spring 7 (tension spring) via setting screw 18.

The output pressure acts via opening E on the working diaphragm 22 of the regulator part. In regulated state, setting spring inlet pressure and pressure of working diaphragm are in force equilibrium.

The compensating diaphragm 23 ensures the fast closing function of valve V1 and a high regulating quality.

Operating method of valve V2


Armature 14 of valve V2 is connected to valve plate unit 11. When it opens, armature 14 pretensions closing spring 13. The valve opening of stage 1 can be set by limiting the armature stroke by means of main volume restrictor 19.

Min. opening (residual stroke) of valve (0.5 to 1.0 mm)


If the second stage of valve 2 opens, closing spring 13 is continuously pretensioned. The maximum valve opening of stage 2 can be set by limiting the armature stroke of armature 16 by means of the main volume restrictor. Main volume restrictor 20 is set by rotating the adjusting plate or the hydraulic brake. The fast and/or slow opening characteristic acts on both stages. It is influenced by setting the fast stroke at the hydraulic brake under the cover.


Closing function


When the supply voltage to the solenoid coils of valves V1 and V2 is interrupted, they are closed within < 1 s by the compression springs.

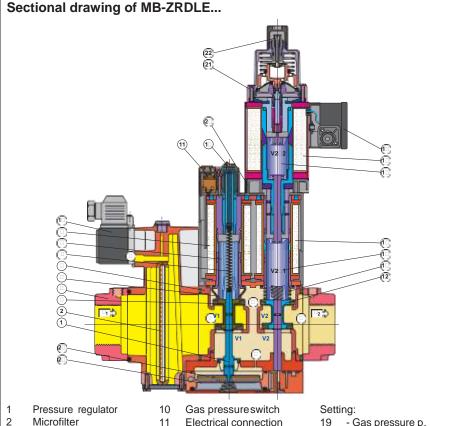

- Microfilter 2
- Valve V1
- Connection flange
- Closing spring V1
- Housing
- Regulating spring
- Armature V1
- Solenoid V1
- Electrical connection
- 12 Valve V2
- Closing spring V2 13
- 14 Armature V2 (1st stage)
- 15 SolenoidV2 (1st stage) Armature V2 (2nd stage) 16
- Solenoid V2 (2ndstage) 17
- 18 Electrical connection
- 19 - Gas pressure pa
- -Partial volume, 1st stage 20
- Main volume 21
- Fast stroke Working diaphragm 23
- Compensation diaphragm

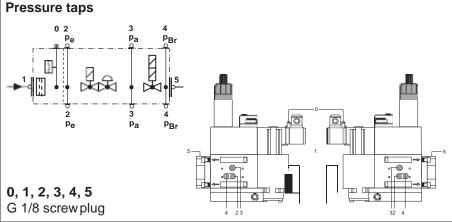

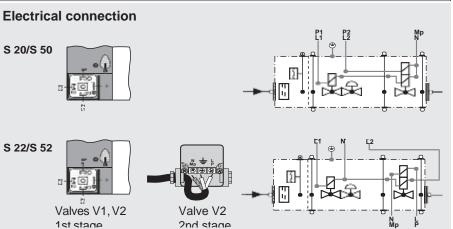



44 ซ.บรมราชชนนี 70 ถ.บรมราชชนนี ศาลาธรรมสพน์ ทวีวัฒนา กทม. 10170.

Line ID: @add11 e-mail: add028883472@gmail.com


Specifications


Closed position signal contact	Closed posit	ion signal contact, t	ype K01/1 (DIN-teste	ed), mountable to V2				
Installation position	Solenoid vertically upright or lying horizontally as well as its intermediate positions.							
Materials of gas conveying parts	Housing Diaphragms, seals Solenoid drive		aluminium die casting NBR basis, Silopren (silicone rubber) steel, brass, aluminium					
Rating / Power consumption Switch-on duration Degree of protection Radio interference	Refer to Dimensions on page 5 100 % IP 54 as per IEC 529 (EN 60529) Interference degree N							
Electrical connection	Plug connection as per DIN EN 175301-803 for valves and pressure switches							
Voltage / Frequency	50 - 60 Hz, 220 - 230 V AC, -15 % +10 % Other preferred voltages: 240 VAC, 110 - 120 VAC, 48 VDC, 24 - 28 VDC							
Burner pressure monitorp _{Br}	Connection downstream of valve V2, pressure switch mountable on adapter laterally							
Measuring / Ignition gas connection	For G 1/8 as per DIN ISO 228, refer to Pressure taps on page 2							
	MB-ZR MB-ZRD MB-ZRDLE MB-ZRLE	fast opening fast opening slowly opening slowly opening	with with with	without with with without				
Solenoid valve V2		Valve V2 design	A Group 2, fast closin Partial volume restrict with	or Main volume restrictor				
Solenoid valve V1	Valve as per DIN EN 161 Class A Group 2, fast closing, fast opening							
Pressure regulator	Pressure regulator compensated for residual pressure, leakproof seal when switched off by means of valve V1 as per DIN EN 88 Class A. Setpoint spring permanently installed (no spring exchange possible). A vent line above roof is not required. Internal pulse tap provided.							
Pressure switches	Types GWA5, ÜBA2 / NBA2 to DIN EN 1854 may be attached. For further information, refer to Datasheets 5.02 and 5.07 "Pressure Switches for DUNGS Multiple Actuators"							
Dirt trap	Sieve, microfilter, changing the filter is possible without removing the valve.							
Ambient temperature	-15 °C to +70 °C (Do not operate MB-ZR below 0 °C in liquid gas systems. Only suitable for gaseous liquid gas, liquid hydrocarbons destroy sealing materials.)							
Media	Gases of families 1, 2, 3 and other neutral gaseous media							
Output pressure ranges	MB-ZR S20/S22 p _a : 4 mbar (0.4 kPa) to 20 mbar (2 kPa) MB-ZR S50/S52 p _a : 20 mbar (2 kPa) to 50 mbar (5 kPa)							
Max. operating pressure	360 mbar (36 kPa)							
Nominal diameters Flange with pipe threads as per ISO 7/1 (DIN2999)	MB-ZR419 Rp 1, 1 1/4, and their cor	1 1/2, 2	MB-ZR420 Rp 1, 1 1/4, and their cor	1 1/2, 2				
ISO 7/1 (DIN 2999) Max. operating pressure	and their cor	1 1/2, 2 mbinations 36 kPa)	and their cor	1 1/2, 2 mbinations				


บริษัท เอดีดี เพอร์เนส จำกัด 44 ซ.บรมราชชนน /บ ถ.บรมราชชนน ศาสาธรรมสพน พบะผน กาย เมื่อ Add Furnace Co.,Ltd. Line ID: @add11 e-mail: add028883472@gmail.com

44 ซ.บรมราชชนนี 70 ถ.บรมราชชนนี ศาลาธรรมสพน์ ทวีวัฒนา กทม. 10170.

Equipment variants GasMultiBloc®B01 Two-stage function	415 B01	420 B01	
MB-ZR	•	•	
MB-ZRD	•	•	
MB-ZRDLE	•	•	
MB-ZRLE	•	•	
Microfilter (standard) with sieve	•	•	Filter element can be removed. A suitable GF/1 gas
Gas pressure switch			filter must then be fitted upstream.
downstream of filter	•	•	
downstream of valve V2 on adapter laterally	•	•	
Pressure regulator	•	•	
Valve V1, double seat	•	•	
Valve V2, double seat	•	•	
Valves opening together	•	•	S 20, S 50
Valves opening separately	•	•	S 22, S 52
Flange Rp 1	•	•	• = possible
Rp 1 1/4	•	•	(•) = on request
Rp 1 1/2	•	•	- = not possible
Rp 2	•	•	

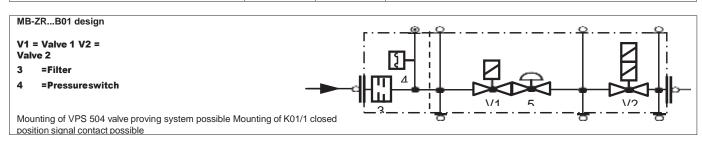

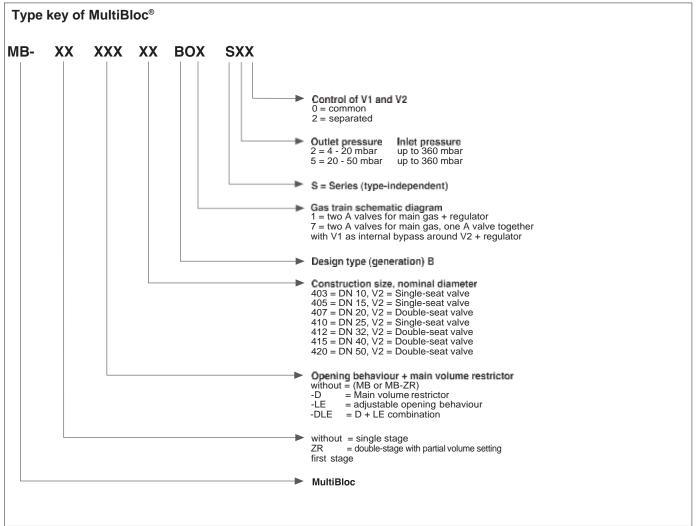

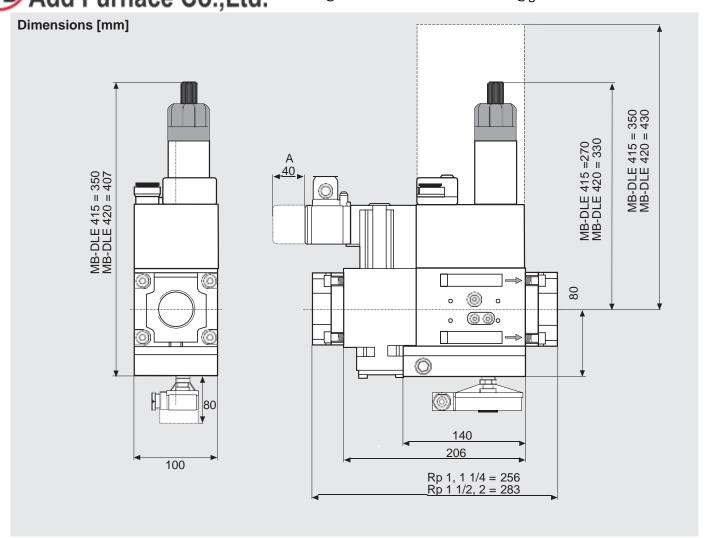

Туре	Rp	Opening time	Nominal rating [VA] 230 V AC;+20°C			Weight [kg]	
			S20	S50	S22	S52	
MB-ZRD 415 B01	Rp 1 - 2	< 1s	80	80	120	120	8.0
MB-ZRDLE 415 B01	Rp 1 - 2	< 20 s	80	80	120	120	8.1
MB-ZRD 420 B01	Rp 1 - 2	< 1s	115	115	135	135	10,1
MB-ZRDLE 420 B01	Rp 1 - 2	< 20 s	115	115	135	135	10.2



44 ซ.บรมราชชนนี 70 ถ.บรมราชชนนี ศาลาธรรมสพน์ ทวีวัฒนา กทม. 10170.


website: https://www.add-furnace.com/ โทร: 02-888-3472

Line ID: @add11 e-mail: add028883472@gmail.com

GasMultiBloc® Combined regulator and safety shutoff valves Two-stage function

MB-ZRD(LE) 415 - 420 B01



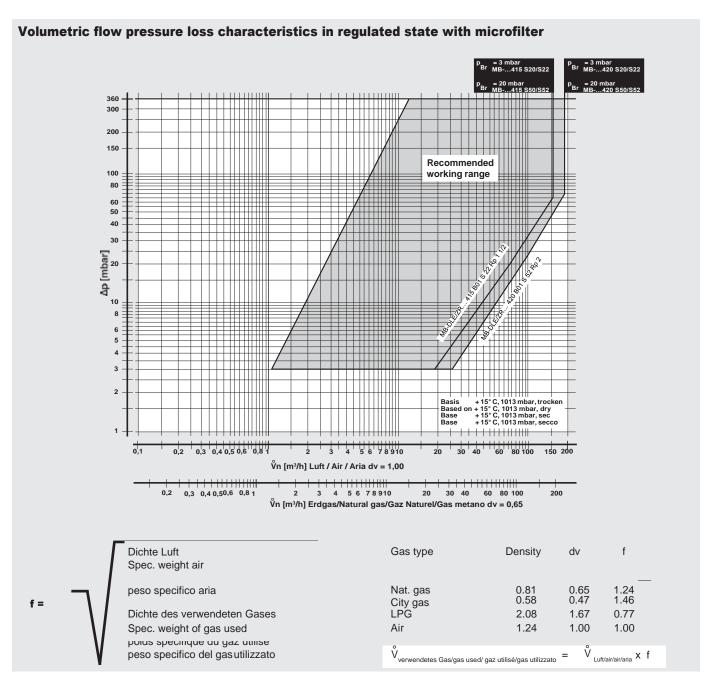

We reserve the right to make any changes in the interest of technical progress.