website: https://www.add-furnace.com/ โทร: 02-888-3472

CS800 Series Commercial / Industrial Pressure Reducing Regulators



TYPE CS803 REGULATOR WITH TRUE-MONITOR™ PROTECTION

TYPE CS804IT REGULATOR WITH INTEGRAL TYPE VSX8 SLAM-SHUT MODULE

Figure 1. Typical CS800 Series Pressure Reducing Regulators

Table of Contents

Introduction	1
Specifications	2
Principle of Operation	3
Installation and Overpressure Protection	10
Startup	14
Adjustment	14
Shutdown	16
Maintenance and Inspection	16
Parts Ordering	20
Parts List	22

Introduction

Scope of the Manual

This Instruction Manual provides instructions for the installation, maintenance and parts ordering information of CS800 Series service regulators. Instructions and parts list for the Type TM600 Integral True-Monitor are found in Instruction Manual D103126X012. Instructions and parts list for the Type VSX8 Slam-shut are found in Instruction Manual D103127X012.







website: https://www.add-furnace.com/ โทร: 02-888-3472

Line ID: @add11 e-mail: add028883472@gmail.com

Specifications

The Specifications section lists the specifications for the CS800 Series regulators. The following information is stamped on the regulator at the factory: Type number, date of manufacture, spring range, orifice size, maximum inlet pressure, maximum operating outlet pressure and outlet pressure. Exceeding any of these limits may damage regulator parts.

Available Configurations

See Table 1

Body Sizes, Material, End Connections and Pressure Ratings⁽¹⁾

See Table 3

Maximum Inlet Pressures(1)

Emergency: 175 psig / 12.1 bar

Operating: See Table 4

Maximum Outlet Pressure(1)

Emergency

Regulator Casing: 15 psig / 1.0 bar Integral Monitor Casing: 25 psig / 1.7 bar Integral Slam-shut Casing: 87 psig / 6.0 bar To avoid internal parts damage: 3 psig / 0.21 bar

differential above outlet pressure setting

Operating Pressure Ranges⁽¹⁾
Regulator: See Table 5

Integral True-Monitor™: See Tables 8 and 9 Slam-shut Module: See Tables 10 to 11

Secondary Seat™ Protection Outlet Pressures

See Table 7

Spring Case Vent Connection Internal Relief: 1 NPT

High Capacity Relief: 2-1/2 NPT

Internal Relief Performance

See Table 6

Token Relief Performance

Approximate Token Relief Start-to-Discharge:

See Table 6

Orifice Sizes, Flow Coefficients and IEC Sizing Coefficients

See Table 4

Pressure Registration

Internal or External

Temperature Capabilities(1)(2)

-20 to 150°F / -30 to 66°C

According to European PED Directive that rates products to a minimum temperature of -4°F / -20°C and a maximum temperature of 140°F / 60°C:

-4 to 140°F / -20 to 60°C

Approximate Weight

With Threaded Body

Type CS800/CS820: 25 lbs / 11 kg Type CS803/CS823: 34 lbs / 16 kg Type CS804/CS824: 31 lbs / 16 kg Type CS805/CS825: 26 lbs / 12 kg Type CS806/CS826: 26 lbs / 12 kg

High-Pressure Types

For CS85x add 2 lbs / 1 kg to types listed above

With Flanged Body

Add 11 lbs / 5 kg to weights listed above

PED Conformity Statement and Information

Types CS800, CS804, CS820, CS824, CS850 and CS854 are in conformity with the Pressure Equipment Directive PED 2014/86/EU and are classified under Category I for units without a slam-shut and Category IV for units with a slam-shut. See Table 2.

For Types CS800, CS820 and CS850, equipment and pipeline situated on outlet side of the regulator are either

- not subject to the PED (PS ≤ 0.5 bar) or
- subject to (PS > 0.5 bar) in which case they should come under Category I maximum

PED Related Information

See Table 2

- 1. The pressure/temperature limits in this Instruction Manual and any applicable standard or code limitation should not be exceeded.
- 2. Product has passed Emerson Process Management Regulator Technologies, Inc. (Emerson) testing for lockup, relief start-to-discharge and reseal down to -40 degrees.

WARNING

Failure to follow these instructions or to properly install and maintain this equipment could result in an explosion and/or fire causing property damage and personal injury or death.

Fisher™ regulators must be installed, operated and maintained in accordance with federal, state and local codes, rules and regulations and Emerson instructions.

If the regulator vents gas or a leak develops in the system, service to the unit may be required. Failure to correct trouble could result in a hazardous condition.

Call a gas service person to service the unit. Only a qualified person must install or service the regulator.

Description

CS800 Series regulators are typically installed on industrial and commercial applications. See Table 1 for available configurations. Constructions with External Registration, e.g., Type CS800EN, require an external control line.

The CS800 Series offers multiple forms of overpressure protection including:

Internal Relief - Minimizes downstream pressure buildup by relieving gas through the diaphragm assembly and out the 1 NPT vent to atmosphere in the event of an overpressure situation.

High Capacity Relief - Provides an increase in relief performance over basic internal relief via a 2-1/2 NPT vent thereby offering a significant improvement in the level of overpressure protection to the downstream system in the event of an overpressure occurrence.

บริษัท เอดีดี เฟอร์เนส จำกัด Add Furnace Co.,Ltd. Line ID: @add11 e-mail: add028883472@gmail.com

website: https://www.add-furnace.com/ โทร: 02-888-3472

Table 1. Available Configurations

			TYPE N	IUMBEF	?			20-10-11
С	S	8						OPTION
	•							OUTLET PRESSURE CONSTRUCTION
			0					Low Pressure Applications (Outlet Pressure: 3.5 to 30 in. w.c. / 9 to 75 mbar)
			2					Medium Pressure Applications (Outlet Pressure: 1 to 5.5 psig / 0.07 to 0.38 bar)
			5					High Pressure Applications (Outlet Pressure: 5 to 10 psig / 0.34 to 0.69 bar)(1)
								OVERPRESSURE PROTECTION MODULE
				0				Without Overpressure Protection Module
				3				With Integral True-Monitor Module ⁽⁴⁾
				4				With Slam-shut Module ⁽⁴⁾
				5				With Secondary Seat Protection
				6				With Secondary Seat Protection with controlled bleed to indicate Secondary Seat is functioning ⁽²⁾
								PRESSURE REGISTRATION
					I			Internal Registration
					Е			External Registration ⁽³⁾
								RELIEF
						N		Non-Relieving
						R		Internal Relief
						Q		High-Capacity Relief
						Т		Token Relief
						L		Low Flow Token Relief
							SC	Stabilizer Cartridge
	2							Example: Type Number CS800IR: Type CS800 regulator without Overpressure Protection Module with Internal Pressure Registration and with Internal Relief. 1. High-pressure Construction is not available with True-Monitor Protection, Secondary Seat Protection or Relief. 2. Available only with Internal Relief or High-Capacity Relief Constructions. 3. Available only with Non-Relieving or Token Relief Constructions. 4. Reference Instruction Manual D103126X012 for information regarding the Type TM600 Integral True-Monitor or Instruction Manual D103127X012 for Type VSX8 safety Slam-shut module.

Integral True-Monitor™ Protection - Provides amonitoring regulator integrally mounted on the inlet side of the valve body that assumes control of flow to the downstream system should the primary regulator cease to regulate flow.

Secondary Seat™ Protection - Provides a solution to the most common cause of regulators failing to shutoff by employing a secondary seating surface to provide shutoff in the event the primary orifice seating surface becomes damaged or blocked.

Slam-shut Protection - Discontinues gas service by shutting the gas off if there is an overpressure or underpressure condition.

Principle of Operation

Types CS800, CS820 and CS850 Base **Regulators Operation**

Refer to Figures 2 and 3. When downstream demand decreases, the pressure under the diaphragm increases. This pressure overcomes the regulator setting (which is set by the regulator control spring). Through the action of the pusher post assembly, lever and valve stem, the valve disk moves closer to the orifice and reduces gas flow. If demand downstream increases, pressure under the diaphragm decreases. Spring force pushes the pusher post assembly downward, the valve disk moves away from the orifice and the gas flow increases downstream as the regulator opens in response to the decreased pressure underneath the diaphragm.

The Type CS800IR regulator includes an internal relief valve for overpressure protection. If the downstream pressure

exceeds the regulator setting by 7 in. w.c. to 2.5 psig / 17 to 172 mbar (depending on the type number and main spring used), the relief valve opens and excess gas is vented through the stabilizer vent in the upper spring case. Units with standard internal relief valve have 1 NPT vent size, Figure 2, while units with high-capacity relief valve have 2-1/2 NPT vent size, Figure 3.

The Types CS800IT, CS800IL, CS800ET and CS800EL provide a low-capacity/token relief. Token relief provides relief from minor overpressure caused by nicks or dents on the orifice or by thermal expansion of gas in the downstream line. Token relief also provides a token or signal, in the form of odor, that an overpressure situation is occurring.

Stability Cartridge

The CS800 Series provides an optional stability cartridge as a solution to system instability. The stabilizer cartridge is used to increase system stability with no piping and minimal specification changes. This device is a compact assembly that is installed, without using any special tools, in the throat of a Type CS800 regulator. See Installation Sheet D104125X012.

Types CS803 and CS823 Integral **True-Monitor Operation**

Types CS803 and CS823 combine the operation of a conventional two-regulator wide-open monitor set into one body, see Figure 4. The Integral True-Monitor is installed on the inlet side of the body and serves to control downstream pressure in the situation where the primary regulator can no longer regulate downstream pressure.

website: https://www.add-furnace.com/ โทร: 02-888-3472

Line ID: @add11 e-mail: add028883472@gmail.com

Table 2. PED Information

TYPE	DESCRIPTION	BODY MATERIAL	PED CATEGORY	FLUID GROUP
CS800, CS820 and CS850	Base regulator	Ductile Iron and WCC Steel	I	Groups 1 and 2 according to 2014/86/EU, 1st and 2nd family gas according to EN 437 or
CS804, CS824 and CS854	Regulator with Slam-shut Module	Ductile Iron and WCC Steel	IV	other gases (compressed air, nitrogen). The gas must be non-corrosive, clean
Eu	ropean EN Reference Standa	ards	EN 334, EN 14382	(filtration on inlet side necessary) and dry.

Table 3. Body Sizes, Materials, End Connections and Maximum Cold Working Pressure Ratings⁽⁵⁾

TYPE	BODY	END		SIZE	PART NUMBER		O-FACE NSION		INLET RE RATING	
	MATERIAL	CONNECTION	ln.	DN		In.	mm	psig	bar	
			1-1/4		GE25859X012	6.12	155			
C2000 C200E		NPT	1-1/2		GE26296X012	6.12 155	155			
CS800, CS805, CS806, CS820,	Gray Cast Iron	INFI	2 ⁽¹⁾		GE26300X012	6.12	155	175	12.1	
CS825, CS826 and CS850	Gray Cast Iron		2		ERAA02462A0	7.5	191	173	12.1	
and C3030		CL 40E EE	2	50	GE26301X012	7.5	191			
		CL125 FF	2	50	GE26303X012	10	254			
	Gray Cast Iron	NPT	2(2)		ERAA02437A0	6.12	155	175	12.1	
			1-1/4(4)		GE26306X012	6.12	155			
		NPT	1-1/2		ERAA02453A1	6.12	155			
			2		ERAA02437A1	6.12	155			
		Rp	2		ERAA02715A1	6.12	155	250	17.2	
	Ductile Iron			2	50	GE48292X012	7.5(4)	191(4)		
00000(2) 00000(2)		CL125 FF / CL150 FF	2	50	ERAA02711A1	10	254			
CS800 ⁽³⁾ , CS820 ⁽³⁾ , CS850 ⁽³⁾ , CS803,		0210011	2	50	ERAA02718A1	10.5	267			
CS823, CS804, CS824 and CS854		PN 10/16	2	50	GE48296X012	7.5(4)	191(4)	000	40	
C3624 and C3634		PN 10/16	2	50	ERAA02719A1	10	254	232	16	
			1-1/4(4)		GE26306X022	6.12	155			
		NPT	1-1/2		ERAA02453A2	6.12	155			
	MCC Stort		2		ERAA02437A2	In.	20			
	WCC Steel	Rp	2		ERAA02715A2	6.12	155			
		CL150 RF	2	50	ERAA02720A2	10	254			
		PN 10/16	2	50	ERAA02719A2	10	254	232	16	

^{1.} Standard on Types CS800, CS820 and CS850.

Table 4. Inlet Pressure Ratings and Flow and Sizing Coefficients

ORIFIC	ORIFICE SIZE	_	OPERATII			IVIAA	IMUM NCY INLET	WIDE-OPEN FLOW COEFFICIENTS			IEC SIZING COEFFICIENTS			
		psig Se	etpoints	In. w.c. S	Setpoints	PRES	SURE							
ln.	In. mm psig bar		bar	psig	bar	psig	bar	C _g	C _v	C ₁	Χ _τ	F _L	F _D	
1/4(1)	6.4(1)	125	8.6	125	8.6			50	2.1	24.6	0.38		0.99	
3/8	9.5	125	8.6	125	8.6]		110	3.8	29.5	0.55]	0.90	
1/2	13	100	6.9	100	6.9]		210	7.2	29.5	0.55]	0.93	
5/8	16	80	6.5	60	4.1	175	10.1	320	10.1	31.8	0.64	0.00	0.88	
3/4	19	80	6.5	60	4.1	1/5	12.1	450	13.3	34	0.73	0.89	0.84	
7/8	22	60	4.1	50	3.4]		600	16.7	36	0.82]	0.81	
1(1)	25(1)	30	2.1	25	1.7]		765	20.1	38.1	0.92]	0.77	
1-3/8(1)(2)	35(1)(2) 15 1.0 15 1.0]		1125	29.8	37.7	0.90]	0.76				

^{1.} Not available on the Types CS805, CS806, CS825 and CS826. 2. Not available on the Types CS803 and CS823.

^{2.} Standard on Types CS803, CS804, CS823, CS824 and CS854.

^{3.} If a ductile iron or steel body material is selected without an Integral True-Monitor™ or Slam-shut Overpressure Protection (OPP) device, the port located at the bottom of the body will 4. Not available on Types CS804, CS824 and CS854.

5. The pressure/temperature limits in this Instruction Manual or any applicable standard or code limitation should not be exceeded.

Table 5. Outlet Pressure Ranges

TYPE	OUTLET PRES	SSURE RANGE	COLOR CODE	PART NUMBER	SPRING WIF	E DIAMETER	SPRING FREE LENGTH		
ITPE	In. w.c.	mbar	COLOR CODE	PART NUMBER	ln.	mm	ln.	mm	
	3.5 to 6 ⁽¹⁾	9 to 15 ⁽¹⁾	Red	GE30337X012	0.15	3.8	6.8	173	
	5.5 to 8.5	13 to 21	Black	GE30338X012	0.17	4.3	6.8	173	
CS800, CS803, CS804, CS805	5.5 to 8.5	13 to 21	Brown [Use with Low Inlet (LIN) Option]	GE49043X012	0.16	4.1	8.3	211	
and CS806	8 to 12	20 to 30	Purple	GE30339X012	0.17	4.3	7.4	188	
	10 to 16	25 to 40	White	GE30340X012	0.18	4.6	7.4	188	
	14 to 30	35 to 75	Dark Green	GE30341X012	0.20	5.2	7.5	191	
CS820, CS823,	1 to 2.5 psig	69 to 170	Dark Blue	GE30342X012	0.25	6.4	7.5	191	
CS824, CS825	1.5 to 3.5 psig	100 to 241	Orange	GE46922X012	0.26	6.6	7.1	180	
and CS826	2.5 to 5.5 psig	170 to 380	Yellow	GE30343X012	0.29	7.5	6.7	170	
CS850 and CS854	5 to 10 psig	345 to 690	Green with White Stripe	GE30344X012	0.39	9.9	7.6	192	

^{1.} In order to achieve the complete spring range listed, in some applications it may be required to re-orient the actuator/spring case to point downward to utilize the weight of the internal components.

Table 6. Approximate Internal Relief Valve Start-to-Discharge Pressure above Setpoint

							RELIEF AND CITY RELIEF		TOKEN	RELIEF											
CONTROL SPRING	SETP	OINT	SET R	ANGE		arge Pressure	Opt	o-Discharge ion ⁽¹⁾	Start-to-Disch												
					Range Abo	ve Setpoint		narge Pressure ove Setpoint	Range Above Setpoint												
	In. w.c.	mbar	In. w.c.	mbar	In. w.c.	mbar	In. w.c.	mbar	In. w.c.	mbar											
GE30337X012	4			9 to 15	11 to 18	27 to 42	7 to 14	17 to 35	6 to 14	15 to 35											
GE30338X012	7 17		5.5 to 8.5	13 to 21	11 to 18	27 to 42	7 to 14	17 to 35	6 to 14	15 to 35											
GE30336X012	/	17	5.5 10 6.5	13 10 21	11 10 16	27 10 42	7 10 14	17 10 35	25 to 35	62 to 87											
GE49043X012 (LIN)	7	17	5.5 to 8.5	13 to 21	11 to 18	27 to 42	7 to 14	17 to 35	6 to 14	15 to 35											
GE49043A012 (LIN)			5.5 10 6.5		11 10 16		7 10 14	17 10 35	25 to 35	62 to 87											
GE30339X012	11	27	8 to 12	20 to 30	11 to 18	27 to 42	7 to 14	17 to 35	6 to 14	15 to 35											
GE30340X012	14	35	10 to 16	25 to 40	11 to 18	27 to 42	7 to 14	17 to 35	6 to 14	15 to 35											
GE30340X012	17	55	10 10 10	23 10 40	11 10 10	27 10 42	7 10 14	17 10 33	25 to 35	62 to 87											
GE30341X012	1 psig	69	14 to 30	35 to 75	7 in. w.c. to 1 psig	17 to 69			8 to 16	20 to 40											
GE30342X012	2 psig	138	1 to 2.5 psig	70 to 170	7 in. w.c. to 2 psig	17 to 138			7 in. w.c. to 1 psig	17 to 69											
GE46922X012	922X012 3 psig 207		1.5 to 3.5 psig	100 to 240	7 in. w.c. to 2 psig	17 to 138			0.5 to 1.5 psig	35 to 100											
GE30343X012	5 psig	345	2.5 to 5.5 psig	170 to 380	7 in. w.c. to 2.5 psig	17 to 170			1 to 2 psig	69 to 138											
1. Low start-to-discharge	option is only	y available	on the main c	ontrol spring r	anges up to 10 to 1	16 in. w.c. / 25 to 4	0 mbar.			1. Low start-to-discharge option is only available on the main control spring ranges up to 10 to 16 in. w.c. / 25 to 40 mbar.											

Table 7. Secondary Seat™ Protection Outlet Pressures

						T	PES CS8	05 AND CS	8825	T	PES CS80	6 AND CS	826
CONTR	OL SPRING	SPRING RANGE		SETPOINT				dary Seat Pressure ⁽²⁾	ı	Downstream Build-up Pressure(1)(2)(3)			
							Orifice Si	ize, In. / mr	n		1		
						3/8	/ 9.5	5/8	/ 16	3/8	/ 9.5	5/8	/ 16
Color	Part Number	In. w.c.	mbar	In. w.c.	mbar	In. w.c.	mbar	In. w.c.	mbar	In. w.c.	mbar	In. w.c.	mbar
Black	GE30338X012	5.5 to 8.5	13 to 21	7	17	11	27	12	30	25	62	23	57
Brown (LIN)	GE49043X012	5.5 to 8.5	13 to 21	7	17	11	27	12	30	25	62	23	57
White	GE30340X012	10 to 16	25 to 40	14	35	19	47	20	50	36	89	33	81
Dark Green	GE30341X012	14 to 30	35 to 75	1 psig	69	1.2 psig	83	1.3 psig	90	2.1 psig	0.14 bar	2 psig	0.14 bar
Dark Blue	GE30342X012	1 to 2.5 psig	69 mbar to 0.17 bar	2 psig	0.14 bar	2.6 psig	0.17 bar	2.6 psig	0.18 bar	3.8 psig	0.26 bar	3.7 psig	0.26 bar
Yellow	GE30343X012	2.5 to 5.5 psig	0.17 to 0.38 bar	5 psig	0.34 bar	6.3 psig	0.43 bar	6.3 psig	0.43 bar	7.4 psig	0.51 bar	8.2 psig	0.56 bar

^{1.} Downstream pressure buildup with Secondary Seat fixed bleed in operation and regulator relief valve relieving to atmosphere.

Outlet pressure values listed are at maximum operating inlet pressure rating per orifice. See Table 4.
 If the outlet pressure rises above setpoint exceeds 3 psig / 207 mbar, inspect internal parts and replace if damaged.

website: https://www.add-furnace.com/ โทร: 02-888-3472

Line ID: @add11 e-mail: add028883472@gmail.com

Table 8. Primary Regulator and Integral True-Monitor™ Outlet Pressure Ranges without Token Relief

		PRII	MARY REGULAT	ror					INTEGRAL 1	TRUE-MONITOR	!	
T	Typical	Setpoint	Spring Part	Spring	Range	Spring	Setp	oint	Spring Part	Spring R	lange	Spring
Type	In. w.c.	mbar	Number	In. w.c.	mbar	Color	In. w.c.	mbar	Number	In. w.c.	mbar	Color
							14	35	GE30189X012	12 to 21	30 to 52	Blue
	4	10	GE30337X012	3.5 to 6	9 to 15	Red	21	52	GE30196X012	18 to 30	45 to 75	Green
							1 psig	69	GE30225X012	26 to 40	65 to 99	Orange
							14	35	GE30189X012	12 to 21	30 to 52	Blue
	7	17	GE30338X012	5.5 to 8.5	13 to 21	Black	21	52	GE30196X012	18 to 30	45 to 75	Green
							1 psig	69	GE30225X012	26 to 40	65 to 99	Orange
							14	35	GE30189X012	12 to 21	30 to 52	Blue
	7	17	GE49043X012	5.5 to 8.5	13 to 21	Brown (LIN)	21	52	GE30196X012	18 to 30	45 to 75	Green
CS803IN						(=)	1 psig	69	GE30225X012	26 to 40	65 to 99	Orange
and CS803EN							21	52	GE30196X012	18 to 30	45 to 75	Green
	11	27	GE30339X012	8 to 12	20 to 30	Purple	1 psig	69	GE30225X012	26 to 40	65 to 99	Orange
							1.5 psig	103	GE30190X012	1.4 to 2.9 psig	97 to 200	Black
	14	35	GE30340X012		25 to 40		21	52	GE30196X012	18 to 30	45 to 75	Green
				10 to 16		White	1 psig	69	GE30225X012	26 to 40	65 to 99	Orange
							1.5 psig	103	GE30190X012	1.4 to 2.9 psig	97 to 200	Black
							1.5 psig	103	GE30190X012	1.4 to 2.9 psig	97 to 200	Black
	1 psig	69	GE30341X012	14 to 30	35 to 75	Dark Green	2 psig	138	GE30190X012	1.4 to 2.9 psig	97 to 200	Black
							3.5 psig	241	GE35081X012	2.6 to 3.7 psig	179 to 255	Purple
							2.5 psig	172	GE30190X012	1.4 to 2.9 psig	97 to 200	Black
	2 psig	138	GE30342X012	1 to 2.5 psig	69 to 170	Dark Blue	3 psig	207	GE35081X012	2.6 to 3.7 psig	179 to 255	Purple
				- 1 - 3			5 psig	345	GE30192X012	3.6 to 6 psig	248 to 414	Dark Blue
CS823IN							3.5	241	GE35081X012	2.6 to 3.7 psig	179 to 255	Purple
and	3 psig	207	GE46922X012	1.5 to 3.5 psig	100 to 241	Orange	4	276	GE30192X012	3.6 to 6 psig	248 to 414	Dark Blue
CS823EN				, 0			6	414	GE33121X012	4 to 7.5	276 to 517	Red
							6	414	GE33121X012	4 to 7.5	276 to 517	Red
	5 psig	345	GE30343X012	2.5 to 5.5 psig	170 to 380	Yellow	7	483	GE33121X012	4 to 7.5	276 to 517	Red
				. 5			7.5	517	GE33121X012	4 to 7.5	276 to 517	Red

Table 9. Primary Regulator and Integral True-Monitor™ Outlet Pressure Ranges with Token Relief

		PF	RIMARY REGULA	ATOR			INTEGRAL TRUE-MONITOR						
Type	Setp	oint	Spring Part		Pressure nge	Spring	Setp	oint	Spring Part	Spring Pres	sure Range	Spring	
7,1	In. w.c.	mbar	Number	In. w.c.	mbar	Color	In. w.c.	mbar	Number	In. w.c.	mbar	Color	
	4	10	GE30337X012	3.5 to 6	9 to 15	Red	21	52	GE30196X012	18 to 30	45 to 75	Green	
	4	10	GE30337X012	3.5 10 6	91015	Reu	1 psig	69	GE30225X012	26 to 40	65 to 99	Orange	
	7	17	GE30338X012	5.5 to 8.5	13 to 21	Black	21	52	GE30196X012	18 to 30	45 to 75	Green	
	,	17	GE30336A012	5.5 10 6.5	13 10 21	DIACK	1 psig	69	GE30225X012	26 to 40	65 to 99	Orange	
CS803IT.	7	17	GE49043X012	5.5 to 8.5	13 to 21	Brown	21	52	GE30196X012	18 to 30	45 to 75	Green	
CS803IL, CS803ET	,	17	GE49043A012	5.5 10 6.5	13 10 21	(LIN)	1 psig	69	GE30225X012	26 to 40	65 to 99	Orange	
,	11	27	GE30339X012	8 to 12	20 to 30	Purple	1 psig	69	GE30225X012	26 to 40	65 to 99	Orange	
	!!	21	GE30339A012	0 10 12	20 to 30	ruipie	1.5 psig	103	GE30190X012	1.4 to 2.9 psig	97 to 200	Black	
	14	35	GE30340X012	10 to 16	25 to 40	White	1 psig	69	GE30225X012	26 to 40	65 to 99	Orange	
	14	33	GL30340X012	10 10 10	23 10 40	VVIIILE	1.5 psig	103	GE30190X012	1.4 to 2.9 psig	97 to 200	Black	
	1 psig	69	GE30341X012	14 to 30	35 to 75	Dark	2 psig	138	GE30190X012	1.4 to 2.9 psig	97 to 200	Black	
	i psig	09	GL30341X012	14 10 30	33 10 73	Green	3 psig	207	GE35081X012	2.6 to 3.7 psig	179 to 255	Purple	
	2 psig	138	GE30342X012	1 to 2.5	69 to 170	Dark	3 psig	207	GE35081X012	2.6 to 3.7 psig	179 to 255	Purple	
CS823IT.	z psig	130	GE30342A012	1 10 2.5	09 10 170	Blue	4 psig	276	GE30192X012	3.6 to 6 psig	248 to 414	Dark Blue	
CS823IL, CS823ET	3 psig	207	GE46922X012	1.5 to 3.5	100 to 241	Orange	5 psig	345	GE30192X012	3.6 to 6 psig	248 to 414	Dark Blue	
and	o psig	201	GE40922X012	1.5 10 3.5	100 to 241	Orange	6 psig	414	GE33121X012	5.1 to 7.5 psig	352 to 517	Red	
CS823EL	5 psig	345	GE30343X012	0.5 4- 5.5	F 470 to 000	Yellow	7 psig	483	GE33121X012	5.1 to 7.5 psig	352 to 517	Red	
	5 psig	343	GE30343X012	2.5 to 5.5	170 to 380	i ellow	7.5 psig	517	GE33121X012	5.1 to 7.5 psig	352 to 517	Red	

Table 10. Regulator and Slam-shut Overpressure Shutoff (OPSO) Pressure Ranges

		DECULATOR					SLAM-SHUT	DEVICE	
		REGULATOR	(Ove	er Pressure Sh	ut-off (OPSO)	
_	Factory	Setpoint	Spring	Range	Factory S	Setpoint ⁽¹⁾	Spring	Range ⁽²⁾	Spring
Туре	In. w.c.	mbar	In. w.c.	mbar	In. w.c.	mbar	In. w.c.	mbar	Part Number and Color
	4	10	3.5 to 6	9 to 15	19	47	- 12 to 25	30 to 60	GF02168X012 / Brown
	7	17	5.5 to 8.5	14 to 21	22	55	12 10 23	30 10 60	GF02106X0127 BIOWIT
	7 (optional)	17 (optional)	5.5 to 8.5	14 to 21	25	62	16 to 44	40 to 110	GF02169X012 / Red
CS804	11	27	8 to 12	20 to 30	25	02	10 10 44	40 10 110	GF02109X0127 Red
	14	35	10 to 16	25 to 40	30	75	24 to 78	60 to 190	GF02170X012 / Orange
	14 (optional)	35 (optional)	10 to 16	25 to 40	2 psig	138	1.4 to	97 to 283	GF02171X012 / Pink
	1 psig	69	14 to 30	35 to 75	2 psig	138	4.1 psig	97 10 203	GI 0217 IX0127 FIIIK
	2 psig	138	1 to 2.5 psig	69 to 170	3.5 psig	241			
CS824	3 psig	207	1.5 to 3.5 psig	100 to 241	5 psig	345	2 to 7.3 psig	138 to 503	GF02172X012 / Green
	5 psig	345	2.5 to 5.5 psig	170 to 380	7 psig	483	3.2 to 8.5 psig	221 to 586	GF02173X012 / Silver
CS854	7 psig	483	5 to 10 psig	345 to 690	9 psig	621	5.8 to 13 psig	400 to 896	GF04353X012 / Yellow

^{1.} For units equipped with Token Relief, if Non-Factory Slam-shut OPSO setpoints are specified, they must be higher than the Token Relief Start-to-Discharge values provided in Table 6. 2. If Non-Factory OPSO setpoints are specified, the allowable OPSO setpoint cannot exceed the maximum of 3 psig / 207 mbar above the regulator setpoint in order to ensure no internal parts damage from overpressure.

website: https://www.add-furnace.com/ โทร: 02-888-3472

Line ID: @add11 e-mail: add028883472@gmail.com

Table 11. Regulator and Slam-shut Underpressure Shutoff (UPSO) Pressure and Overpressure Shutoff (OPSO) Ranges

									SLAM-SH	UT DEVIC	E			
	К	EGULA	IOR			Under P	ressure S	hut-off (UPSO)		Over	Pressure \$	Shut-off (0	OPSO)
Туре	Fact Setp	•	Spring	Range	Facto Setpo	Shring D		Range	Spring Part Number and Color	Facto Setpo		Spring Over Setpe		Spring Part Number and Color
	In. w.c.	mbar	In. w.c.	mbar	In. w.c.	mbar	In. w.c.	mbar	Color	In. w.c.	mbar	In. w.c.	mbar	Color
	7	17	5.5 to 8.5	14 to 21	3	7				22	55			
CS804 11		27	8 to 12	20 to 30	6	15	2 to 12	5 to 30	T14168T0012 / White	25	62	17 to 28	42 to 69	GF02168X012 / Brown
CS804 -	14	35	10 to 16	25 to 40	9	22				30	75			
	1 psig	69	14 to 30	35 to 75	0.5 psig	35	0.36 to 2.3 psig	25 to 160	T14170T0012 / Silver	2 psig	138	1.3 to 3.1 psig	90 to 214	GF02170X012 / Orange
	2 psig	138	1 to 2.5 psig	69 to 170	1 psig	69	0.36 to 2.3 psig	25 to 160	T14170T0012 / Silver	3.5 psig	241	1.3 to 3.1 psig	90 to 214	GF02170X012 / Orange
CS824	3 psig	207	1.5 to 3.5 psig	100 to 241	1.75 psig	121	1.5 to	100 to	FA142869X12 /	5 psig	345	2.7 to	186 to	GF02171X012 /
•	5 psig	345	2.5 to 5.5 psig	170 to 380	3 psig	207	7.3 psig	500	Orange Stripe	7 psig	483	5.5 psig	379	Pink
CS854	7 psig	483	5 to 10 psig	345 to 690	3.5 psig	241	1.5 to 7.3 psig	100 to 500	FA142869X12 / Orange Stripe	9 psig	621	2.7 to 5.5 psig	186 to 379	GF02171X012 / Pink

^{1.} If Non-Factory UPSO setpoints are specified, a minimum differential of 4 in. w.c. / 10 mbar between UPSO setpoint and regulator setpoint must be maintained in order to ensure a secure latch of the Slam-shut.

During normal operation the True-Monitor™ is in a wide open state as its setpoint is set higher than the primary regulator. See Tables 8 and 9 for guidance regarding the setpoints of the regulator and associated Integral Monitor sets. If the downstream pressure should rise to the setpoint of the True-Monitor due to loss of pressure control by the primary regulator, the monitor will assume control and regulate flow to the downstream system. If a token relief is present, the token relief will relieve a small amount of gas to the atmosphere as an indication that the Integral Monitor is controlling the downstream pressure.

Either internal or external downstream pressure registration is available. External pressure registration requires a downstream sensing line. See the Type TM600 Integral True-Monitor Instruction Manual (D103126X012) for additional details of operation.

Types CS804, CS824 and CS854 Slam-shut Operation

The Type VSX8 Slam-shut module on the CS804 Series regulators is a fast acting shutoff device that provides overpressure (OPSO) or overpressure and underpressure (OPSO/UPSO) protection by completely shutting off the flow of gas to the downstream system. See Tables 10 and 11 for guidance regarding the typical setpoint of the regulator and associated OPSO and UPSO sets. The Type VSX8's actions are independent of the CS804 Series regulator and of variations to the inlet pressure. The Type VSX8 provides the option of internal or external downstream pressure registration. External registration requires a downstream

sensing line. See Figure 11 for guidance regarding installation of the downstream control line.

The Type VSX8 shutoff disk is normally in the open (reset) position, see Figure 5. If the downstream pressure below the slam-shut diaphragm increases (or decreases) until it reaches the slam-shut setpoint, this diaphragm moves upward (or downward) to release the trip mechanism which allows the spring force on the stem to push the disk against the seat, shutting off all gas flow. To reset the slam-shut after gas has been shutoff; refer to Type VSX8 Instruction Manual (D103127X012) for additional details.

! WARNING

In order for the Underpressure Shutoff (UPSO) of any slam-shut to be triggered, the downstream pipe pressure must drop below the UPSO setpoint. In the case of a downstream line break, numerous factors can prevent the downstream pipe pressure from decreasing below the slam-shut UPSO setpoint. These factors include the distance of pipe to the break, the diameter of the pipe, size of the break and the number of restrictions, such as valves, elbows and bends, downstream of the regulator and/ or slam-shut device. Due to these factors additional protections should be installed to stop flow in the event of a line break.

For units equipped with Token Relief, if Non-Factory Slam-shut OPSO setpoints are specified, they must be higher than the Token Relief Start-to-Discharge values provided in Table 6.
 If Non-Factory OPSO setpoints are specified, the allowable OPSO setpoint cannot exceed the maximum of 3 psig / 207 mbar above the regulator setpoint in order to ensure no internal parts damage from overpressure.

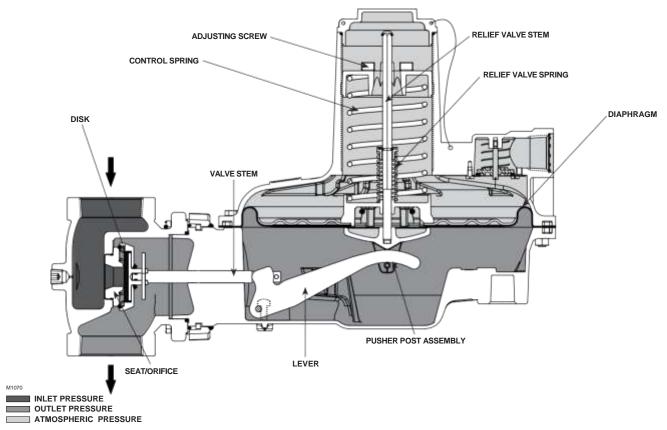


Figure 2. Type CS800IR Internally Registered Regulator with Internal Relief Operational Schematic

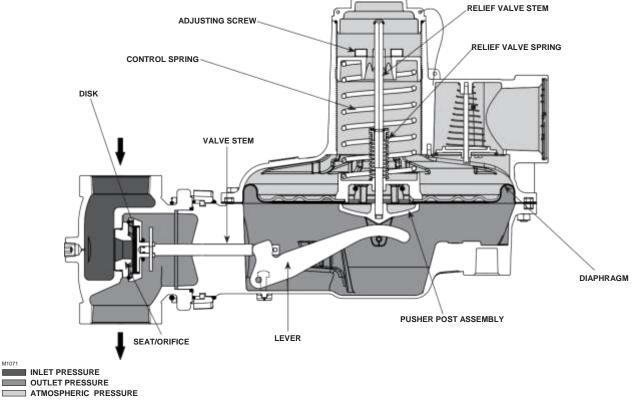


Figure 3. Type CS800IQ Internally Registered Regulator with High Capacity Relief Operational Schematic



If the slam-shut device trips due to a lever disconnect failure of the main regulator, it is recommended that you check downstream equipment for damage prior to re-setting the slam-shut.

Types CS805 and CS825 with Secondary Seat™ Protection

CAUTION

Types CS805 and CS825 regulators do not have any means to alert when the Secondary Seat operates at lockup. Therefore, it is recommended that Internal relief or high-capacity relief are also selected or the addition of some other method of overpressure protection be added in the downstream system as discussed in the Overpressure Protection section.

Refer to Figure 6. The CS805 Series provides Secondary Seat Protection. As downstream demand decreases and downstream pressure rises to the regulator pressure lock-up value, the regulator will lock up. If, however, damage has occurred to the primary disk or orifice's seating surface (seat) or debris has become lodged between the primary disk and seat, the outlet pressure will continue to rise. This additional pressure causes the disk to apply additional force to the primary seat, which causes the Secondary Seat to move toward the secondary disk/sealing surface. If downstream demand decreases to zero, then the Secondary Seat will contact the sealing surface to provide lockup. Refer to Table 7 for approximate lock-up values provided by the Secondary Seat.

Types CS806 and CS826 Secondary Seat Protection with Bleed

When the Secondary Seat is providing lockup, the CS806 Series provides small bleed to the downstream system as an indication that the Secondary Seat is providing lockup. In the event that the primary seat and disk cannot provide lockup, the Secondary Seat will move into contact with a metal disk with a small drilled hole. This metal-to-metal interface and bleed hole will allow a small amount of gas to bleed downstream thereby increasing outlet pressure until the Internal relief valve begins to discharge gas to the atmosphere. The odor of this discharged gas provides an indication that the regulator is relying on the Secondary Seat for overpressure protection. See Table 7 for the Downstream Pressure Buildup of the Internal relief acting in conjunction with the Type CS806 Secondary Seat Assembly.

Secondary Seat Protection Limitations

CAUTION

Overpresssure conditions can occur in the downstream piping when the Secondary Seat Protection is installed. The Secondary Seat Protection serves only as a backup to the

44 ซ.บรมราชชนนี 70 ถ.บรมราชชนนี ศาลาธรรมสพน์ ทวีวัฒนา กทม. 10170.

website: https://www.add-furnace.com/ โทร: 02-888-3472

Line ID: @add11 e-mail: add028883472@gmail.com

primary seat for lockup. Refer to the sections on Overpressure Protection and Maintenance.

Secondary Seat Protection does not provide additional overpressure protection in the event the secondary seat or disk is damaged by debris or contamination in the pipeline or from conditions that would cause the regulator to go wide-open.

Installation and Overpressure Protection

! WARNING

Personal injury or system damage may result if this regulator is installed, without appropriate overpressure protection, where service conditions could exceed the limits given on the regulator nameplate.

Regulator installations should be adequately protected from physical damage.

All vents should be kept open to permit free flow of gas to the atmosphere. Protect openings against entrance of rain, snow, insects or any other foreign material that may plug the vent or vent line. For outdoor installations, point the spring case vent downward to allow condensate to drain (see Figure 8). This minimizes the possibility of freezing and of water or other foreign materials entering the vent and interfering with proper operation.

Under enclosed conditions or indoors, escaping gas may accumulate and be an explosion hazard. In these cases, the vent should be piped away from the regulator to the outdoors. See Vent Line Installation section for the recommended venting practices.

CAUTION

The CS800 Series regulators have an outlet pressure rating lower than their inlet pressure rating. If actual inlet pressure can exceed the outlet pressure rating, outlet overpressure protection is necessary. However, overpressuring any portion of the regulators beyond the limits in the Specifications section and referenced tables may cause leakage, damage to regulator parts or personal injury due to bursting of pressure-containing parts.

Some type of external overpressure protection should be provided if inlet pressure will be high enough to damage downstream equipment. Common methods of external overpressure protection include relief valves, monitoring regulators, shut-off devices and series regulation.

website: https://www.add-furnace.com/ โทร: 02-888-3472

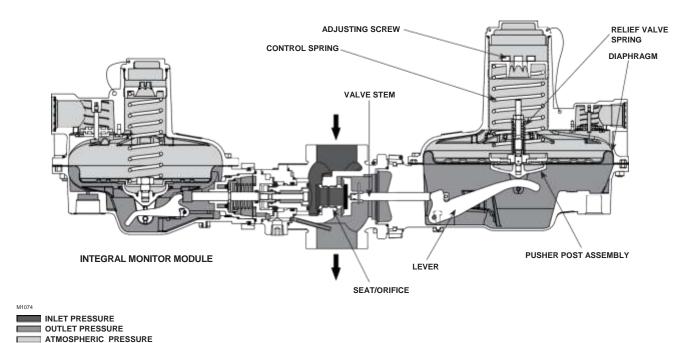


Figure 4. Type CS803IT Internally Registered Primary Regulator with Internally Registered Integral Monitor Operational Schematic

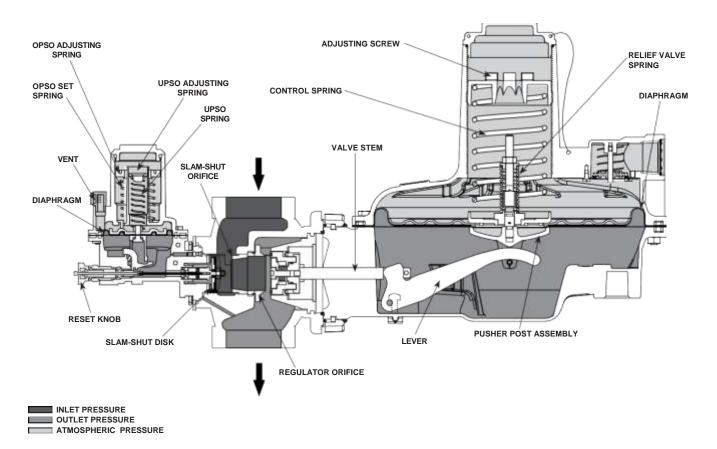


Figure 5. Type CS804IT Internally Registered Regulator with Slam-shut Module Operational Schematic

If the regulator is exposed to an overpressure condition, it should be inspected for any damage that may have occurred. Regulator operation below these limits does not preclude the possibility of damage from external sources or from debris in the pipeline.

General Installation Instructions

Before installing the regulator,

- Check for damage, which might have occurred during shipment.
- Check for and remove any dirt or foreign material, which may have accumulated in the regulator body.
- Blow out any debris, dirt or copper sulfate in copper tubing and the pipeline.
- Apply pipe compound to the external threads of the pipe before installing the regulator.

Note

Applying pipe compound to internal threads can result in excess pipe compound collecting in the body of the regulator and potentially clog registration ports, affect lockup or downstream equipment.

- Make sure gas flow through the regulator is in the same direction as the arrow on the body. "Inlet" and "Outlet" connections are clearly marked.
- When designing a pressure reducing station using a CS800 Series regulator, make an analysis if it is necessary to take into account the effects of wind, snow and temperature to avoid unnecessary load and movement to the flanges of the equipment.
- If needed, a support may be used under the piping and regulator/slam-shut body to avoid excessive pressure force on the regulator/slam-shut.

Note

For Types CS805, CS825, CS806 and CS826 equipped with the white-colored disk, ensure that the open end of disk is oriented toward the downstream as indicated in Figure 7. If the body direction relative to the actuator is changed during installation, the orientation of the white disk must also be removed, turned and reinstalled to ensure the open end faces downstream.

Installation Location

- The installed regulator should be adequately protected from vehicular traffic and damage from other external sources.
- Install the regulator with the vent pointed vertically down, see Figure 8. If the vent cannot be installed in a vertically down position, the regulator must be installed under a separate protective cover. Installing the regulator

44 ซ.บรมราชชนนี 70 ถ.บรมราชชนนี ศาลาธรรมสพน์ ทวีวัฒนา กทม. 10170.

website: https://www.add-furnace.com/ โทร: 02-888-3472

Line ID: @add11 e-mail: add028883472@gmail.com

with the vent down allows condensation to drain, minimizes the entry of water or other debris from entering the vent and minimizes vent blockage from freezing precipitation.

- Do not install the regulator in a location where there can be excessive water accumulation or ice formation, such as directly beneath a downspout, gutter or roof line of building. Even a protective hood may not provide adequate protection in these instances.
- Install the regulator so that any gas discharge through the vent or vent assembly is over 3 ft. / 0.91 m away from any building opening.

Regulators Subjected to Heavy Snow Conditions

Some installations, such as in areas with heavy snowfall, may require a hood or enclosure to protect the regulator from snow load and vent freeze over.

Downstream Control Line Installation

A CS800 Series regulator with an EN or ET in the type number has a blocked throat, an O-ring stem seal and a 3/4 NPT control line tapping in the lower diaphragm casing. A regulator with a downstream control line is used for monitoring installations or other applications where there is other equipment installed between the regulator and the pressure control point.

For types with an EN or ET in the type number, connect downstream control line tubing to the lower casing and run the tubing a distance of approximately 6 times the outlet piping diameter as shown in Figures 9, 10 and 11. For best results, the outer diameter of the control line tubing should be 3/8 in. / 9.5 mm or larger.


Downstream Control Line Installation with Integral True-Monitor™

Refer to Figure 10. When installing the Types CS803ET and CS803EN regulators, connect downstream control line tubing to the lower casing of the Primary Regulator and run the tubing a distance of approximately 6 times the outlet pipingdiameter downstream of the regulator outlet. Connect a second, separate downstream control line tubing to the lower casing of the Integral Monitor and run the tubing a distance of approximately 6 times the outlet piping diameter downstream of the Integral Monitor outlet. For best results, the outer diameter of the control line tubing for both the Primary Regulator and the Integral Monitor should be 3/8 in. / 9.5 mm or larger.

Installation with External Overpressure Protection

If the regulator is used in conjunction with a Type 289H relief valve, it should be installed as shown in Figure 8. The outside end of the vent line should be protected with a rainproof assembly. The Type 289H should be set 10 in. w.c. / 25 mbar higher than the outlet pressure setting of the regulator, up to 30 in. w.c. / 75 mbar outlet pressure. For pressure greater than this, set the Type 289H 0.75 psi / 52 mbar higher than the outlet pressure setting of the regulator. See the 289 Series Instruction Manual (D100280X012) for more information.

website: https://www.add-furnace.com/ โทร: 02-888-3472

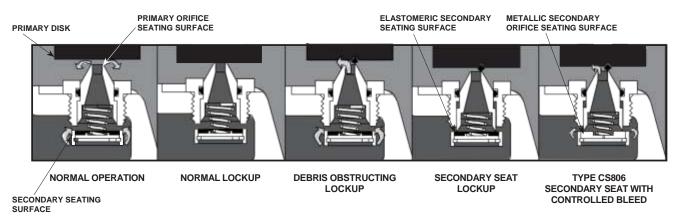

SECONDARY SEAT DETAILED VIEW

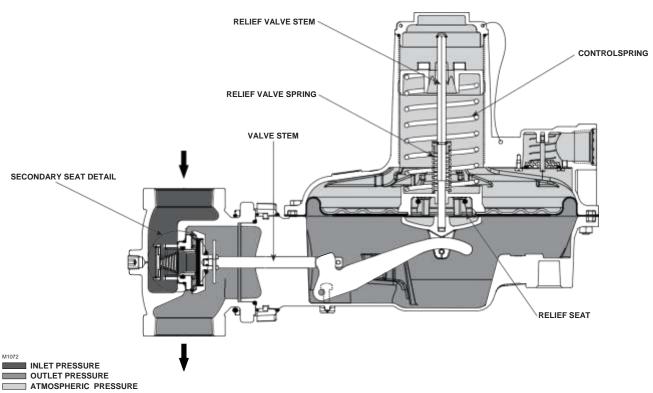


Figure 6. Type CS805IR with Secondary Seat Protection

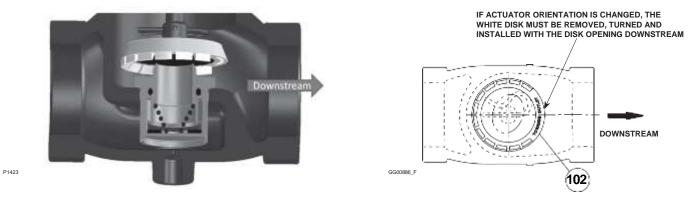


Figure 7. White Disk Orientation for use with Secondary Seat™ Protection



Vent Line Installation

The CS800 Series regulators have a 1 or 2-1/2 NPT screened vent opening in the spring case. If necessary to vent escaping gas away from the regulator, install a remote vent line in the spring case tapping. Vent piping should be as short and direct as possible with a minimum number of bends and elbows. The remote vent line should have the largest practical diameter. Vent piping on regulators with internal relief must be large enough to vent all relief valve discharge to atmosphere without excessive backpressure and resulting excessive pressure in the regulator. Ensure piping is properly supported to avoid excessive stress on the regulator spring case.

The CS800 Series offers optional Token Relief that provides low-capacity relief which is located in the spring case of the Primary Regulator. If necessary to vent escaping gas away, install a remote vent line in the spring case tapping of the Primary Regulator as described above.

Periodically check all vent openings to be sure that they are not plugged.

CS800 Series outlet pressure ranges are shown in Table 5. Outlet pressure greater than 3 psi / 0.21 bar above setpoint may damage internal parts such as the diaphragm head and valve disk. The maximum emergency (casing) outlet pressure is 15 psig / 1.0 bar.

Startup

CAUTION

Pressure gauges should always be used to monitor downstream pressure during Startup.

With the downstream system depressurized, perform the following procedure to startup the regulator.

- 1. Check to see that all appliances are turned off.
- 2. Slowly open the upstream shut-off valve.
- 3. Check inlet and outlet pressure for correct values.
- 4. Check all connections for leaks.
- 5. Turn on utilization equipment and recheck the pressures.

Adjustment

Note

The range of allowable pressure setting is stamped on the nameplate. If the required setting is not within this range, substitute the correct spring (as shown in Table 5). If the spring is changed, change the nameplate to indicate the new pressure range.

Because of the weight of internal regulator parts, the Red spring, 3.5 to 6 in. w.c. / 9 to 15 mbar spring range (nominal 4 in. w.c. / 10 mbar setting) gives the best pressure control when the regulator spring barrel is

44 ซ.บรมราชชนนี 70 ถ.บรมราชชนนี ศาลาธรรมสพน์ ทวีวัฒนา กทม. 10170.

website: https://www.add-furnace.com/ โทร: 02-888-3472

Line ID: @add11 e-mail: add028883472@gmail.com

pointed down. Spring barrel down orientation may require that vent piping or vent adaptors are installed to keep the vent pointed down.

For types that include the Integral Monitor module, refer to the Instruction Manual for Type TM600 Integral Monitor, document D103126X012, for Adjustment and Maintenance of the Integral Monitor. For types that include the Slam-shut module, refer to the Instruction Manual for Type VSX8 Slam-shut, document D103127X012, for Adjustment and Maintenance of the Slam-shut.

A pressure gauge should always be used to monitor downstream pressure while adjustments are being made.

1. Remove the closing cap (key 60, Figure 12).

! WARNING

During setpoint adjustment, do not mistake the Token Relief Spring Nut (key 46) for the main spring adjusting screw. Turning the Token Relief Spring Nut will change the token relief setting and if rotated counterclockwise could result in gas discharge and possible personal injury.

- To increase the outlet setting, turn the adjusting screw (key 65, Figure 12) clockwise. To decrease the outlet setting, turn the adjusting screw counterclockwise.
- 3. Replace the closing cap or tighten the hex locknut.

Types CS803 and CS823 with Integral True-Monitor™ Module

When adjusting the primary regulator and integral True-Monitor for operation, ensure that the pressure differences between the primary regulator and the integral True-Monitor shown in Tables 8 and 9 are observed. For example, if the primary regulator setpoint is set at 7 in. w.c. / 17 mbar, then the integral monitor should be set at a minimum of 14 in. w.c. / 35 mbar or higher.

To test the integral monitor operation, the primary regulator setpoint must be adjusted above the integral monitor's setpoint to simulate a failure of the primary regulator. If the spring range of the primary regulator is sufficiently high, it can simply be adjusted above the integral monitor's setpoint by following step 2 above. Otherwise, a different spring with a setpoint higher than the integral monitor's setpoint must be installed to check the operation of the integral monitor. An alternative to using a higher set spring on the primary regulator is to attach a hand pump and gauge to the primary regulator vent to pressure load it until its setpoint exceeds that of the integral True-Monitor.

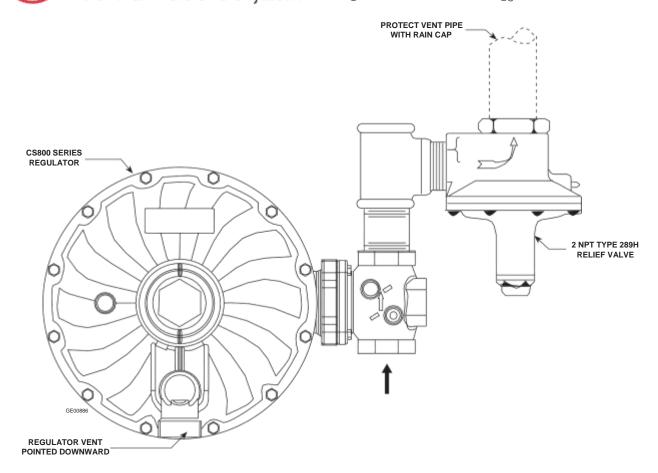


Figure 8. CS800 Series Regulator Installed with the Vent Pointed Downward and with a Type 289H Relief Valve for High Capacity Relief

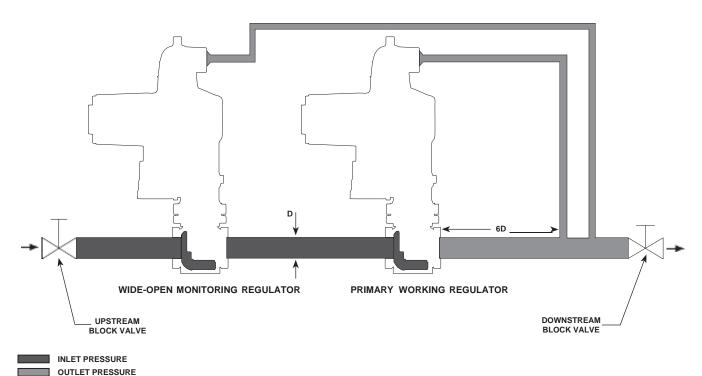


Figure 9. CS800 Series Wide-open Monitor Control Line Installation



CAUTION

When applying pressure to the regulator spring case through the vent, care must be taken not to exceed 3 psig / 0.21 bar, which is the maximum differential across the diaphragm.

Types CS804, CS824 and CS854 with Slam-shut Module

When adjusting the Primary Regulator and Slam-shut for operation, reference Tables 10 and 11 and the footnotes in each table for the OPSO and OPSO/UPSO setpoints of the slam-shut for the given regulator spring ranges.

CAUTION

Equipment installed downstream the Type VSX8 Slam-shut device can be damaged if the following procedure for resetting the Type VSX8 Slam-shut device is not followed. This equipment includes the integral Type VSX8 or regulator configurations.

- To properly reset the Type VSX8 Slam-shut after it has been tripped to the closed position, insert a flat-head screwdriver into the position shown in Figure 8 on the backside of the reset button (refer to Type VSX8 Instruction Manual, key 30, Figure 8).
- 2. Slowly rotate the screwdriver to gradually pull the reset button (refer to Type VSX8 Instruction Manual, key 30) away from the Type VSX8 device. This slow movement allows for a slow bleed of the pressure across the Type VSX8 Slam-shut's disk and seat area. The operator should be able to hear the pressure bleeding through the system.
- When the pressure has equalized and the air bleeding sound has dissipated, completely pull the reset button (refer to Type VSX8 Instruction Manual, key 30) away from the Type VSX8 Slam-shut device by hand until the internal shut-off mechanism has been re-latched.
- Once the operator feels the click of the re-latch occurring, completely push the reset button (refer to Type VSX8 Instruction Manual, key 30) back into its original position.

Shutdown

Installation arrangements may vary, but in any installation it is important that the valves be opened or closed slowly and that the outlet pressure be vented before venting inlet pressure to prevent damage caused by reverse pressurization of the regulator. The steps below apply to the typical installation as indicated.

- 1. Open valves downstream of the regulator.
- 2. Slowly close the upstream shut-off valve.

44 ซ.บรมราชชนนี 70 ถ.บรมราชชนนี ศาลาธรรมสพน์ ทวีวัฒนา กทม. 10170.

website: https://www.add-furnace.com/ โทร: 02-888-3472

Line ID: @add11 e-mail: add028883472@gmail.com

- Inlet pressure should be released automatically downstream as the regulator opens in response to the lowered pressure on the diaphragm.
- 4. Close outlet shut-off valve.

Maintenance and Inspection

! WARNING

To avoid personal injury or equipment damage, do not attempt any maintenance or disassembly without first isolating the regulator from system pressure and relieving all internal pressure as described in "Shutdown" section.

Test the regulator that has been disassembled for repair to ensure that it is operating properly before being returned to service. Only parts manufactured by Emerson should be used for repairing Fisher™ regulators. Restart gas utilization equipment according to normal Startup procedures.

Due to normal wear or damage that may occur from external sources, inspect and maintain this regulator periodically. The frequency of inspection and replacement of parts depends upon the severity of service conditions or the requirement of local, state and federal rules and regulations.

Perform periodic inspection on Wide-Open Monitor regulators, Integral True-Monitor™ or Slam-shut overpressure protection modules to ensure protection of the downstream system in the event of a failure to the primary regulator. This inspection must test that the wide open monitor, Integral True-Monitor or Slam-shut functions as intended.

Maintenance on CS800 Series with Secondary Seat™ Protection

Types CS805 and CS825 regulators do not have any means to alert when the Secondary Seat operates at lockup. A lock-up test can be done on the regulator to determine if the lock-up pressure has elevated to or near the values in Table 7, under the heading Types CS805 and CS825. If so, replace the regulator primary disk and orifice.

Internal relief operation on units equipped with Secondary Seat Protection is an indication that the Secondary Seat Protection on the Types CS805IR and CS805IQ may not be working and that the Types CS806IR and CS806IQ Secondary Seat may have closed. Maintenance should address any potential causes for internal relief operation as well as other regulator malfunctions separate from the Secondary Seat.

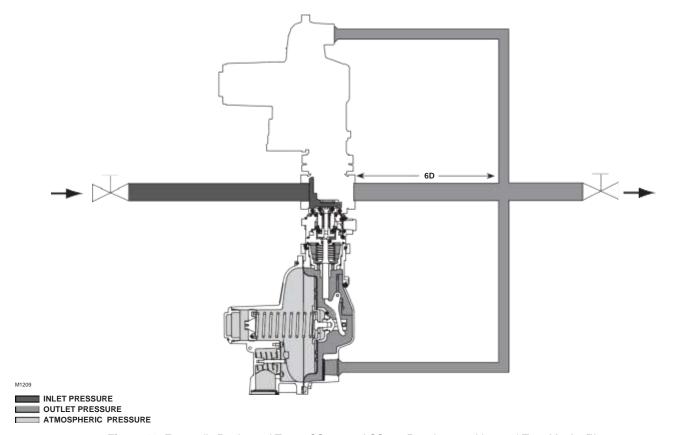


Figure 10. Externally Registered Types CS803 and CS823 Regulator and Integral True-Monitor™ Downstream Control Line Installation

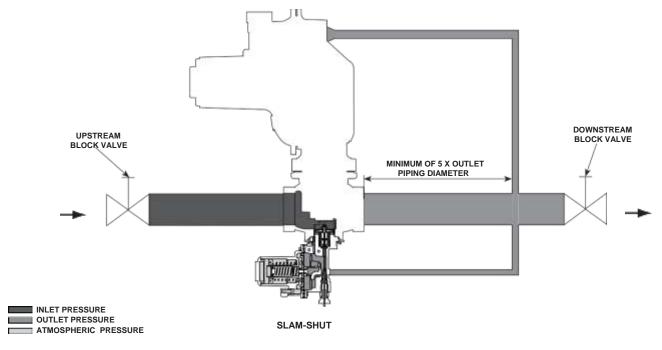


Figure 11. Externally Registered Types CS804, CS824 and CS854 Regulator and Slam-shut Downstream Control Line Installation



Maintenance on CS800 Series

Disassembly to Replace Diaphragm (See Figures 12, 14 and 16)

- See Figure 16. All Types except Type CS850, remove the closing cap (key 60). Turn the adjusting screw (key 65) counterclockwise to ease spring compression. Remove adjusting screw and spring (key 38).
- 2 See Figure 16. Type CS850, loosen hex locknut (key 107). Turn adjusting screw (key 65) counterclockwise to ease spring compression. Unscrew bonnet (key 104) and remove. Remove spring (key 38).
- See Figure 12. Remove the nuts (key 16) and hexbolts (key 15). Separate the upper spring case (key 1) from the lower casing (key 9).

Note

When disassembling a CS800 Series regulator, lift the upper spring case straight up in order to avoid hitting the stem (key 11).

- See Figure 12. Slide the diaphragm head assembly (key 55) away from the body (key 70) to unhook the pusher post (key 50) from the lever (key 10). Lift off the diaphragm head assembly.
- 5. See Figure 14. Non-Relieving units, unscrew the bolt (key 45). The bolt threads in to the pusher post (key 50) and holds the non-relieving diaphragm assembly together. Unscrewing the bolt will separate the diaphragm retainer (key 47), the lower spring seat (key 43) and diaphragm assembly (key 55) and pusher post (key 50).

CAUTION

Use caution when unscrewing the relief valve stem as the relief valve spring is in compression.

See Figure 14. Internally Relieving units, unscrew the relief valve stem (key 44). The relief valve stem threads into the pusher post (key 50) and holds the relieve assembly together. Unscrewing the relief valve stem will separate the E-Ring (key 48), the spring retainer (key 42), the relief spring (key 41), the lower spring seat (key 43) and the diaphragm assembly (key 55) onto the pusher post (key 50).

See Figure 14. Token Relieving units, measure and note for reassembly, the distance between the top of the diaphragm stem (key 44) and the top of the token relief hex nut (key 46). Unscrew token relief nut with a 1/2 in. / 13 mm wrench. Remove the spring seat (key 42) and relief spring (key 41). Unthread the second lower nut (key 46). Pull the pusher post assembly (key 50) through the diaphragm assembly. Replace the pusher post O-ring (key 52) and diaphragm stem O-ring (key 115). Unscrew the pusher post nut (key 110), which allows for separation of the lower spring seat (key 43), diaphragm assembly (key 55) and the pusher post retainer (key 111).

44 ซ.บรมราชชนนี 70 ถ.บรมราชชนนี ศาลาธรรมสพน์ ทวีวัฒนา กทม. 10170.

website: https://www.add-furnace.com/ โทร: 02-888-3472

Line ID: @add11 e-mail: add028883472@gmail.com

- 6. Reassemble in the reverse order of step five. For the Token Relief Assembly, ensure the distance from the top of the diaphragm stem (key 44, Figure 14) to the top of the token relief hex nut (key 46) is the same as before disassembly. When assembling the diaphragm (key 55A) onto the diaphragm head (key 55B), apply a small amount of adhesive on the outer flat portion of the diaphragm head that contacts the diaphragm, as indicated in Figure 14. Place the diaphragm head on the diaphragm and check to ensure the hole in the diaphragm head with the hole of the diaphragm are concentrically aligned.
- Place the diaphragm assembly into position in the lower casing; make sure that the pusher post is hooked on the lever.

Note

See Figure 12. To ease in the process of inserting the diaphragm assembly into the lower case (key 9) and hooking it onto the lever (key 10), loosen the four body bolts (key 71). This will allow the lever to be rotated upward in order to slide the diaphragm assembly (key 55) onto the lever.

- After the diaphragm assembly is hooked to the lever, rotate the diaphragm so that the diaphragm and lower casing holes are aligned.
- 9. Reassemble the remaining parts by following steps 1 to 3 in reverse order.

Note

See Figure 12, always tighten bolts in a cross pattern.

Disassembly to Replace Valve Stem O-ring (For externally registered Types only, e.g., Type CS800EN) (See Figures 12, 15 and 16)

- 1. See Figure 12. Remove the four body bolts (key 71) and remove the body (key 70).
- Check the body O-ring (key 19) for wear and replace as necessary.
- 3. See Figure 16.
 - a. All types except Type CS850, remove the closing cap (key 60). Turn the adjusting screw (key 65) counterclockwise to ease spring compression. Remove adjusting screw and spring (key 38).
 - b. Type CS850, loosen hex locknut (key 107). Turn adjusting screw (key 65) counterclockwise to ease spring compression. Unscrew bonnet (key 104) and remove. Remove spring (key 38).
- 4. See Figure 12. Remove the nuts (key 16) and hexbolts (key 15). Separate the upper spring case (key 1) from the lower casing (key 9).

ปริษัท เอดีดี เฟอร์เนส จำกัด 44 ซ.บรมราชชนนี 70 ถ.บรมราชชนนี ศาลาธรรมสพน์ ทวีวัฒนา กทม. 10170. Add Furnace Co.,Ltd. Line ID: @add11 e-mail: add028883472@gmail.com

website: https://www.add-furnace.com/ โทร: 02-888-3472

Note

When disassembling a CS800 Series regulator, lift the upper spring case straight up in order to avoid hitting the stem (key 11).

- 5. Slide the diaphragm head assembly (key 55) away from the body (key 70) to unhook the pusher post (key 50) from the lever (key 10). Lift off the diaphragm head assembly.
- 6. Remove the two lever retaining screws (key 14). Lift lever up slightly and then slide in the direction away from the body. Once the lever pin (key 13) has cleared the lower actuator the lever can be lowered and at the same time rotated upward to allow it to be removed from the slotted stem (key 11).
- 7. See Figure 15. Remove the disk retainer clip (key 36B) and then remove the disk assembly (key 36). Remove the stem (key 11) by sliding it in the direction away from the body.
- 8. Replace stem O-ring (key 12) making certain to apply lubricant.
- 9. Reassemble in the reverse order.

Note

When placing the diaphragm assembly into position in the lower casing, make sure that the pusher post is hooked on the lever. After the diaphragm assembly is hooked to the lever. rotate the diaphragm so that the diaphragm and lower casing holes are aligned.

See Figure 12, always tighten bolts in a cross pattern.

10. Reassemble the remaining parts by following steps 1 to 3 in reverse order.

Disassembly to Replace Valve Disk and Orifice (See Figures 12 and 18)

- 1. Remove the four hex bolts (key 71) which hold the lower spring case (key 9) to the body (key 70). Separate the lower spring casing from the body.
- 2. Check the body O-ring (key 19) for wear and replace as necessary.

Note

There are multiple disk assemblies based on construction and these are identified by color. See Tables 13, 14 and 15 for direction in selecting appropriate disk color. Product performance will be changed if the incorrect disk assembly is used.

- 3. Examine the disk assembly (key 36) for nicks, cuts and other damage. To replace, remove the disk retainer clip (key 36B) and slide the disk assembly off of the stem (key 11).
- 4. See Figure 18.

- a. If the seating edge of the CS800 Series orifice (key 25) is nicked or rough, remove the orifice from the body using a 2 in. / 50 mmsocket wrench.
- b. If equipped with a CS805/CS806 Series Secondary Seat orifice assembly, see the following section "Disassembly to Replace Valve Disk and Secondary Seat orifice assembly" for maintenance instructions.

Note

If the orifice is replaced with a different size, change the nameplate to state the new size and maximum inlet pressure (see Table 4).

- 5. Replace O-ring (key 82). Apply anti-seize lubricant to the external threads of the new orifice/orifice assembly and reassemble into the body. Install the orifice per Figure 17 and tighten the orifice or orifice subassembly into the body per Figure 12.
- 6. Reassemble the regulator in reverse order of the above steps. O-ring (key 28, Figure 12) on end of stem (key 11) should be lubricated before replacing the disk assembly. This O-ring is not a pressure retaining part but keeps the disk holder from rattling on the stem.

Note

See Figure 12, always tighten bolts in a cross pattern.

Disassembly to Replace Valve Disk and Secondary Seat™ Orifice Assembly (See Figure 12)

- 1. Remove the four hex bolts (key 71) which hold the lower spring case (key 9) to the body (key 70). Separate the lower spring casing from the body.
- 2. Check the body O-ring (key 19) for wear and replace as necessary.

Note

There are multiple disk assemblies based on construction and these are identified by color.

See Tables 13, 14 and 15 for direction in selecting appropriate disk color. Product performance will be changed if the incorrect disk assembly is used.

If the White disk is selected, the open side of the disk must be directed toward the outlet of the body as indicated in Figure 7.

- 3. Examine the disk assembly (key 36) for nicks, cuts and other damage. To replace, remove the disk retainer clip (key 36B) and slide the disk assembly off of the stem (key 11).
- 4. See Figure 19. Remove the orifice assembly from the body using a 2 in. / 50 mm socket wrench.

website: https://www.add-furnace.com/ โทร: 02-888-3472

Line ID: @add11 e-mail: add028883472@gmail.com

Table 12. Adjustment Tools

KEY NUMBER	PART DESCRIPTION	ADJUSTMENT TOOL		
15	Hex Bolt	1/2 in. / 13 mm Socket		
16	Nut	1/2 in. / 13 mm Socket		
25	Orifice/Seat	2 in. / 50 mm Socket		
44	Relief Valve Stem	9 mm Socket or Adjustable End Wrench		
45	Bolt, Diaphragm Assembly	1/2 in. / 13 mm Socket		
60	Closing Cap	2 in. / 50 mm Socket		
		7/8 in. Hex/Allen Wrench		
	Adjusting Carety up to 2.5 paig / 0.17 has apring range	2 in. / 50 mm Socket		
65	Adjusting Screw, up to 2.5 psig / 0.17 bar spring range	1/2 in. / 13 mm Socket		
05		Large Flat head Screw Driver		
	Adjusting Screw, 2 to 5.5 psig / 0.17 to 0.38 bar spring range	1/2 in. / 13 mm Socket Driver Extension		
	Adjusting Screw, above 5 psig / 0.34 bar spring range	15/16 in. / 24 mm or Adjustable End Wrench		
71	Body Bolt	1/2 in. / 13 mm Socket		
72	1/4 NPT Pipe Plug	1/4 in. Hex/Allen Wrench		
1. Use of Adjustment tool is option	onal.			

Inspect the primary seating surface as well as the secondary seating surface and sealing surface. If nicks or other damage are present, start to disassemble the Secondary Seat™ assembly by removing the internal retaining ring (key 25D) with retaining ring pliers. Use care when removing the internal retaining ring as the spring (key 25F) is compressed and will exert force on the Secondary Seat disk (key 25C).

- 5. Remove the Secondary Seat disk (key 25C), spring (key 25F) and double sided orifice (key 25B). Finally, remove the orifice O-ring (key 25E). Lubricate O-ring with extreme low temperature bearing grease or similar lubricant that maintains its lubrication properties at cold temperatures and replace O-ring. Insert the new double-sided orifice (key 25B), then the spring (key 25F), ensuring that the larger diameter opening is contacting the shelf of the orifice.
- Replace the Secondary Seat disk (key 25C). See Figure 19.
 - a. For Types CS805 and CS825 ensure that the rubber/Nitrile (NBR) sealing surface is facing the Secondary Seating surface of the orifice.
 - ForTypes CS806 and CS826, ensure that the hole in the center of the disk that acts as the spring seat is facing the spring.
- 7. Press the disk inside the housing (key 25A) to allow the internal retaining ring to be reinserted.

Note

If the orifice is replaced with a different size, change the nameplate to state the new size and maximum inlet pressure (see Table 4).

 Replace O-ring (key 82). Apply anti-seize lubricant to the external threads of the new orifice/orifice assembly and reassemble into the body. Install and tighten the orifice per Figure 12. Reassemble the regulator in reverse order of the above steps. O-ring (key 28) on end of stem (key 11) should be lubricated before replacing the disk assembly. The O-ring is not a pressure retaining part but keeps the disk holder from rattling on the stem.

Note

See Figure 12, always tighten bolts in a cross pattern.

Regulator Reassembly

It is recommended that a good quality pipe thread sealant be applied to pressure connections and fittings and a good quality lubricant be applied to all O-rings. Also apply an anti-seize compound to the adjusting screw threads and other areas as needed. Reference Figures 12 through 19 to determine the recommended lubricant/sealant/adhesive for these parts. All lubricants/sealants/adhesives must be selected such that they meet the temperature requirements.

When reassembling, torque bolts and fasteners per torque values are indicated on Figures 12 through 19. Some relaxation from initial torque values may occur. Always tighten bolts in a cross pattern.

Parts Ordering

The type number, orifice size, spring range and date of manufacture are stamped on the nameplate. Always provide this information in any correspondence with your local Sales Office regarding replacement parts or technical assistance.

When ordering replacement parts, reference the key number and the 11-digit Part Number of each needed part as found in the following parts list. Separate repair part kits containing all recommended elastomer spare parts are available.

Table 13. CS800 Series Disk Color Selection

PRESSURE	TYPE	BODY SIZE		SPRING RANGE(1)		BODY	END	DISK	DISK ASSEMBLY	REPAIR KIT(2)
REGISTRATION		ln.	DN	In. w.c.	mbar	MATERIAL	CONNECTION	COLOR	PART NUMBER	
		1-1/4 and 1-1/2	32 and 40	3.5 to 30	9 to 75	All Materials	All Connections	Black	GE29773X022	RCS800XBLK2
			2 50	3.5 to 6	9 to 15	All Materials	All Connections	Green	GE29773X042	RCS800XGRN2
	CS800			5.5 to 8.5 and 8 to 12	13 to 21 and 20 to 30	Gray Cast Iron	All Connections	Blue	GE29773X032	RCS800XBLU2
Internal		2				Ductile Iron or WCC Steel	Flanged	Blue	GE29773X032	RCS800XBLU2
							Threaded	Dark Gray	GE29773X082	RCS800XGRY2
				10 to 16 and 14 to 30	25 to 40 and 35 to 75	All Materials	All Connections	Green	GE29773X042	RCS800XGRN2
	CS820 and CS850	and All S		1 to 10 psig	69 to 690	All Materials	All Connections	Black	GE29773X022	RCS800XBLK2
External	All	All S	Sizes	Α	II	All Materials	All Connections	Black	GE29773X022	RCS800XBLK2

The 3.5 to 30 in. w.c. / 9 to 75 mbar spring range indicates that all of the springs within this range are applicable.

Table 14. CS803 and CS804 Series Disk Color Selection

PRESSURE REGISTRATION	TYPE	BODY SIZE		SPRING RANGE(1)		BODY	END	DISK	DISK ASSEMBLY	REPAIR KIT(2)
		ln.	DN	In. w.c.	mbar	MATERIAL	CONNECTION	COLOR	PART NUMBER	KEI / III K KII
		1-1/2	40	3.5 to 30	9 to 75	All Materials	All Connections	Black	GE29773X022	RCS800XBLK2
				3.5 to 6	9 to 15	All Materials	All Connections	Green	GE29773X042	RCS800XGRN2
	CS803 and CS804			5.5 to 8.5 and 8 to 12	13 to 21 and 20 to 30	Ductile Iron or WCC Steel	Flanged	Blue	GE29773X032	RCS800XBLU2
							Threaded	Dark Gray	GE29773X082	RCS800XGRY2
Internal		2				Gray Cast Iron	All Connections	Blue	GE29773X032	RCS800XBLU2
				10 to 16 and 14 to 30	25 to 40 and 35 to 75	All Materials	All Connections	Green	GE29773X042	RCS800XGRN2
	CS823, CS824 and CS854	All S	Sizes	1 to 10 psig	69 to 690	All Materials	All Connections	Black	GE29773X022	RCS800XBLK2
External	All	All S	Sizes	А	II	All Materials	All Connections	Black	GE29773X022	RCS800XBLK2

^{1.} The 3.5 to 30 in. w.c. / 9 to 75 mbar spring range indicates that all of the springs within this range are applicable.

Table 15. CS805 and CS806 Series Disk Color Selection

PRESSURE REGISTRATION	TYPE	BODY SIZE		SPRING RANGE(1)		BODY	END	DISK	DISK ASSEMBLY	REPAIR KIT(3)
		ln.	DN	In. w.c.	mbar	MATERIAL	CONNECTION	COLOR	PART NUMBER	
	CS805 and CS806	1-1/4	32	3.5 to 30	9 to 75	Gray Cast Iron	All Connections	Yellow/ White Dot	GE29773X062	RCS800XYEL2
		1-1/2	40					Green/ White Dot	GE29773X092	RCS800XGR22
Internal		2	50					White/ White Dot ⁽²⁾	GE29773X052	RCS800XWHT2
	CS825 and CS826	All S	Sizes	1 to 5.5 psig	70 to 380	Gray Cast Iron	All Connections	Yellow/ White Dot	GE29773X062	RCS800XYEL2
External	All	All S	Sizes	Al	l	All Materials	All Connections	Black	GE29773X022	RCS800XBLK2

^{1.} The 3.5 to 30 in. w.c. / 9 to 75 mbar spring range indicates that all of the springs within this range are applicable.

^{2.} Repair kit includes O-ring (key 19), disk assembly (key 36) and O-ring (key 62).

^{2.} Repair kit includes O-ring (key 19), disk assembly (key 36) and O-ring (key 62).

White/White Dot disk requires the open end to be directed downstream with the direction of flow.
 Repair kit includes O-ring (key 19), disk assembly (key 36) and O-ring (key 62).



website: https://www.add-furnace.com/ โทร: 02-888-3472

Line ID: @add11 e-mail: add028883472@gmail.com

Parts List


Key Description	Part Number	Key	Description	Part Number
Regulator Repair Kit		2	Vent Screen, Stainless steel	
Disk Assembly Repair Kit		2	1 NPT vent size	T1121338982
[Disk Assembly Repair Parts kit includes			2-1/2 NPT vent size	GE29700X012
O-ring (key 19), disk assembly (key 36)		3	Retaining Ring	
	Tables 13, 14 and 15	-	1 NPT vent size, Zinc-plated steel	T1120925072
Orifice Repair Kit			2-1/2 NPT vent size, Stainless steel	GE29714X012
[Orifice Repair Parts kit includes keys 25 (C	Orifice)	4	Stabilizer Guide, Stainless steel	
and 82 (O-ring).]			1 NPT vent size	GE27061X012
1/4 in. / 6.4 mm orifice size	GE31286X012		2-1/2 NPT vent size	GE27028X012
3/8 in. / 9.5 mm orifice size 1/2 in. / 13 mm orifice size	GE31287X012 GE31288X012	5	Stabilizer	
5/8 in. / 16 mm orifice size	GE31289X012		1 NPT vent size	GE46735X012
3/4 in. / 19 mm orifice size	GE31290X012	_	2-1/2 NPT vent size	GE27034X012
7/8 in. / 22 mm orifice size	GE31291X012	6	Stabilizer Spring, Stainless steel	CE25040V042
1 in. / 25 mm orifice size	GE31292X012		1 NPT vent size 2-1/2 NPT vent size	GE35010X012 GE29718X012
1-3/8 in. / 35 mm orifice size	GE31294X012	7	Stabilizer Retainer Ring, Steel/Nitrile (NBR)	GL291 10X012
True-Monitor™ Repair Kit		,	1 NPT vent size	GE46526X012
[When ordering repair kits for Types CS803			2-1/2 NPT vent size	GE46547X012
CS823, it is necessary to order both a Prim Regulator Repair Kit found on Tables 13, 1	,	8	Stabilizer screw (3 required), Zinc-plated steel	GE29724X012
15 and a True Monitor Repair Kit. See th		9	Lower Spring Case, Aluminum	3220127/012
Type TM600 Instruction Manual for deta		3	Internal Sensing	GE26104X012
on which parts are included.]	RTM600X0012		External Sensing	GE46833X012
Secondary Seat™ Repair Kit		10	Lever, Steel	GE27408X012
[Disk or Backplate Repair Parts kit includes		11	Stem, Stainless steel	GE27021X012
disk or backplate (key 25C) and O-ring (key	/s 25E	12*	O-ring, Nitrile (NBR) (external sensing only)	GE29753X012
and 82). Orifice Assembly Repair Parts kit		13	Lever Pin, Steel	GE29701X012
includes orifice assembly (key 25) and O-ring (key 82).]				
Types CS805 and CS825 Secondary Seat		14	Lever Pin Screw, Plated steel (2 required)	GE30039X012
without Bleed		15	Hex head cap screw, Steel (12 required)	GE29973X012
Disk or Backplate Repair Parts Kit		16	Nut, Steel (10 required)	GE30042X012
For use with 3/8 and 1/2 in. /		17	Union Ring, Aluminum	GE26416X012
9.5 and 13 mm orifice sizes	RCS805X0022	18	Snap Ring, Music wire	GE27018X012
For use with 5/8, 3/4 and 7/8 in./	D00005\/0000	19*	O-ring, Nitrile (NBR)	GE29755X012
16, 19 and 22 mm orifice sizes	RCS805X0032	25*	Orifice, Aluminum	
Orifice Assembly Repair Parts Kit 3/8 in. / 9.5 mm orifice size	RCS805RFC38		Standard (For configurations without	
1/2 in. / 13 mm orifice size	RCS805RFC12		Secondary Seat Assembly) 1/4 in. / 6.4 mm	GE29702X012
5/8 in. / 16 mm orifice size	RCS805RFC58		3/8 in. / 9.5 mm	GE29702X012 GE29703X012
3/4 in. / 19 mm orifice size	RCS805RFC34		1/2 in. / 13 mm	GE29704X012
7/8 in. / 22 mm orifice size	RCS805RFC78		5/8 in. / 16 mm	GE29705X012
Types CS806 and CS826 Secondary Seat with Bleed			3/4 in. / 19 mm	GE29706X012
Disk or Backplate Repair Parts Kit			7/8 in. / 22 mm	GE29707X012
For use with 3/8 and 1/2 in. /			1 in. / 25 mm 1-3/8 in. / 35 mm	GE29708X012 GE29710X012
9.5 and 13 mm orifice sizes	RCS806X0022	25*	Orifice Assembly, Brass/Nitrile (NBR)	GL291 10X012
For use with 5/8, 3/4 and 7/8 in./		20	For configurations with Secondary Seat Assemb	lv
16, 19 and 22 mm orifice sizes	RCS806X0032		For Types CS805 and CS825 without Bleed	.,
Orifice Assembly Repair Parts Kit 3/8 in. / 9.5 mm orifice size	RCS806RFC38		3/8 in. / 9.5 mm	GE29965X012
1/2 in. / 13 mm orifice size	RCS806RFC12		1/2 in. / 13 mm	GE29968X012
5/8 in. / 16 mm orifice size	RCS806RFC58		5/8 in. / 16 mm	GE29985X012
3/4 in. / 19 mm orifice size	RCS806RFC34		3/4 in. / 19 mm 7/8 in. / 22 mm	GE29986X012
7/8 in. / 22 mm orifice size	RCS806RFC78		For Types CS806 and CS826 with Bleed	GE29987X012
Slam-shut Repair Kit	See Type VSX8		3/8 in. / 9.5 mm	GE29970X012
	Instruction Manual		1/2 in. / 13 mm	GE29972X012
	D103127X012		5/8 in. / 16 mm	GE29989X012
Stability Cartridge Kit			3/4 in. / 19 mm	GE29990X012
Kit includes Key (120 and 19)	RCS800STBA0		7/8 in. / 22 mm	GE29991X012
 Upper Spring Case, Aluminum 		25A	o ,	CE20040V042
1 NPT vent size	GE26101X012		3/8 in. / 9.5 mm 1/2 in. / 13 mm	GE29940X012 GE29940X012
2-1/2 NPT vent size	GE26102X012		5/8 in. / 16 mm	GE29940X012 GE29947X012
			3/4 in. / 19 mm	GE29947X012
			7/8 in. / 22 mm	GE29947X012

^{*}Recommended spare part



Key	Description	Part Number	Key	Description	Part Number
25B	Orifice, Brass 3/8 in. / 9.5 mm	GE29941X012	45	Hex Head Bolt, Steel Types CS800 and CS820	GE32061X012
	1/2 in. / 13 mm 5/8 in. / 16 mm	GE29942X012 GE29948X012	46	Type CS850 Token Relief Nut, Steel	GE29974X012
	3/4 in. / 19 mm 7/8 in. / 22 mm	GE29949X012 GE29950X012	40	Token Relief (Low Flow) Token Relief (Standard Flow)	GE30042X012 GE30042X012
25C*	Disk Types CS805 and CS825 without bleed Types CS806 and CS826 with bleed	GE29943X012 GE32017X012	47	Diaphragm Retainer, Aluminum Types CS800 and CS820	0507007V040
25D	Internal Ring, Zinc-plated steel	GE32017X012 GE29945X012		No Relief Token Relief (Standard Flow)	GE27027X012 ERAA00916A0
25E*	O-ring, Nitrile (NBR)			Type CS850	GE47664X012
	3/8 in. / 9.5 mm 1/2 in. / 13 mm	GE29958X012 GE29958X012	48	Retaining E-Ring, Copper Standard Relief (High Capacity Relief)	GE33106X012
	5/8 in. / 16 mm	GE29756X012		Low Start-to-Discharge for Standard Relief	
	3/4 in. / 19 mm 7/8 in. / 22 mm	GE29756X012 GE29756X012	50	(High Capacity Relief)	GE33106X012
25F	Spring, Music wire or Stainless steel	GE29/36A012	50	Pusher Post No Relief, Aluminum	GE44924X012
201	3/8 in. / 9.5 mm	GE29944X012		Token Relief (Standard Flow), Aluminum	GE44947X012
	1/2 in. / 13 mm	GE29944X012		Token Relief (Low Flow), Zinc-plated steel	GE46958X012
	5/8 in. / 16 mm 3/4 in. / 19 mm	GE29951X012 GE29951X012		Standard Relief (High Capacity Relief), Aluminum Low Start-to-Discharge for Standard Relief	GE44947X012
	7/8 in. / 22 mm	GE29951X012		(High Capacity Relief), Aluminum	GE44947X012
26	Overpressure Protection Orifice, Aluminum		52*	Pusher Post O-ring, Nitrile (NBR)	
	For configurations with True-Monitor™	GE30327X012		Token Relief (Low Flow) only	GE47389X012
07	For configurations with Slam-shut	GE32066X012	53	Pusher Post Pin, Stainless steel	GE29761X012
27	Overpressure Protection Orifice O-ring, Nitrile (NBR For configurations with True-Monitor or Slum-shut		54	Roller Pin, Brass	GE27060X012
28	O-ring, Nitrile (NBR)	GE01439X012	55	Diaphragm Assembly Types CS800 and CS820	GE29775X012
36*	Disk Assembly			Type CS850	GE47296X012
	(See Tables 13, 14 and 15, Disk Color Selection)	0500770\/000	55A*	Diaphragm, Nitrile (NBR)	GE29721X012
	Black Blue	GE29773X022 GE29773X032	55B	Diaphragm Head, Zinc-plated steel	
	Green	GE29773X042		Types CS800 and CS820 Type CS850	GE27019X012 GE46996X012
	Dark Gray	GE29773X082	56	Pusher Post Pin Retaining Ring, Steel	GE33772X012
	Green/White Dot White/White Dot	GE29773X092 GE29773X052	57	Spring Pin, Zinc-plated steel	0200270.2
	Yellow/White Dot	GE29773X062		Token Relief (Low Flow) only	GE33668X012
36B	Retaining Disk Clip, Stainless steel	GE33709X012	60	Closing Cap (Types CS800 and CS820 only),	
38	Spring	See Table 5		Aluminum Gray	GE26109X012
41	Relief Valve Spring, Stainless steel 25 to 35 in. w.c. / 62 to 87 mbar, Token Relief			Red	GE26109X022
	(Standard Flow)	ERAA17935A0	62*	O-ring, Nitrile (NBR)	GE29750X012
	6 to 14 in. w.c. / 15 to 35 mbar, Token Relief		65	Adjusting Screw	
	(Standard Flow) Token Relief (Low Flow)	GE48120X012 GE48120X012		For Types CS800 and CS820, Aluminum Spring ranges up to 2.5 psig / 170 mbar	GE26108X012
	Standard Relief (High Capacity Relief)	GE30347X012		For Type CS820, Brass	02201007012
	Low Start-to-Discharge for Standard Relief	0= (0.00)/0.40		Spring ranges above 2.5 psig / 170 mbar	GE47294X012
40	(High Capacity Relief)	GE48120X012	70	For Type CS850, Zinc-plated steel Body	GE27026X012 See Table 3
42	Upper Spring Retainer Token Relief (Low Flow), Zinc-plated steel	GE46956X012	71	Bolt, Steel (4 required)	GE29974X012
	Token Relief (Standard Flow), Zinc-plated steel	GE46956X012	72	Pipe Plug	022007 17.012
	Standard Relief (High Capacity Relief), Aluminum Low Start-to-Discharge for Standard Relief	GE27059X012		Plated steel	1C333528992
	(High Capacity Relief), Aluminum	GE27059X012		Stainless steel	1C3335X0012
43	Lower Spring Seat, Aluminum		74	Blanking Plug, Aluminum For Ductile Iron and Steel Bodies,	
	Non-relief	GE27025X012		non-Overpressure Protection service only	GE31255X012
	Token Relief (Standard Flow) Token Relief (Low Flow)	GE27025X012 GE27025X012	75	O-ring, Nitrile (NBR)	
	Standard Relief (High Capacity Relief)	GE26111X012		For Ductile Iron and Steel Bodies,	05004407040
	Low Start-to-Discharge for Standard Relief	OF00444V040	76	non-Overpressure Protection service only Half Flange (2 required), Steel	GF03442X012
11	(High Capacity Relief)	GE26111X012	76	For Ductile Iron and Steel Bodies,	
44	Relief Valve Diaphragm Stem Token Relief (Low Flow), Zinc-plated steel	ERAA00767A0		non-Overpressure Protection service only	GF01942X012
	Token Relief (Standard Flow), Zinc-plated steel	ERAA00767A0	77	O-ring, Nitrile (NBR)	
	Standard Relief (High Capacity Relief) Aluminum Low Start-to-Discharge for Standard Relief	GE27058X012		For Ductile Iron and Steel Bodies, non-Overpressure Protection service only	GF03443X012
	(High Capacity Relief), Aluminum	GE27058X012		Storprocedio i recocción del vide dilly	5. 551 15/1012
*D					

Line ID: @add11 e-mail: add028883472@gmail.com

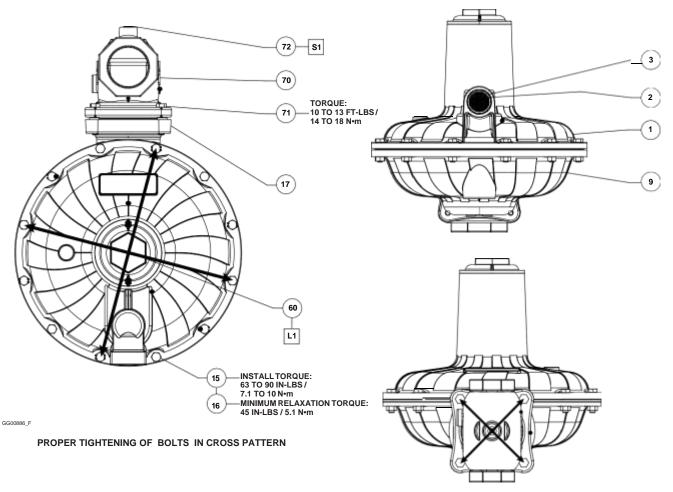


PROPER TIGHTENING OF BOLTS IN CROSS PATTERN

APPLY LUBRICANT (L) / SEALANT (S)(1):
 L1 = ANTI-SEIZE LUBRICANT
 S1 = THREAD SEALANT WITH PTFE

Figure 12. CS800 Series Regulator Assemblies

Key	Description	Part Number	Key	Description	Part Number
80	Screw (4 required), Steel For Ductile Iron and Steel Bodies,		104	Bonnet, Zinc-plated steel Type CS850 only	GE26812X012
	non-Overpressure Protection service only	GE38176X012	105	Upper Spring Seat, Zinc-plated carbon steel	
81	Spring Pin, Plated carbon steel			Type CS850 only	GE26809X012
	For ductile iron and steel bodies not common to the Type CS804	GE32722X012	106	Ball Bearing, Stainless steel Type CS850 only	GE33131X012
81	Sense Tube		107	Locknut, Steel (Type CS850 only)	GE49038X012
	For configurations with Slam-shut For configurations with True-Monitor™	ERAA02440A0 ERAA03562A0	108	Stem Rivet, Stainless steel	GE45994X012
82*	O-ring, Nitrile (NBR)	GE30397X012	109	Retaining Ring, Steel	GE33772X012
90	Nameplate		110	Pusher Post Nut, Zinc-plated steel Token Relief (Low Flow) only	GE46959X012
91	Warning Label		111	Pusher Post Retainer, Aluminum	GE40939A012
93	PED / EN 334 Information Label			Token Relief (Low Flow) only	GE46957X012
100	Lockwire, Stainless steel	T12315T0022	115	Diaphragm Stem O-ring, Nitrile (NBR)	
103	Thrust Washer, CS820 Series			Token Relief (Low Flow) only	GE49041X012
	2.5 psig to 5.5 psig / 170 to 380 mbar spring only	GE47292X012	120	Stabilizer Cartridge	ERAA26894A0

^{1.} Lubricant and sealant must be selected such that they meet the temperature requirements.

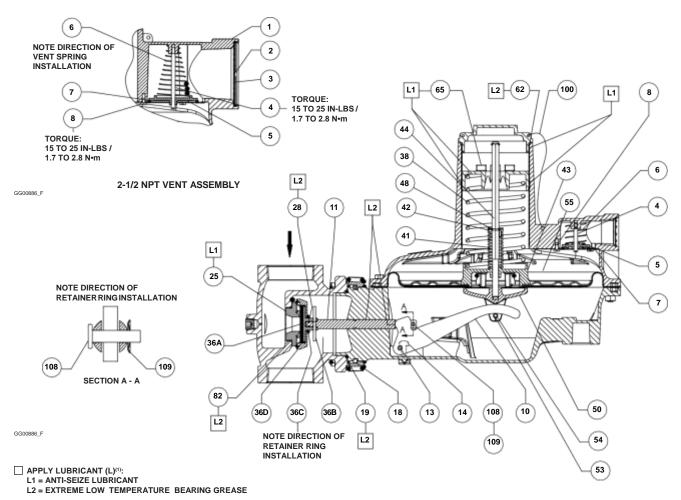

1. Lubricants must be selected such that they meet the temperature requirements.

GG00886_HC

Figure 12. CS800 Series Regulator Assemblies (continued)


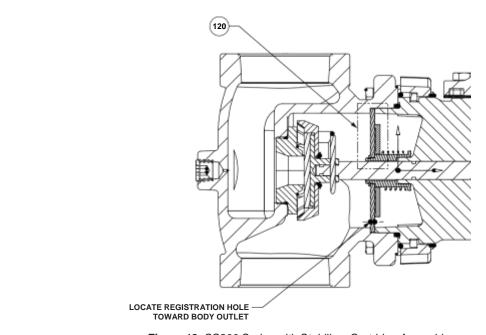



Figure 13. CS800 Series with Stabilizer Cartridge Assembly

website: https://www.add-furnace.com/ โทร: 02-888-3472

Line ID: @add11 e-mail: add028883472@gmail.com

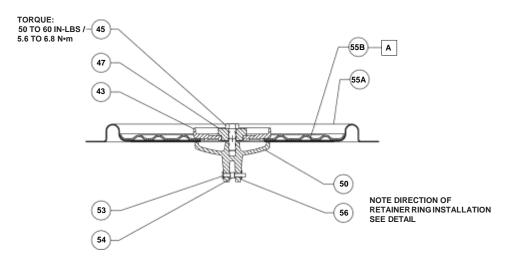

TYPE CS800/CS820 NON-RELIEF

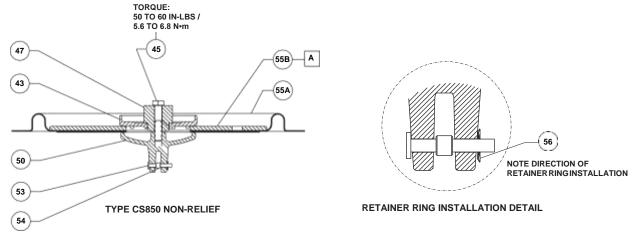

GG00886 F


APPLY ADHESIVE (A)(1)

NOTE: APPLY ADHESIVE ON THE FLAT SURFACE OF THE DIAPHRAGM PLATE THAT CONTACTS THE DIAPHRAGM, TOWARD THE OUTER PERIMETER, AND AWAY FROM THE CENTER HOLE.

1. Adhesive must be selected such that it meets the temperature requirements.

Figure 14. CS800 Series Diaphragm and Relief Assemblies

บริษัท เอดีดี เพอร์เนส จำกัด 44 ซ.บรมราชชนนี 70 ถ.บรมราชชนนี ศาลาธรรมสพน์ ทวีวัฒนา กทม. 10170. website: https://www.add-furnace.com/ โทร: 02-888-3472 Line ID: @add11 e-mail: add028883472@gmail.com

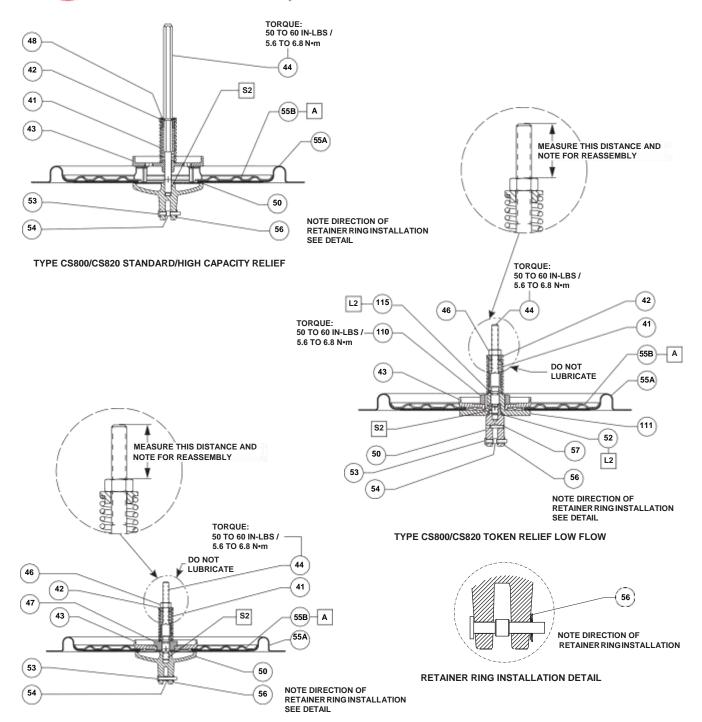

TYPE CS800/CS820 STANDARD FLOW TOKEN RELIEF

☐ APPLY LUBRICANT (L) / SEALANT (S) / ADHESIVE (A)(1):
L2 = EXTREME LOW TEMPERATURE BEARING GREASE S2 = MEDIUM STRENGTH THREADLOCKER SEALANT A = ADHESIVE

NOTE: APPLY ADHESIVE ON THE FLAT SURFACE OF THE DIAPHRAGM PLATE THAT CONTACTS THE DIAPHRAGM, TOWARD THE OUTER PERIMETER, AND AWAY FROM THE CENTER HOLE.


1. Lubricant, sealant and adhesive must be selected such that they meet the temperature requirements.


Figure 14. CS800 Series Diaphragm and Relief Assemblies (continued)



website: https://www.add-furnace.com/ โทร: 02-888-3472

Line ID: @add11 e-mail: add028883472@gmail.com

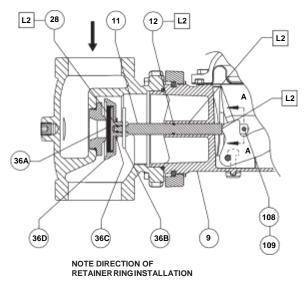





GG00886_I

- APPLY LUBRICANT (L)(1):
 L1 = ANTI-SEIZE LUBRICANT
- 1. Lubricants must be selected such that they meet the temperature requirements.

L2 = EXTREME LOW TEMPERATURE BEARING GREASE

Figure 15. CS800 Series External Registration

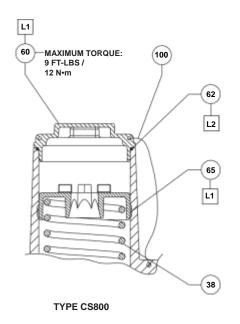


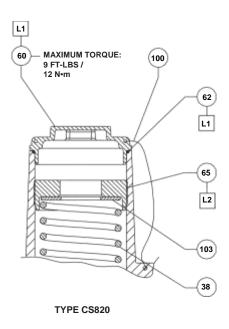

GG00886_F


- APPLY LUBRICANT (L)(1): L1 = ANTI-SEIZE LUBRICANT
 - L2 = EXTREME LOW TEMPERATURE BEARING GREASE
- 1. Lubricants must be selected such that they meet the temperature requirements.


Figure 16. CS800 Series Control Spring Adjustment Assemblies

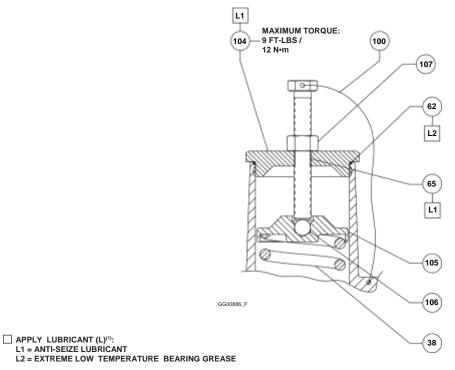

^{1.} Lubricants must be selected such that they meet the temperature requirements.

Figure 16. CS800 Series Control Spring Adjustment Assemblies (continued)



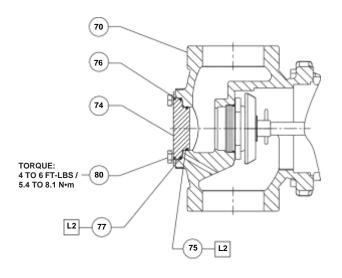

GRAY CAST IRON BODIES WITHOUT OVERPRESSURE PROTECTION **GRAY CAST IRON/DUCTILE IRON/STEEL BODIES** WITH OVERPRESSURE PROTECTION

APPLY LUBRICANT (L) / SEALANT (S)(1): L1 = ANTI-SEIZE LUBRICANT

L2 = EXTREME LOW TEMPERATURE BEARING GREASE


S1 = THREAD SEALANT WITH PTFE

Figure 17. CS800 Series Body Configurations

^{1.} Lubricants and sealants must be selected such that they meet the temperature requirements.

website: https://www.add-furnace.com/ โทร: 02-888-3472

Line ID: @add11 e-mail: add028883472@gmail.com

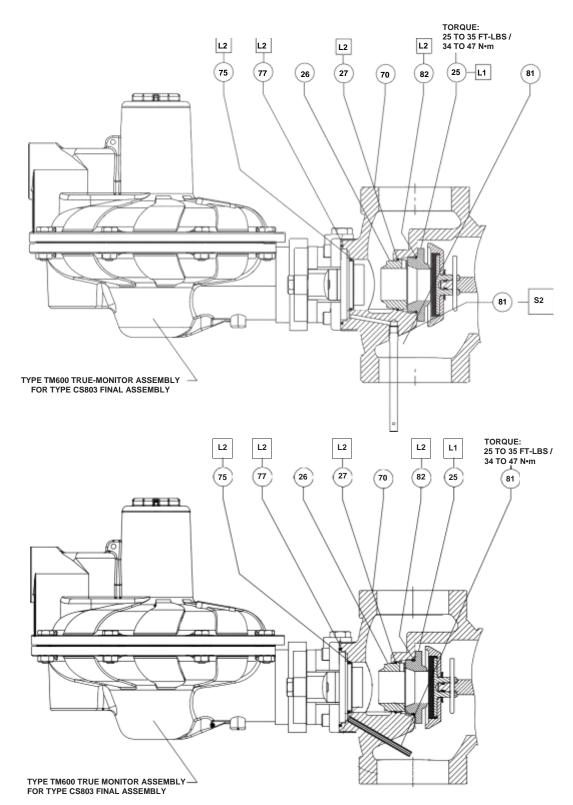


APPLY LUBRICANT (L) / SEALANT (S)(1):

Figure 18a. CS800 Series Integral True-Monitor™ Module and Orifice Assemblies

L1 = ANTI-SEIZE LUBRICANT

L2 = EXTREME LOW TEMPERATURE BEARING GREASE S2 = MEDIUM STRENGTH THREADLOCKER SEALANT

^{1.} Lubricants and sealants must be selected such that they meet the temperature requirements.

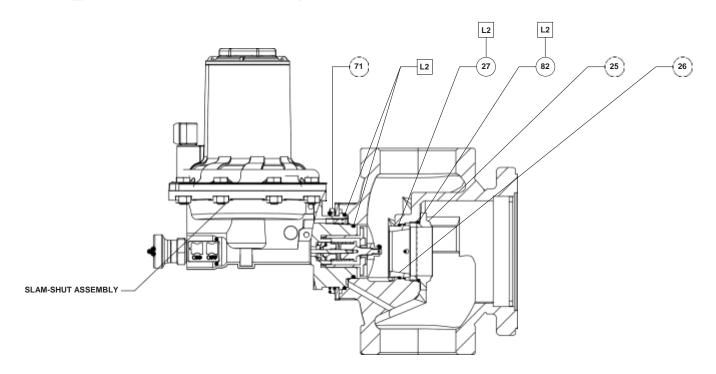

ORIFICE AND SLAM-SHUT ASSEMBLY


GE32407 AB

APPLY LUBRICANT(1):

L2 = EXTREME LOW-TEMPERATURE BEARING GREASE

1. Lubricants must be selected such that they meet the temperature requirements.

Figure 18b. CS800 Series Slam-shut Module and Orifice Assemblies (continued)

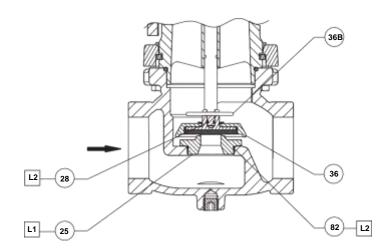


STANDARD ORIFICE AND STANDARD DISK ASSEMBLY

- ☐ APPLY LUBRICANT (L) / SEALANT (S)(1): L1 = ANTI-SEIZE LUBRICANT

 - L2 = EXTREME LOW TEMPERATURE BEARING GREASE
- 1. Lubricants and sealants must be selected such that they meet the temperature requirements.

Figure 19. CS800 Series Base Orifice and Secondary Seat™ (For Types CS805 and CS806) Assemblies

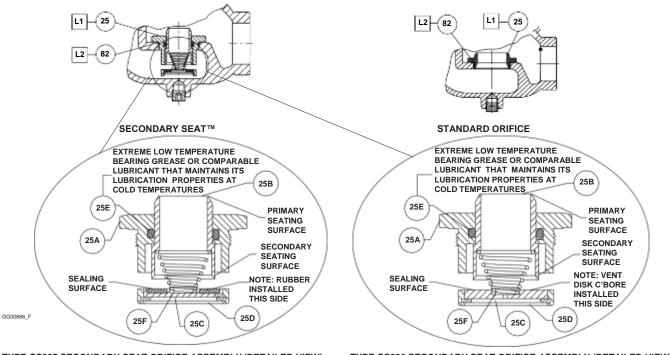

TYPE CS805 SECONDARY SEAT ORIFICE ASSEMBLY (DETAILED VIEW)

TYPE CS806 SECONDARY SEAT ORIFICE ASSEMBLY (DETAILED VIEW)

- APPLY LUBRICANT (L)(1): L1 = ANTI-SEIZE LUBRICANT
 - L2 = EXTREME LOW TEMPERATURE BEARING GREASE
- 1. Lubricants must be selected such that they meet the temperature requirements.

Figure 19. CS800 Series Base Orifice and Secondary Seat (For Types CS805 and CS806) Assemblies (continued)

D103124X012 © 2010, 2020 **Emerson Process** Management Regulator Technologies, Inc. All rights reserved. 06/20. The Emerson logo is a trademark and service mark of Emerson Electric Co. All other marks are the property of their prospective owners. Fisher™ is a mark owned by Fisher Controls

International LLC. a business of Emerson Automation Solutions.

The contents of this publication are presented for information purposes only, and while effort has been made to ensure their accuracy, they are not to be construed as warranties or guarantees,

express or implied, regarding the products or services described herein or their use or applicability. All sales are governed by our terms and conditions, which are available on request. We reserve the right to modify or improve the designs or specifications of our products at any time without notice.

Emerson Process Management Regulator Technologies, Inc. does not assume responsibility for the selection, use or maintenance of any product. Responsibility for proper selection, use and maintenance of any Emerson Process Management Regulator Technologies, Inc. product remains solely with the purchaser.



The distinctive swirl pattern cast into every actuator casing uniquely identifies the regulator as part of the Fisher™ brand Commercial Service Regulator family and assures you of the highest-quality engineering, performance, and support traditionally associated with Fisher™ and Tartarini™ regulators. Visit www.fishercommercialservice.com to access interactive applications.

