



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

## Actuators IC 20, IC 40

Technical Information · GB

3 Edition 04.14



- IC 20 for applications with continuous or three-point step control and Automatic/Manual mode-changeover for easy commissioning, IC 20..E with electronic positioning function and adjustable behaviour in the event of cable discontinuity
- IC 40 for complex applications with programmable functions for flexible adjustment to the process, with statistics and fault history to support service personnel
- A position indicator that can be read externally
- Spacious connection chamber for ease of installation
- Actuators can be delivered ready installed on butterfly valves BVG, BVGF, BVA, BVAF, BVH, BVHS or linear flow control VFC



**krom//  
schroder**



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

## Contents

Actuators IC 20, IC 40 .....	1
------------------------------	---

Contents .....	2
----------------	---

1 Application .....	4
---------------------	---

1.1 Examples of application. ....	7
-----------------------------------	---

1.1.1 IC 20, continuous control. ....	7
---------------------------------------	---

1.1.2 IC 20..E, continuous control .....	7
--	---

1.1.3 IC 20, modulating control with burner control unit BCU 370 .....	8
--	---

1.1.4 IC 40, staged control. ....	9
-----------------------------------	---

1.1.5 IC 40, staged control with three burner capacity levels. ....	9
---	---

1.1.6 IC 40, continuous control by three-point step signal .....	10
--	----

1.1.7 IC 40, staged control with pre-purge. ....	11
--	----

1.1.8 IC 40, continuous control with defined ignition position. ....	12
--	----

1.1.9 IC 40, hot-air compensation. ....	13
---	----

1.1.10 IC 40, staged control with online adjustment of the	
--	--

burner capacity. ....	14
-----------------------	----

2 Certification .....	15
-----------------------	----

3 IC 20 function .....	16
------------------------	----

3.1 IC 20..T Connection diagram .....	17
---------------------------------------	----

3.2 IC 20..E connection diagram .....	18
---------------------------------------	----

3.2.1 Continuous control. ....	18
--------------------------------	----

3.2.2 2-point step control. ....	18
----------------------------------	----

3.3 IC 20..E Display .....	19
----------------------------	----

3.3.1 In Manual mode. ....	19
----------------------------	----

3.3.2 Low-fire/High-fire rate adjustment (in Manual mode	
--	--

only) .....	19
-------------	----

3.3.3 Warnings and faults .....	19
---------------------------------	----

3.4 IC 20..E DIP switch. ....	20
-------------------------------	----

4 IC 40 function .....	21
------------------------	----

4.1 Operating modes. ....	22
---------------------------	----

4.2 Standard and analogue operating modes. ....	22
---	----

4.3 Closed, low-fire rate, intermediate and open position .....	22
---	----

4.4 Running times. ....	23
-------------------------	----

4.5 Standard operating modes 1 – 12. ....	24
---	----

4.5.1 2-point operation. ....	24
-------------------------------	----

4.5.2 2-point operation with flame proving period .....	25
---	----

4.5.3 2-step operation with one or two digital inputs .....	26
---	----

4.5.4 2-step operation with two digital inputs .....	28
--	----

4.5.5 3-point step operation. ....	29
------------------------------------	----

4.5.6 3-step operation with one or two digital inputs .....	30
---	----

4.5.7 2-point operation with switchover of the adjustment	
---	--

angle for the "open" position. ....	32
-------------------------------------	----

4.5.8 2-point operation with input-dependent adjustment	
---	--

angle for the "open" position. ....	34
-------------------------------------	----

4.5.9 2-point operation with switchover of the running times. ....	35
--	----

4.5.10 3-point step operation with running time fractions. ....	36
---	----

4.5.11 3-step operation with two digital inputs .....	38
---	----

4.5.12 3-point step operation with low position .....	39
---	----

4.6 Analogue operating modes 21 – 27. ....	40
--	----

4.6.1 2-point operation .....	40
-------------------------------	----

4.6.2 2-point operation with switchover of the adjustment	
---	--

angle for the "open" position. ....	42
-------------------------------------	----

4.6.3 2-point operation with input-dependent adjustment	
---	--

angle for the "open" position. ....	44
-------------------------------------	----

4.6.4 2-point operation with switchover of the running times. ....	45
--	----

4.6.5 2-point operation with characteristic curve switchover I .....	47
--	----

4.6.6 2-point operation with characteristic curve switchover II .....	49
---	----

4.6.7 2-step operation with two digital inputs and variable	
---	--

adjustment angl .....	51
-----------------------	----

4.6.8 Safety closing function. ....	52
-------------------------------------	----

4.7 Parameters .....	53
----------------------	----

4.7.1 Parameter sets .....	54
----------------------------	----

4.7.2 Factory default parameters. ....	56
--	----

4.8 Inputs. ....	57
------------------	----

4.8.1 Digital .....	57
---------------------	----

4.8.2 Analogue .....	57
----------------------	----

4.9 Outputs .....	59
-------------------	----

4.10 Manual mode .....	60
------------------------	----

4.10.1 Direct position preset .....	60
-------------------------------------	----

4.10.2 Simulate inputs. ....	60
------------------------------	----

4.11 Statistics. ....	61
-----------------------	----

4.11.1 Counters. ....	61
-----------------------	----

4.11.2 Measured values .....	61
------------------------------	----

4.11.3 Resetting statistics. ....	61
-----------------------------------	----

4.11.4 Resetting a signal .....	61
---------------------------------	----

4.12 IC 40 connection diagram .....	62
-------------------------------------	----

4.13 Display .....	63
--------------------	----

4.13.1 During operation. ....	63
-------------------------------	----

4.13.2 Warnings and faults. ....	63
----------------------------------	----

4.14 Relay outputs RO 1 and RO 2 function .....	65
---	----

5 Replacement possibilities for actuators .....	66
---	----



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

5.1 GT 31 is to be replaced with IC 20 .....	66	11.2 Positions .....	84
5.2 GT 31 is to be replaced with IC 40 .....	67	11.3 Adjustment angle for the "open" position. ....	84
5.3 M5/M6 is to be replaced with IC 40 .....	68	<b>12 Legend .....</b>	<b>85</b>
<b>6 Selection .....</b>	<b>69</b>	<b>Feedback .....</b>	<b>86</b>
6.1 IC 20, IC 40. ....	69	<b>Contact .....</b>	<b>86</b>
6.1.1 Type code .....	69	<b>Contents</b>	
<b>7 Project planning information .....</b>	<b>70</b>		
7.1 Electrical connection. ....	70		
7.1.1 Cable selection .....	70		
7.1.2 IC 20. ....	70		
7.1.3 IC 20.E. ....	70		
7.1.4 IC 40 .....	70		
7.2 Feedback potentiometer. ....	72		
7.3 Installation .....	73		
7.4 IC 40 commissioning. ....	73		
<b>8 Accessories .....</b>	<b>74</b>		
8.1 IC 20, IC 40 Heat deflectors .....	74		
8.2 Adapter set for mounting an actuator IC 20, IC 40 onto a butterfly valve DKL, DKG .....	74		
8.3 IC 20, IC 40 "single application" attachment set. ....	74		
8.4 IC 20 potentiometer installation set. ....	75		
8.5 BCSoft® .....	75		
8.5.1 Opto-adapter PCO 200 .....	75		
8.5.2 Bluetooth adapter PCO 300 .....	75		
<b>9 Technical data .....</b>	<b>76</b>		
9.1 IC 20, IC 20.E. ....	76		
9.1.1 IC 20. ....	76		
9.1.2 IC 20.E. ....	76		
9.2 IC 40. ....	77		
9.3 Running times and torques .....	78		
9.4 Dimensions of IBG/IBA (BVG/BVA + IC 20/IC 40) .....	79		
9.4.1 With full bore = nominal diameter .....	79		
9.4.2 With 1 × reduced bore. ....	79		
9.4.3 With 2 × reduced bore .....	79		
9.5 Dimensions of IBGF/IBAF (BVGf/BVAF + IC 20/IC 40) .....	80		
9.5.1 With full bore = nominal diameter .....	80		
9.5.2 With 1 × reduced bore. ....	80		
9.5.3 With 2 × reduced bore .....	80		
9.6 Dimensions of IBH/IBHS (BVH/BVHS + IC 20/IC 40) .....	81		
9.7 Dimensions IFC, IFC.T (VFC + IC 20/IC 40) .....	82		
<b>10 Maintenance cycles .....</b>	<b>83</b>		
<b>11 Glossary .....</b>	<b>84</b>		
11.1 Start fuel flow rate. ....	84		



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ: 08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

## 1 Application


The actuators IC 20 and IC 40 are designed for all applications that require precise, controlled rotary movement between 0° and 90°. They can be mounted directly onto the butterfly valves BVG, BVGF, BVA, BVAF, BVH, BVHS or linear flow control VFC in order to control the gas and air flow rates on gas burners.

Actuators and butterfly valves BVG, BVGF, BVA, BVAF, BVH, BVHS or linear flow control VFC can also be delivered ready assembled as butterfly valves with actuator IBG, IBGF, IBA, IBAF, IBH, IBHS or linear flow control IFC.

### IC 20



IC 20 is controlled by a continuous signal or three-point step signal. The Automatic/Manual mode changeover and the position indicator that can be read externally assist in the setting of the infinitely adjustable switching cams upon commissioning. This enables precise settings even in the low-fire rate range.

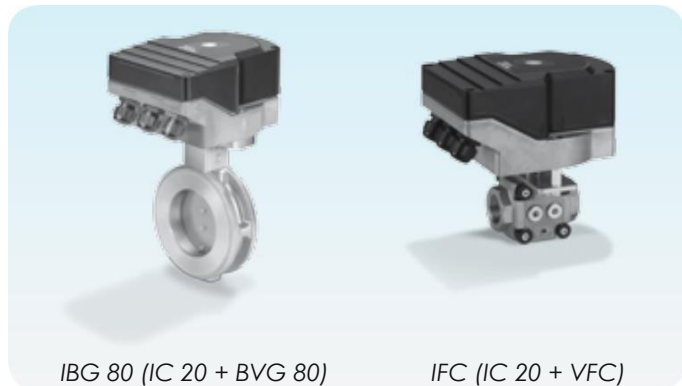

IBG 80 (IC 20 + BVG 80)

IFC (IC 20 + VFC)

An optional integrated feedback potentiometer offers the option of monitoring the current position of the actuator. This checking function can be used in automation processes.



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

## Application

### IC 40



Service technicians can call up statistical data using BCSoft®, such as hours of operation, actuating cycles and a fault history. Some values can also be set to zero, for example to record data over a specific period of time.

The IC 40 offers additional functions. It can be used in continuously-controlled burners and in stage-controlled burners.

Settings on the actuator IC 40 can be made using a PC with the parameterization software BCSoft®. All the relevant settings for the process are made using the software via an optical interface. Various operating modes, which may be modified, are stored in the unit. In addition, the control type (two-point signal, three-point step signal or continuous control), running times, adjustment angles and intermediate positions can be programmed.

The actuator can also be controlled “by hand” using the software.

Once set, all the parameters can be saved on the PC and copied from there into other actuators, thus saving time during the commissioning process.



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

## Application



IC 20 with BVG 80

*Roller hearth kiln in the ceramics industry*



*Forging furnace*



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**


44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

## Application


**krom  
schroder**

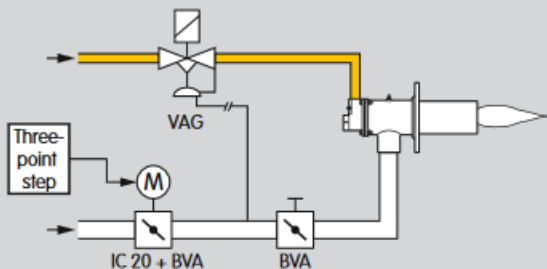

### 1.1 Examples of application

#### 1.1.1 IC 20, continuous control

For processes that require high temperature accuracy and low circulation in the furnace. The actuator IC 20 is controlled by a three-point step controller.

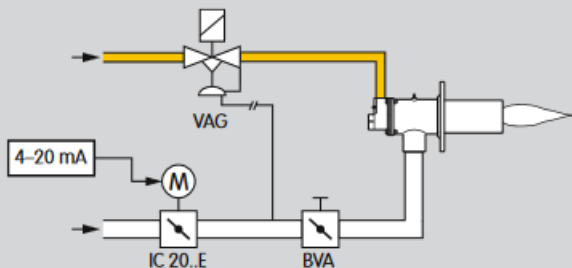

#### 1.1.2 IC 20..E, continuous control

For processes that require high temperature accuracy and low circulation in the furnace. The actuator IC 20..E is controlled by a 4–20 mA, 0–20 mA or 0–10 V signal.



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**


44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

Application > Examples of application

**krom  
schroder**

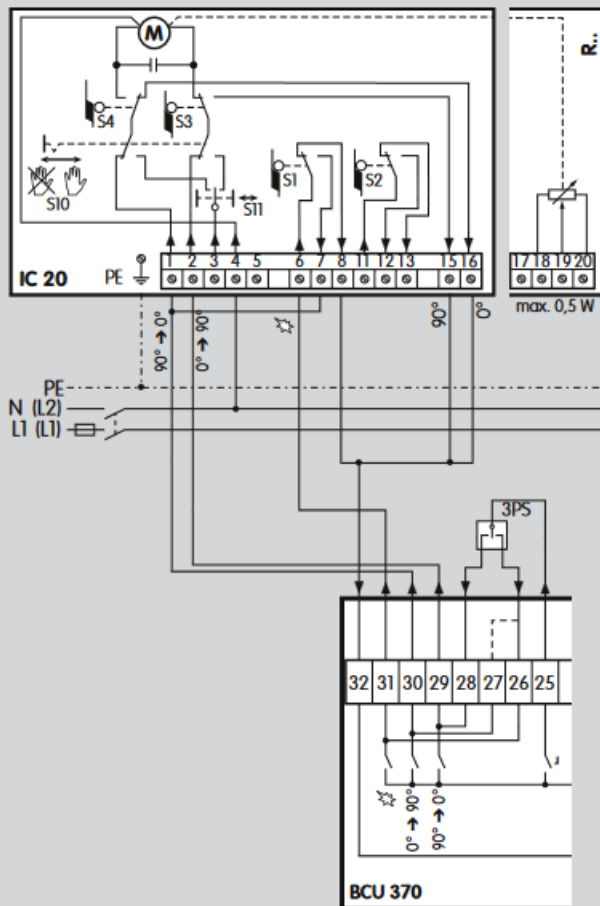

### 1.1.3 IC 20, modulating control with burner control unit BCU 370

This connection option can be used on modulating forced draught burners. The BCU 370 controls the fan and moves the butterfly valve to pre-purge and ignition position. After pre-purge and burner start, the controller enable signal is issued to an external three-point step controller which positions the butterfly valve in accordance with the capacity demand.

The "Close contact" (90° 0°) of the external three-point step controller (3PS) can be connected to terminal 26 or 27 of the BCU 370.

Terminal 26: the controller operates between the open and ignition positions.

Terminal 27: the controller operates between the open and closed positions.



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**


44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

Application > Examples of application


**krom  
schroder**

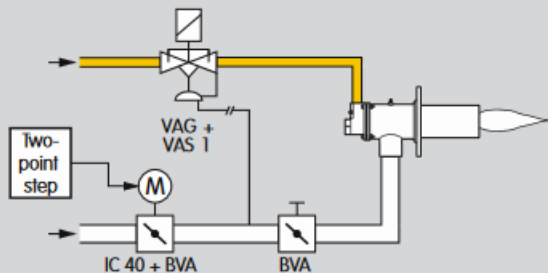

#### 1.1.4 IC 40, staged control

For processes that require a homogeneous temperature distribution in the furnace. The actuator IC 40 is controlled by a two-point controller and operates in On/Off or High/Low intermittent mode.

The actuator closes when the voltage supply is interrupted. The running time can be adjusted between 5 and 25 seconds.

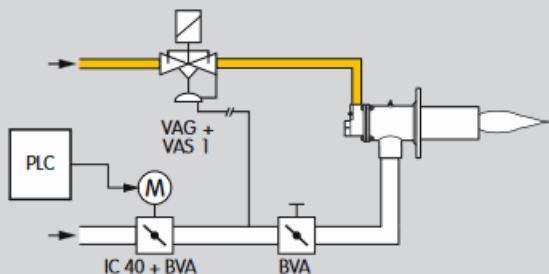

#### 1.1.5

##### IC40, staged control with three burner capacity levels

For processes that require a homogeneous temperature distribution in the furnace and three burner capacity levels. The actuator IC 40 is controlled by a programmable controller and works in High/Medium/Low or High/Medium/Low/Off intermittent mode. This allows the ignition stage to be started. The optional pressure switch provides fail-safe monitoring of the maximum pilot air volume. The actuator running time can be adjusted between 5 and 50 (75) seconds.



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**


44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

## Application > Examples of application

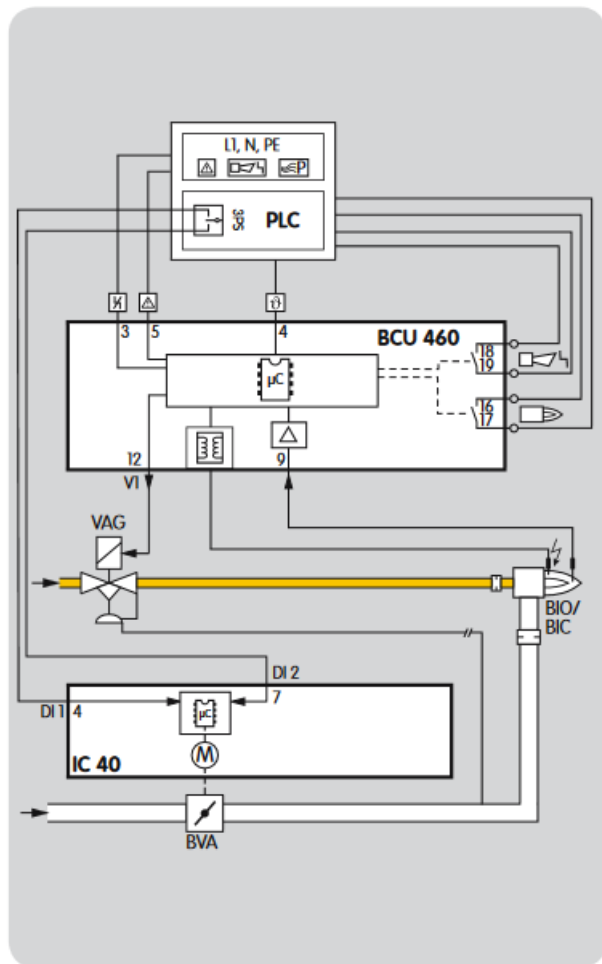

### 1.1.6 IC 40, continuous control by three-point step signal

The actuator IC 40 is controlled by the three -point step controller 3PS and moves the butterfly valve BVA to the ignition position. The burner starts.

Once the burner is operating, the operation signalling contact of the burner control unit BCU 460 closes. The BCU issues the controller enable signal to the temperature controller. The butterfly valve opens or closes between the low-fire and high-fire rate positions depending on the capacity demand of the burner. When the three -point step signal is disconnected, the butterfly valve stops at its current position.

If both inputs on the IC 40 (DI 1 and DI 2) are actuated after the burner has been shut down, the butterfly valve closes further than the low-fire rate position (see Operating mode 12, 3-point step operation with low position)

DI 1	DI 2	IC 40 position	Valve position
Off	Off	Idle/Stop	Idle
On	Off	Open to high position	Open to high-fire rate
Off	On	Close to middle position	Close to low-fire rate
On	On	low	Valve closes further



44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom**  
**schroder**

### Application > Examples of application



The central control system starts the pre-purge. Input DI 2 is actuated via the air valve output of the BCU and moves the butterfly valve BVA to the pre-purge position.

In the event of a temperature demand, the burner control unit BCU actuates input DI 1 via the valve output V1 and moves the butterfly valve to the ignition position. (Precondition: the IC 40 must have reached the ignition position on the instant of ignition.) The burner starts.

To activate the high -fire rate, DI 2 is actuated via the air valve output on terminal 26 of the BCU.

The butterfly valve moves cyclically between the high-fire rate position and the low-fire rate position (see Operating mode 11, 2-step operation with two digital inputs).

DI 1/	DI 2/	IC 40	Valve position
V1	air Valve	position	
Off	Off	closed	Closed
On	Off	low	Ignition position/low-fire rate
On	On	middle	High-fire rate
Off	On	high	Pre-purge



44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ: 08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

### Application > Examples of application



In the event of a temperature demand, the burner control unit BCU actuates input DI 1 via the valve output V1 and moves the butterfly valve to the ignition position. (Precondition: the IC 40 must have reached the ignition position on the instant of ignition.) The burner starts.

The BCU actuates DI 2 via the air valve output. This enables the analogue input AI on the actuator IC 40. Depending on the capacity demand of the temperature controller, the butterfly valve BVA moves steplessly to the position between the low-fire rate and the high-fire rate as specified by the analogue input AI (see Operating mode 27, 2-step operation with two digital inputs and variable adjustment angle).

DI 1/	DI 2/	IC 40	Valve position
V1	air valve	position	
Off	Off	closed	Closed
On	Off	low	Ignition position/low-fire rate
			Any position between ignition
On	On	AI	
			position and pre-purge
Off	On	high	Pre-purge/high-fire rate



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**


44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

Application > Examples of application

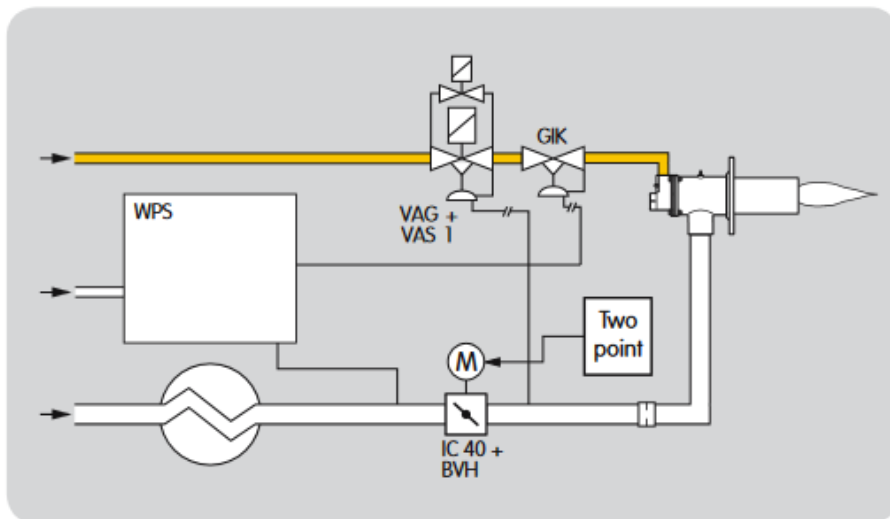

### 1.1.9 IC 40, hot-air compensation

For processes in which preheated combustion air at a temperature of up to 450°C must be controlled. In this example, the actuator IC 40 is regulated by a two-point controller to adjust the burner capacity. It runs in High/Low intermittent mode. The running time can be adjusted between 5 and 25 seconds.



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**


44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

## Application > Examples of application

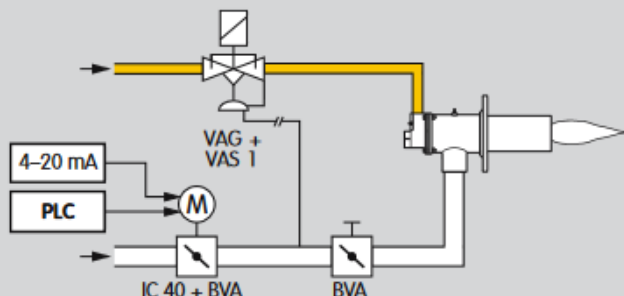

### 1.1.10 IC 40, staged control with online adjustment of the burner capacity

For processes that require a homogeneous temperature distribution and high temperature accuracy in the furnace.

If only a low heat output is required, for example to maintain the temperature in the furnace, the burner can continue to run in intermittent mode. The adjustment angle of the valve is reduced by the analogue input (4–20 mA) of the actuator and the burner capacity is therefore lowered. This ensures uniform temperature distribution even with a low burner capacity.

This function of the actuator IC 40 can also be used in the ceramics industry to correct the lambda value or for temperature compensation purposes in hot-air applications.



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

## 2 Certification

### EC type-tested and certified



### Meets the requirements of the

- Low Voltage Directive (2006/95/EC) on the basis of EN 60730-1,
- Electromagnetic Compatibility Directive (2004/108/EC).

### Approval for Russia



Certified by Gosstandart pursuant to GOST R.

Approved by Rostekhnadzor (RTN).

Scan of the approval for Russia (RUS), see [www.docuthek.com](http://www.docuthek.com)

→Elster Kromschröder→Kromschröder,  
LBE→Products→03 Valves and butterfly  
valves→Actuators IC 20, IC 40→Type of document:  
Certificate→IC B00069 (nationales Zertifikat  
Russland) (RUS)



บริษัท เอดีดี เฟอ์เรนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ: 08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

## 3 IC 20 function

The actuator IC 20 moves towards 0° or 90° if it is energized electrically at the related terminal. If the voltage is disconnected, the actuator stops at the current position. A high holding torque when de-energized renders additional braking elements superfluous. The low-fire and high-fire rates are adjusted using two infinitely adjustable switching cams (S3, S4). An optional integrated feedback potentiometer offers the option of monitoring the current position of the actuator.

The actuator IC 20 is optimally tailored to the Kromschöder butterfly valves BVG, BVGF, BVA, BVAF, BVH, BVHS or linear flow control VFC.

### IC 20.E

In normal operation, input "OK" is supplied with voltage. The setpoint device issues an actuating signal (0 (4) – 20 mA, 0–10 V). The current signal corresponds to the adjustment angle to be approached (e.g. with a 0–20 mA signal, 10 mA correspond to a valve angle of 45°). The minimum and maximum adjustment angles can be set manually using the keys. The hysteresis can be adjusted on a potentiometer to suppress interference in the input signal.

The IC 20..E offers the option of monitoring the current position of the actuator via the continuous 4–20 mA output signal.

### Automatic/Manual mode

Switchover between Automatic and Manual mode facilitates setting of the infinitely adjustable switching cams during commissioning. This enables precise settings even in the low-fire rate range.

The switching point is set directly on the cams with a screw-driver.

External devices can be activated or intermediate positions can be checked via two additional, floating, infinitely adjustable switches.



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**


44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

IC 20 function

**krom  
schroder**

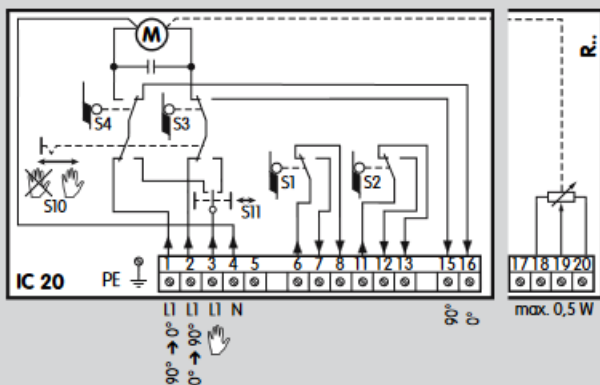


### 3.1 IC 20..T Connection diagram

See page 70 (Project planning information).

See page 76 (Technical data).



## IC 20 function

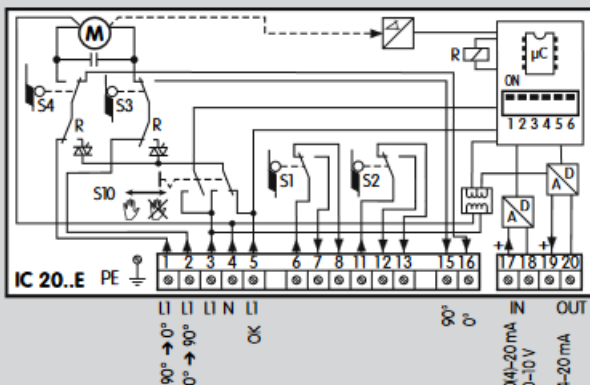

### 3.2 IC 20..E connection diagram


See page 70 (Project planning information).

See page 76 (Technical data).

#### 3.2.1 Continuous control

Following successful modulation enable via terminal 5(OK), the actuator reacts to the setpoint specification 0 (4) – 20 mA, 0 – 10 V) via terminals 17 and 18.

The pre-purge and ignition positions are controlled via terminals 1 and 2.

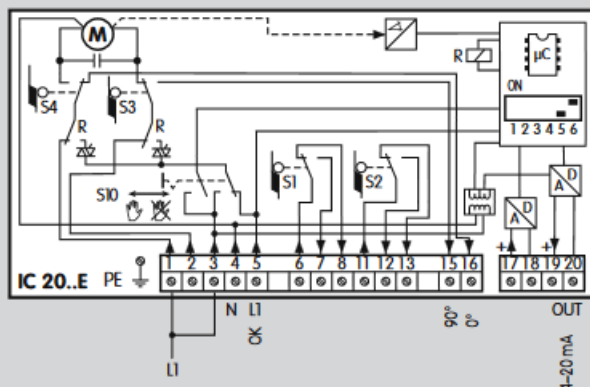

#### 3.2.2 2-point step control

Connect voltage to terminals 1 and 3. Set the DIP switch to 2-point step control, see page 20 (IC 20..E DIP switch).

If an input signal is applied to terminal 5(OK), the actuator opens. If no input signal is applied to terminal 5, the actuator closes.

Terminals 17 and 18 for continuous control are not required in the case of 2-point control



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

IC 20 function



## 3.3 IC 20..E Display

### 3.3.1 In Manual mode

Blue LED	Red LED	Operating state
On	Off	Manual mode
Flashing	Flashing	Calibration (in Manual mode only)

### 3.3.2 Low-fire/High-fire rate adjustment (in Manual mode only)

Blue LED	Red LED	Operating state
On	On for 0.5 s	Min. value $\geq$ max. value*
Off for $\leq 0.5$ s	Off	Min. or max. setting accepted

\* Value will only be accepted, if the Min. or Max. button is pressed for another three seconds

### 3.3.3 Warnings and faults

Blue LED	Red LED	Warning/fault	Description	Cause
Off	Flashing light (1×)	Warning	The device is in 4 – 20 mA mode, the input signal is $< 3$ mA	- Cable discontinuity on the 4 – 20 mA set point input
Off	Flashing light (2×)	Warning	Many changes of direction, input signal oscillates	- Hysteresis set too small
Off	Flashing light (3×)	Warning	Control range $< 1^\circ$	- Device programming error (min. and max. setting)
Flashing light (1×)	Permanent light	Fault	Calibration not successful	- Control range $< 1^\circ$ (cams overlapping), motor defective, gear defective, potentiometer defective
Flashing light (2×)	Permanent light	Fault	Internal fault	- Unit defective



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170


โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

IC 20 function

**krom  
schroder**

#### Choosing the input signal

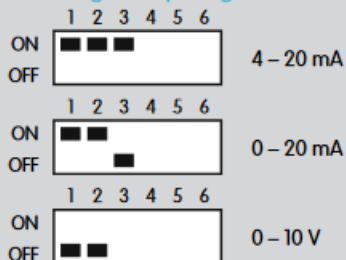


#### Load impedance of the current input




### 3 .4 IC 20..E DIP switch

The setpoint device input, the load impedance of the current input, the behaviour in the event of cable discontinuity (4 – 20 mA) or 2-point step control are set by means of a DIP switch on the actuator.

#### Behaviour in the event of cable discontinuity (4 – 20 mA)

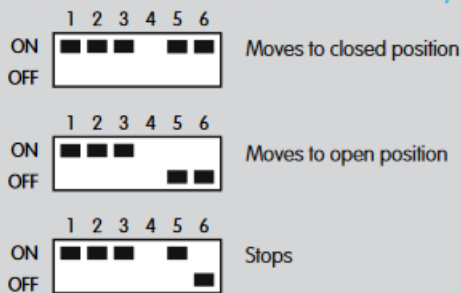

#### 2-point step control



■ = Switch position



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

## 4 IC 40 function

The actuator IC 40 moves the butterfly valve towards 0° or 90°. There are 4 possible positions which the actuator can approach in steps. Any intermediate position is possible in continuous three-point step mode. Optionally, the actuator can also approach any intermediate position via an additional current input.

The slow flashing blue LED indicates that the motor of actuator IC 40 is moving. The position indicator on the housing indicates the opening angle. Further visualization and operation are performed on a PC using the Kromschöder BCSof<sup>®</sup>t software.

## BCSof<sup>®</sup>t

The sequence of opening and closing is programmed using the BCSof<sup>®</sup>t software and can be adapted individually to any application.

All settings for the actuator IC 40 are made using BCSof<sup>®</sup>t. Commissioning and calibration of the "closed" position are performed conveniently using the software.

BCSof<sup>®</sup>t offers the option of moving and setting the butterfly valve in Manual mode via the actuator, see page 60 (Manual mode).

A detailed manual is available for the BCSof<sup>®</sup>t software:  
<http://www.docuthek.com>

Products 03 Valves and butterfly valves  
Actuators IC 20, IC 40.



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ: 08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

IC 40 function

**krom  
schroder**

## 4.1 Operating modes

The operating mode is responsible for the setting properties of the IC 40.

The running times and dwell positions of the actuator are stored in the various operating modes but can be reprogrammed at any time using BCSof<sup>®</sup> (if mounted on BVA, BVG or BVH).

The actuator operates in continuous and intermittent mode with various adjustment angles for the "open" position. The adjustment angles for the "open" position indicate the approach position of the actuator in the case of intermittent operation. They can be changed in BCSof<sup>®</sup>.

The corresponding operating modes are displayed in BCSof<sup>®</sup> as flowcharts by way of example to visualize the opening/ closing behaviour of the actuator.

## 4.2 Standard and analogue operating modes

In the **standard operating modes**, two digital inputs (DI 1 and DI 2) of the actuator are pre -assigned at the works as universal inputs. If a voltage of 24 V DC or 100 – 230 V AC is applied to the input, this is recognized as "On" signal (positive logic) . It is not necessary to set or readjust the voltage magnitude or voltage type.

In the **analogue operating modes**, an additional input (AI) is assigned for the actuator. If an actuator IC 40..A with 4 – 20 mA analogue input is connected (option), further operating modes are available in addition to the standard operating modes. The actuator can approach corresponding intermediate positions via a current signal to the additional input, see page 58 (Priority and running time in operating modes 1 – 10).

## 4.3 Closed, low-fire rate, intermediate and open position

Depending on the set operating mode, there are 4 positions which the actuator can approach: Closed = 0° = 0%,  
Low = low-fire rate position,  
Middle = intermediate position,  
High = open position.

The positions not used by the operating mode are barred in this case.

The "closed position" is always the calibrated zero position of the device and cannot be readjusted. The other positions can be defined on site.

Basically, the following parameter limits must be noted.

Ascending sequence of positions:

0% = closed ->

low ->

middle ->

high ≤ 100%

The "high position" may not be selected less than 10%.

If the positions have been changed in the software, BCSof<sup>®</sup> checks the new values for compliance with the limits and adapts the positions.



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ: 08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

IC 40 function

**krom  
schroder**

#### 4..4 Running times

Up to 6 running times ( $t_1$  to  $t_6$ ), each between 0 and max. 25.5 seconds, can be set dependent on the operating mode.

A minimum running time is required for each change in position.

Minimum actuator running time  $t_{min}$ :

$$4.5 \text{ s} \times \text{change in position \%}$$

$$t_{min} = \frac{4.5 \text{ s} \times \text{change in position \%}}{100\%}$$

Times which are too short are automatically corrected by the IC 40 to the minimum possible value. If the actuator is to operate as fast as possible, a time of 0 seconds can be pre-set.

In the case of undershoot of position changes < 16.2%, the maximum running time is reduced from 25.5 s percentage-wise. The IC 40 corrects the time to the maximum possible value.

After they have been entered, the valid parameters are automatically read out and displayed in BCSoft®.

We recommend switching to Manual mode when commissioning in order to establish the right positions and running times for the application, see page 60 (Manual mode).

#### Outputs

In addition to feedback signals, it is also possible to apply freely adjustable position ranges to the two outputs, RO 1 and RO 2, see page 59 (Outputs).

#### Statistics

The statistical data stored in the unit, such as faults which have occurred, various counter readings and measured values, are displayed and read out in BCSoft®, see page 61 (Statistics).

#### Safety closing function

A pre-tensioned spiral spring moves the drive shaft with valve disc against the mechanical stop of the butterfly valve to closed position in the event of faults or if the continuous supply voltage is interrupted, within the closing time < 1 s, see page 52 (Safety closing function).



บริษัท เอดีดี เฟอร์เนส จำกัด


**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

IC 40 function

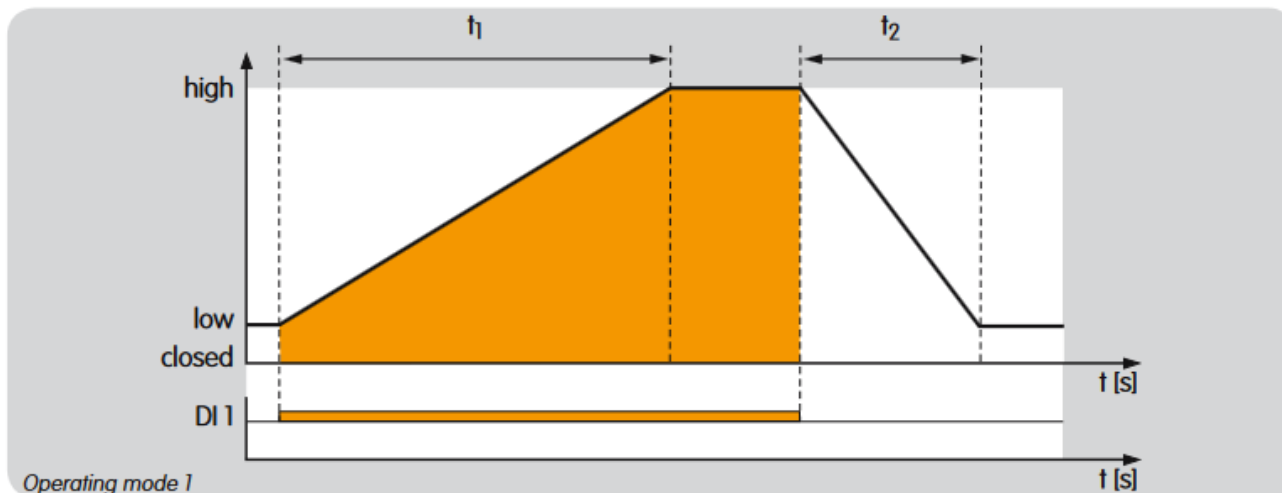

## 4.5 Standard operating modes 1 – 12

General description, see page 22 (Operating modes).

### 4.5.1 2-point operation

Operating mode 1

In idle state (DI 1 with no signal), the actuator is in "low" position

("low" position may also be  $0^\circ$  = "closed" position).

If a signal is applied to digital input DI 1, the actuator moves

to "high" position in running time  $t_1$ . As the signal at digital input DI 1 drops, the actuator moves back to "low" position in

running time  $t_2$

DI 1	Position
Off	low/closed
On	high

If the signal at digital input DI 1 is deactivated before "high"

position is reached, the actuator moves directly to "low" position in the percentage time of  $t_2$ .

The actuator operates in high/low (high/closed) intermittent mode.

Possible parameter sets for this operating mode:

P 68017, P 68018 and P 68019, see page 54 (Parameter sets).



บริษัท เอดีดี เฟอร์เนส จำกัด


**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

IC 40 function

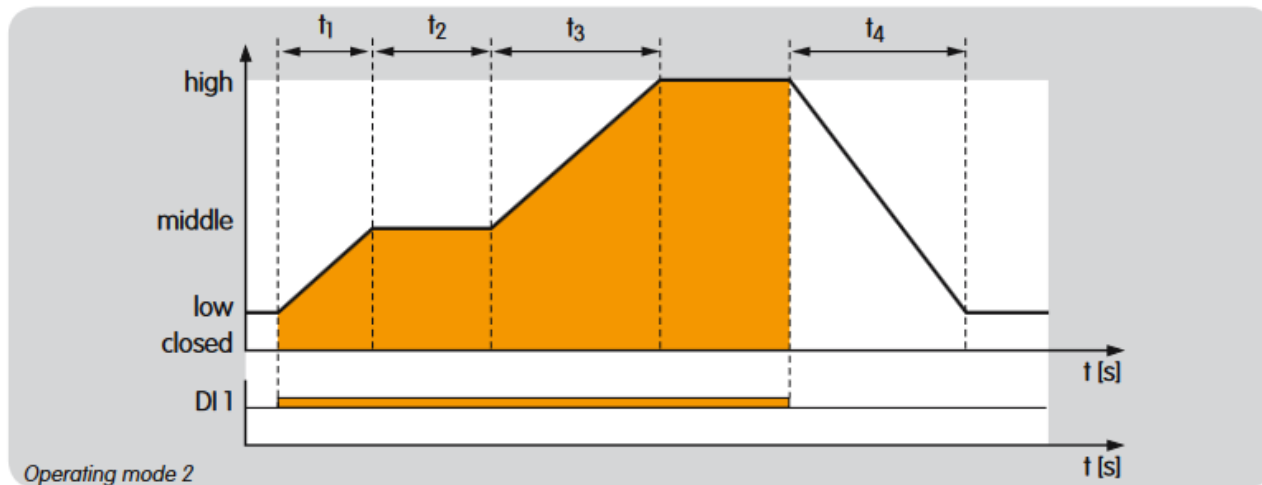

#### 4.5.2 2-point operation with flame proving period

Operating mode 2

In idle state (DI 1 with no signal), the actuator is in "low" position

("low" position may also be 0° = "closed" position).

If digital input DI 1 is activated, the actuator moves to "middle" position in running time t1.

After the waiting time t2, the actuator automatically moves

further to "high" position in running time t3.

As the voltage at digital input DI 1 drops, the actuator closes to the "low" position in running time t4.

DI 1	Position
Off	low/closed
On	high

If the signal at digital input DI 1 is deactivated before "high" position is reached, the actuator moves directly to "low" position in the percentage time of t4. The actuator operates in high/middle/low (high/middle/closed) intermittent mode. On burners which must ignite during opening of the butterfly valve, the waiting time t2 is appropriate for flame proving.

Possible parameter set for this operating mode: P 68021, see page 54 (Parameter sets).



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**


44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

IC 40 function > Standard operating modes 1 – 12

**krom  
schroder**

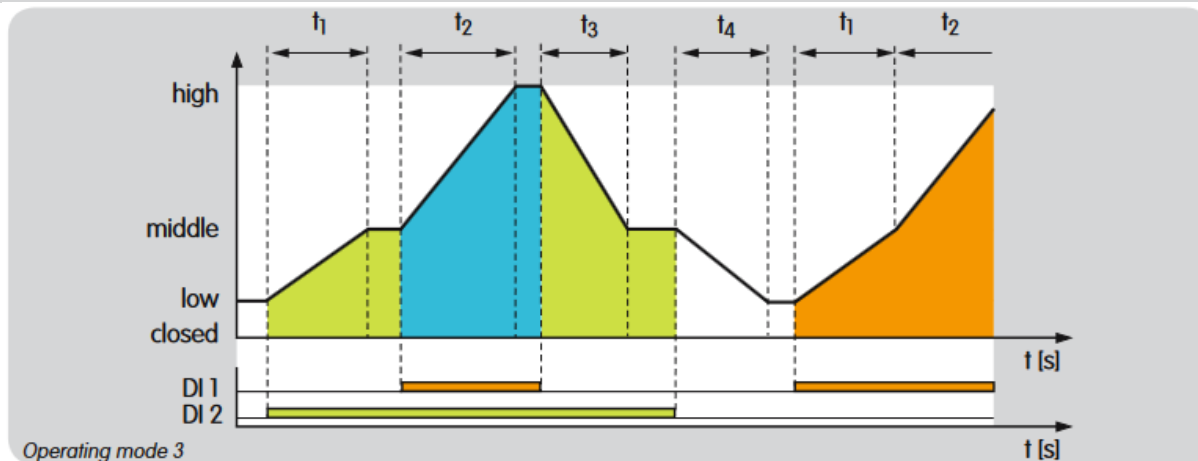

#### 4.5.3 2-step operation with one or two digital inputs

Operating mode 3

In idle state (DI 1 and DI 2 with no signal), the actuator is in "low"

position ("low" position may also be 0° = "closed" position).

##### Control via two digital inputs

If digital input DI 2 is activated, the actuator moves from "low"

position to "middle" position in running time t1.

If, in addition, digital input DI 1 is activated, the actuator approaches "high" position in running time t2.

When the signal DI 1 drops, the actuator moves back to "middle"

position in running time t3 and closes the control element to the "low" position in running time t4 if the signal is also disconnected from DI 2.

The actuator operates in high/middle/low (high/middle/closed) intermittent mode.

DI 1	DI 2	Position
Off	Off	low/closed
On	Off	high (DI 1 has priority)
Off	On	middle
On	On	high

In this operating mode, digital input DI 1 has priority and its signal always leads to opening of the actuator to the "high" position.



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**


44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

IC 40 function > Standard operating modes 1 – 12 > 2-step  
operation with one or two digital inputs

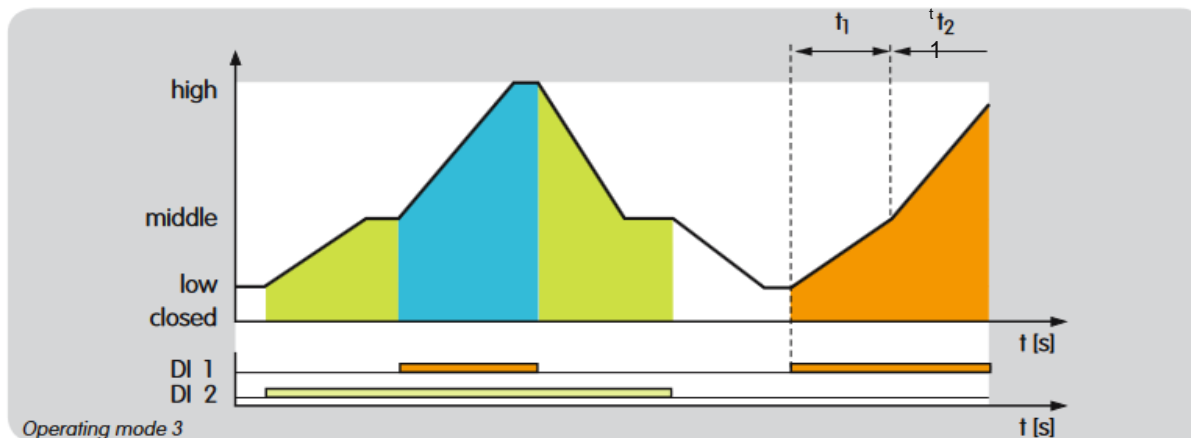

This may prove to be practical in order, for instance, to purge a furnace or kiln via DI 1 (independently of DI 2). It is then possible to operate with both inputs in high/middle/low intermittent mode.

Possible parameter sets for this operating mode:  
P 68015, P 68016, see page.54 (Parameter sets).

### Control via one digital input

If digital input DI 1 is activated (DI 2 with no signal), the actuator moves to "high" position. The running times  $t_1$  and  $t_2$  run directly in succession.

Likewise, the actuator closes in the successive running times  $t_3$  and  $t_4$  if signal DI 1 drops. The "middle" position serves as an interpolation point and can be freely programmed.

Owing to the two successive running times, the opening characteristic of the butterfly valve can be changed. For example, the characteristic of the air circuit can be adapted to that of the gas circuit.

Running times up to 51 s ( $2 \times 25.5$  s) are possible in this operating mode. If the signal at digital input DI 1 is deactivated before "high" position is reached, the actuator moves directly to "low" position in the percentage times of  $t_3$  and  $t_4$ .

The actuator operates in high/low (high/closed) intermittent mode.

DI 1	DI 2	Position
Off	Off	low/closed
On	Off	high



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**


44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

IC 40 function > Standard operating modes 1 – 12

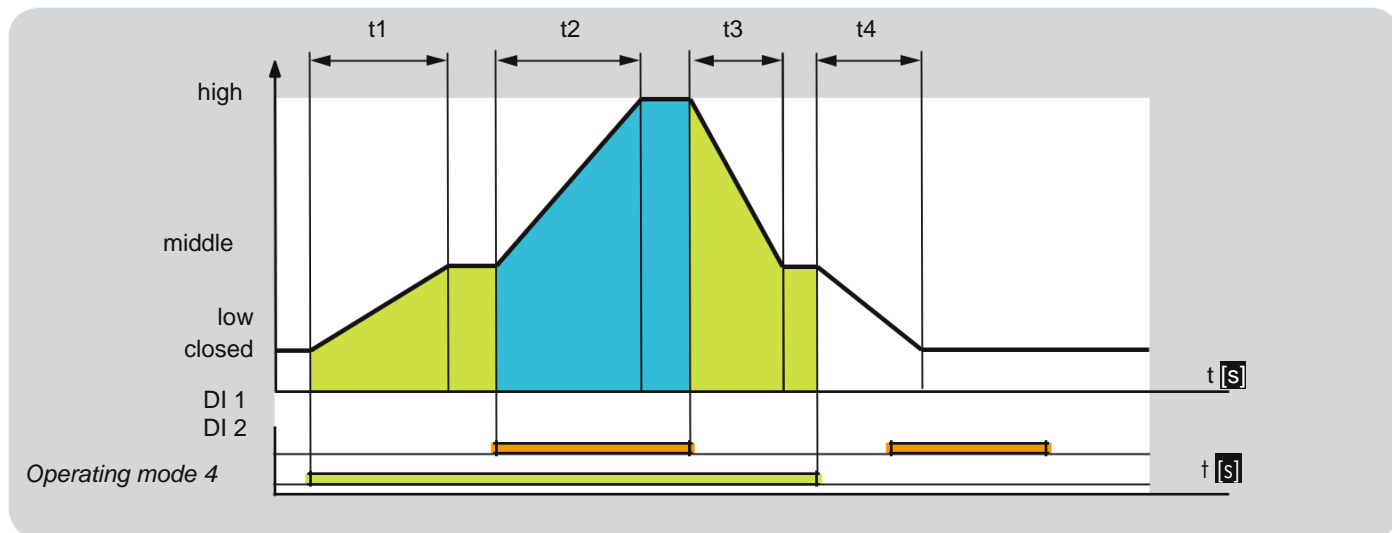

#### 4.5.4 2-step operation with two digital inputs

Operating mode 4

The function corresponds to operating mode 3 with different priority of the digital inputs.

Digital input DI 2 has priority over DI 1. This means that a signal at DI 1 has no effect unless a signal is also applied to DI 2.

DI 1	DI 2	Position
Off	Off	low/closed
On	Off	low/closed (DI 2 has priority))
Off	On	middle
On	On	high

Possible parameter set for this operating mode:  
P 68022, see page 54 (Parameter sets).



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**


44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

IC 40 function > Standard operating modes 1 – 12

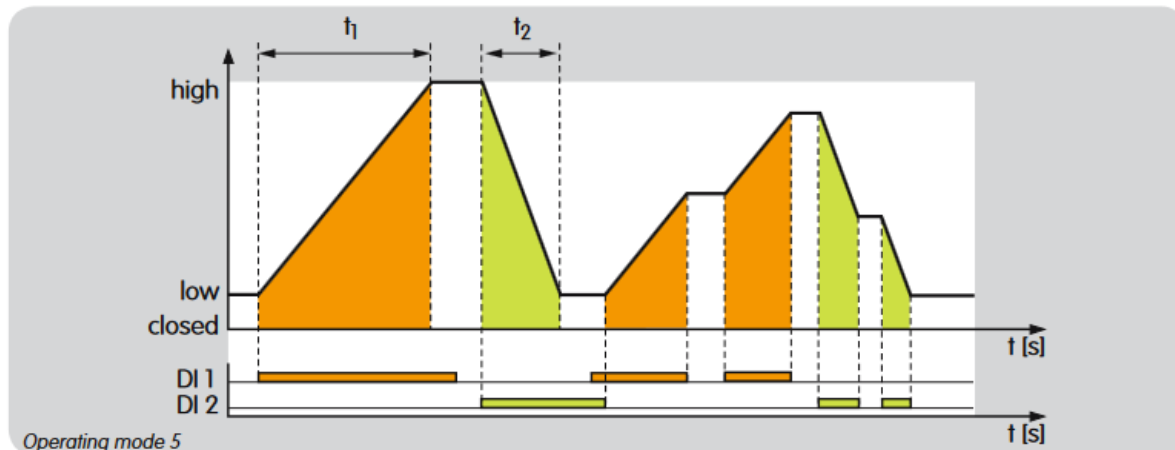

#### 4.5.5 3-point step operation

Operating mode 5

If only digital input DI 1 is active, the actuator opens. If only digital input DI 2 is active, the actuator closes.

If none of the two digital inputs or both digital inputs is or are active simultaneously, the actuator stops in its position. This means that it can stop at any position.

The actuator operates in continuous mode and is controlled via a 3-point step signal. The actuating function is limited by the "low" and "high" positions ("low" position may also be 0° = "closed" position).

The opening speed is pre-set via the time  $t_1$  for the entire "low" to "high" actuating travel. Accordingly, the closing speed is set with  $t_2$  for the entire "high" to "low" actuating travel

Possible parameter sets for this operating mode: P 68012, P 68013, P 68014, see page 54 (Parameter sets).

DI 1	DI 2	Reaction
Off	Off	Idle/Stop
On	Off	Open to "high" position at max.
Off	On	Close to "low" position ("closed" position) at min.
On	On	Idle/Stop

This method of control is frequently used on furnaces and kilns in the sector of ceramics, steel and aluminium



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**


44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

IC 40 function > Standard operating modes 1 – 12

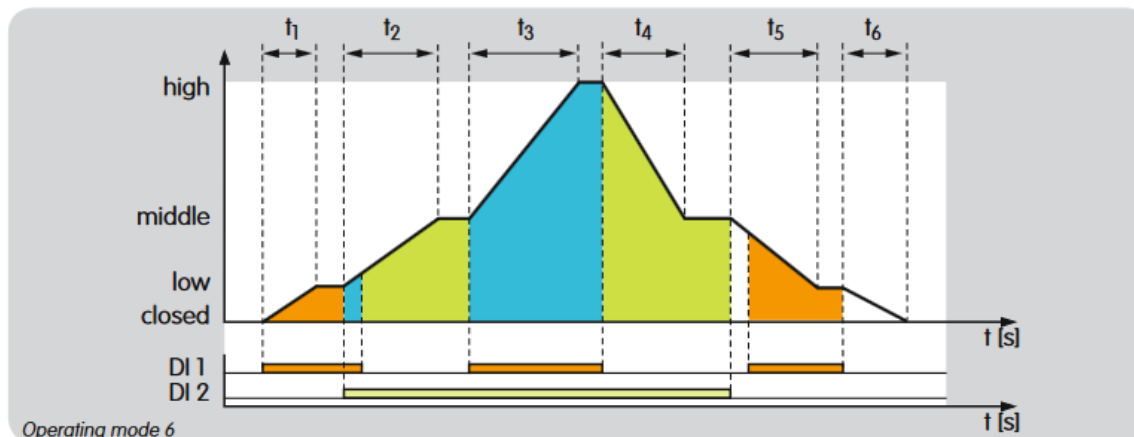

#### 4.5.6 3-step operation with one or two digital inputs

Operating mode 6

Each of the 4 circuit combinations resulting from DI 1 and DI 2

2 determines precisely one actuator position:

DI 1	DI 2	Position
Off	Off	closed
On	Off	low
Off	On	middle
On	On	high

Each signal change results in a new position setpoint for the actuator. If the signals overlap (see t2), the actuator moves towards "high". If the signals do not overlap (see t5), the actuator moves towards "closed".

Various modes of operation can be implemented with this operating mode.

#### Control via one digital input

DI 2 with no signal: The actuator operates in low/closed intermittent mode via digital input DI 1.

DI 1 with no signal: The actuator operates in middle/low intermittent mode via digital input DI 2.



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**


44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

IC 40 function > Standard operating modes 1 – 12 > 3-step operation with one or two digital inputs

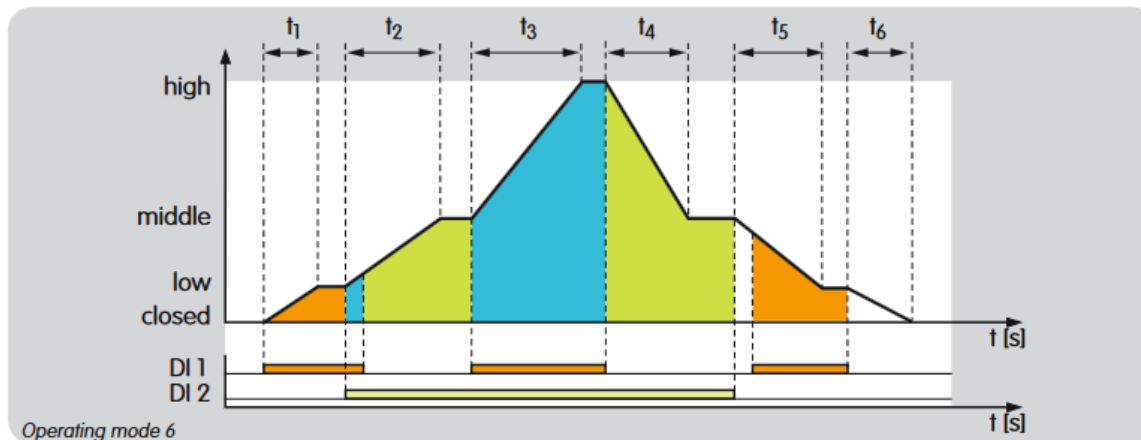

DI 1 with continuous signal, for instance resulting from inversion of the logic, see page 57 (Switching logic): The actuator operates in high/low (high/closed) intermittent mode via digital input DI 2 with two successive running times up to 51 s (2 x 25.5 s). DI 1 and DI 2 are connected in parallel: The actuator operates with one signal in high/closed intermittent mode with three successive running times up to 76.5 s (3 x 25.5 s).


With three successive running times via interpolation points, it is possible to change the opening characteristic of the butterfly valve. For example, the characteristic of the air circuit can be adapted to that of the gas circuit.

### Control via two digital inputs

If all possible combinations of the two inputs are used, for instance by a PLC control system, it is possible to implement high/middle/low/closed intermittent mode (3 steps plus the "closed" position). Possible parameter set for this operating mode: P 68001, see page 54 (Parameter sets).



## IC 40 function > Standard operating modes 1 – 12

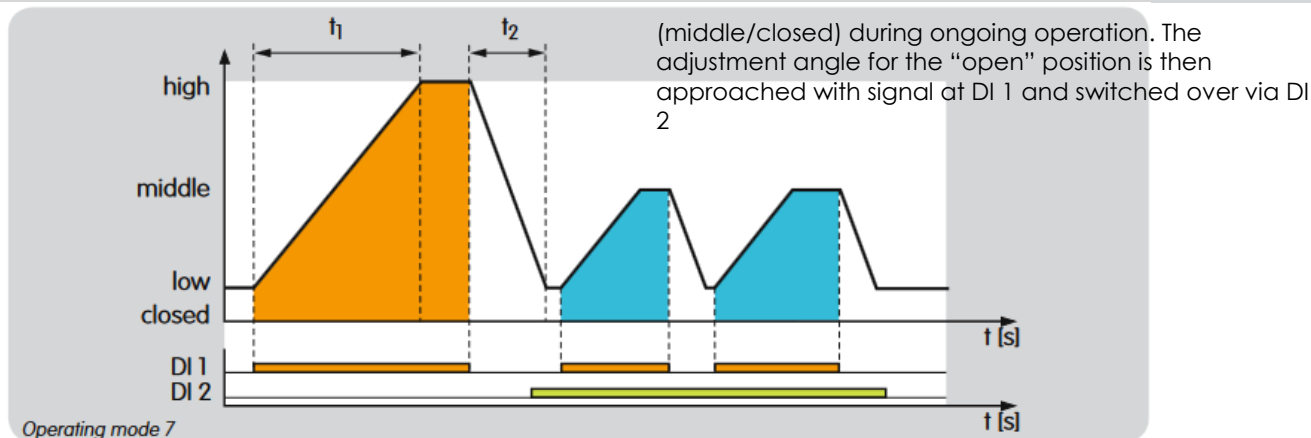

### 4.5.7 2-point operation with switchover of the adjustment angle for the "open" position

#### Operating mode 7

In idle state (DI 1 and DI 2 with no signal), the actuator is in "low" position ("low" position may also be 0° = "closed" position). Digital input DI 1 functions as a pulse input.

DI 2 has no signal: The actuator operates in high/low (high/closed) intermittent mode via digital input DI 1. Signal at DI 2:

The actuator can switch over its intermittent mode between high/low (high/closed) and middle/low

The actuator now operates in middle/low (middle/closed) intermittent mode via digital input DI 1. The heat output can now be reduced and it is nevertheless possible to continue operation in intermittent mode so as to ensure a uniform temperature distribution. High/low may also be used for purging and middle/low may also be used for heating mode in order, for instance, to reduce the pre-purge time.

DI 1	DI 2	Position
Off	Off	low/closed
On	Off	high
Off	On	low/closed (DI 1 has priority)
On	On	middle



บริษัท เอดีดี เฟอร์เนส จำกัด


**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<http://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

IC 40 function > Standard operating modes 1 – 12

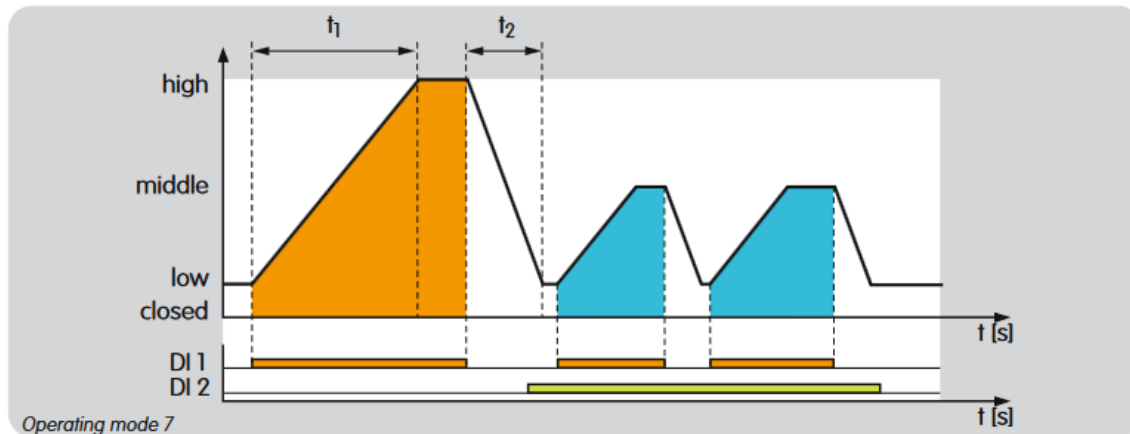

The opening speed is pre-set via the running time  $t_1$  for the entire “low” to “high” actuating travel. Accordingly, the closing speed is set with  $t_2$  for the entire “high” to “low” actuating travel. The speeds are retained when switching with reduced capacity (signal at DI 2). The running time is shortened in accordance with the reduced position.

Alternative function (2-step operation with constant speed):

DI 1	DI 2	Position
Off	Off	low/closed
On	Off	high
Off	On	low/closed (DI 1 has priority)
On	On	middle

For as long as a signal is applied to DI 1, DI 2 switches to and fro between “high” and “middle” position. In this case, it may be practical to invert the logic of digital input DI 2, see page 57 (Switching logic). This mode of operation ensures that the actuator always opens or closes at constant speed. Possible parameter set for this operating mode: P 68023, see page 54 (Parameter sets).



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**


44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

IC 40 function > Standard operating modes 1 – 12

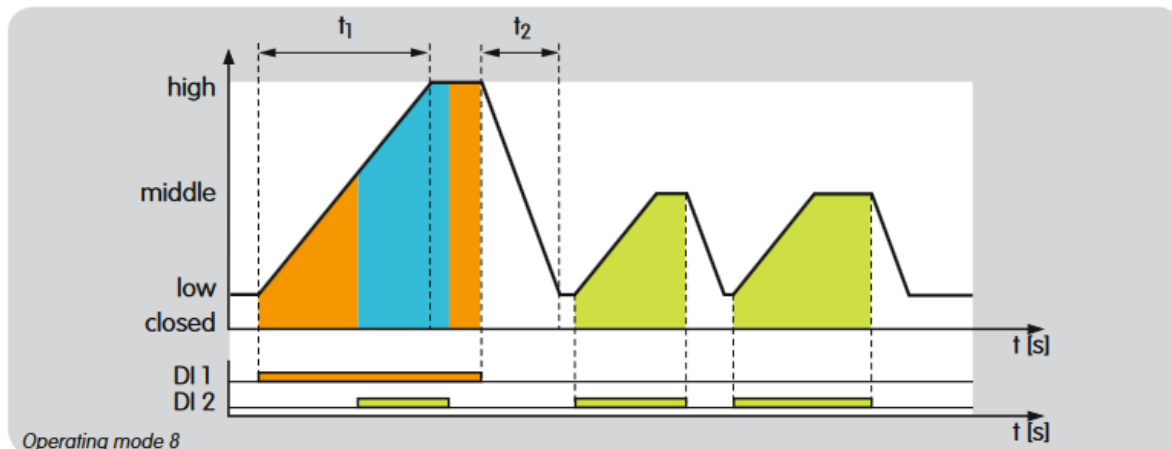

#### 4.5.8 2-point operation with input-dependent adjustment angle for the “open” position

Operating mode 8

The function corresponds to operating mode 7 apart from the fact that both digital inputs function as pulse inputs.

The actuator operates in high/low (high/closed) intermittent mode via digital input DI 1 and operates in middle/low (mid-dle/closed) mode via DI 2.

A signal at DI 1 (priority) always leads to approaching to “high” position which, for instance, can be used to purge the furnace or kiln.

DI 1	DI 2	Position
Off	Off	low/closed
On	Off	high
Off	On	middle
On	On	high (DI 1 has priority)

Alternative function: 2-step operation with constant speed.

For as long as a signal is applied to DI 2, DI 1 switches to and fro between “high” and “middle” position.

This mode of operation ensures that the actuator always opens or closes at constant speed.

Possible parameter set for this operating mode: P 6802, see page 54 (Parameter sets).



บริษัท เอดีดี เฟอร์เนส จำกัด


**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ: 08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

IC 40 function > Standard operating modes 1 – 12

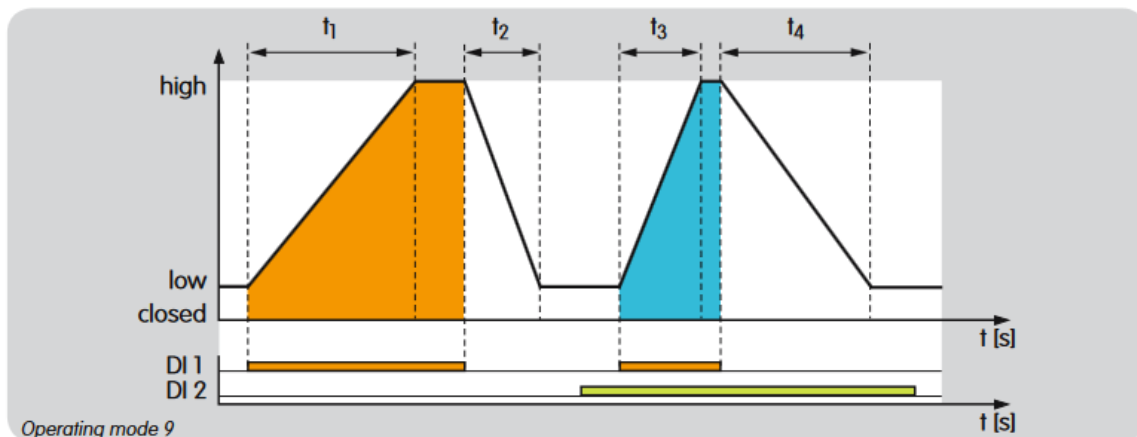

#### 4.5.9 2-point operation with switchover of the running times

Operating mode 9

Digital input DI 1 functions as a pulse input.

The actuator operates in high/low (high/closed) intermittent mode via digital input DI 1. In idle state (DI 1 with no signal), the actuator is in "low" position ("low" position may also be 0° = "closed" position).

DI 1	Position
Off	low/closed
On	high

The running times are switched over via DI 2.


DI 2	Opening time	Closing time
Off	$t_1$	$t_2$
On	$t_3$	$t_4$

Switchover of the running times may also occur during movement of the actuator.

This function can also, for instance, be used for fast movement to the pre-purge position, with correspondingly slow running time for burner operation. Possible parameter set for this operating mode: P 68025, see page 54 (Parameter sets).



IC 40 function > Standard operating modes 1 – 12

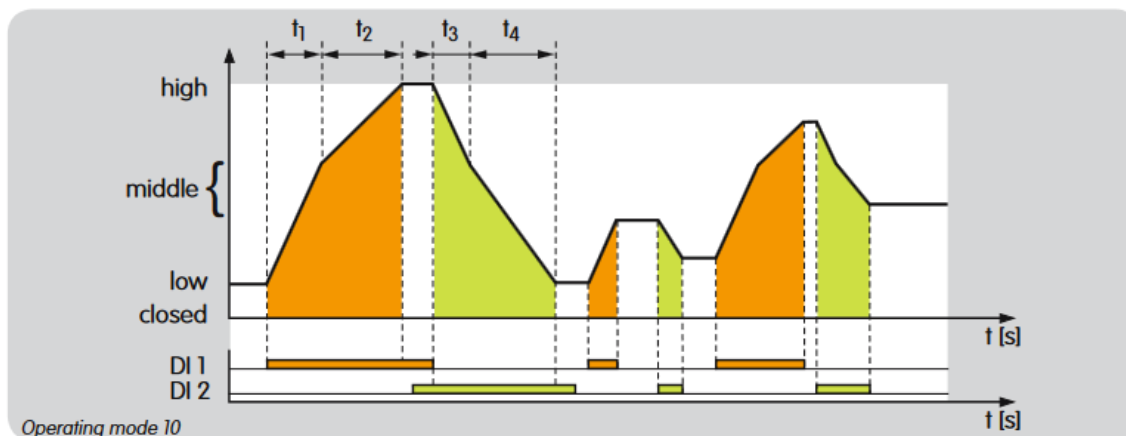

#### 4.5.10 3-point step operation with running time fractions

Operating mode 10

If only digital input DI 1 is active, the actuator opens. If only digital input DI 2 is active, the actuator closes.

If none of the two digital inputs or both digital inputs is or are active simultaneously, the actuator stops in its position.

The actuator can be stopped in any position.


The actuator operates in continuous mode and is controlled via a 3-point step signal.

The actuating function is limited by the "low" and "high" positions ("low" position may also be 0° = "closed" position)

DI 1	DI 2	Reaction
Off	Off	Idle/Stop
ON	Off	Open to "high" position at max.
Off	ON	Close to "low" position ("closed" position) at min.
ON	ON	Idle/Stop



IC 40 function > Standard operating modes 1 – 12 > 3-point step  
operation with running time fractions

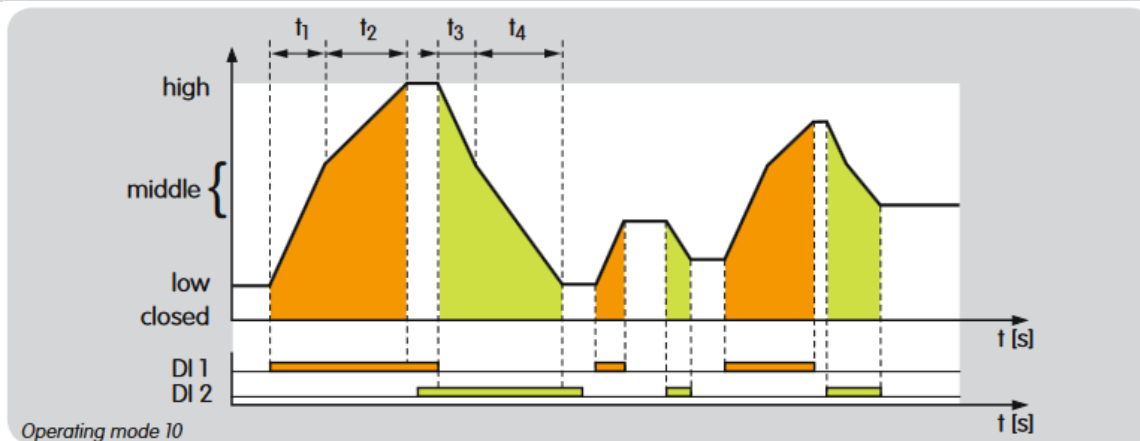

The opening time results from the two successive running times  $t_1$  and  $t_2$ .

The closing time results accordingly from running times  $t_3$  and  $t_4$ . "Middle" position is used as an interpolation point. This can be defined individually.

Owing to the two successive running times, the opening characteristic of the butterfly valve can be changed. For example, the characteristic of the air circuit can be adapted to that of the gas circuit.

Running times up to 51 s ( $2 \times 25.5$  s) are possible in this operating mode.

Possible parameter sets for this operating mode: P 68010, P 68011 and P 68020, see page 54 (Parameter sets).



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**


44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

IC 40 function > Standard operating modes 1 – 12

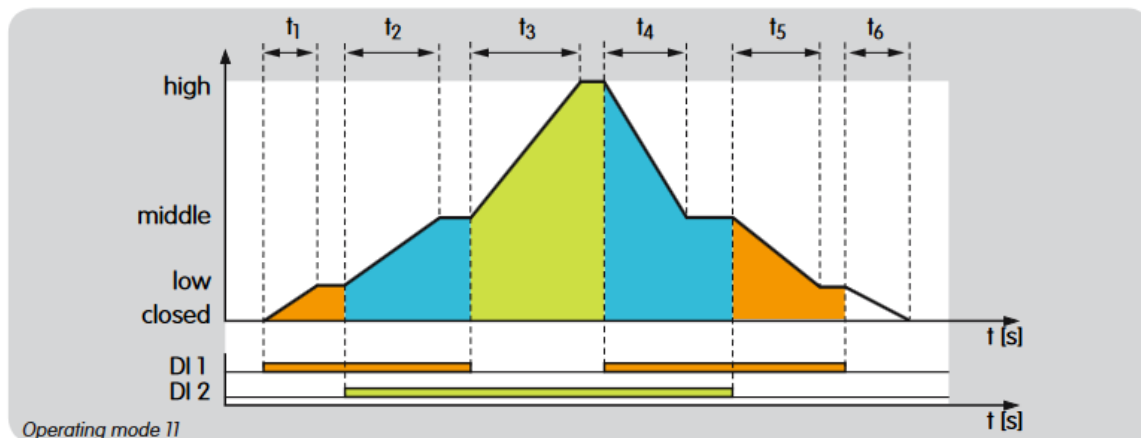

#### 4.5.11 3-step operation with two digital inputs

Operating mode 11

In idle state (DI 1 and DI 2 with no signal), the actuator is in "closed" position and the butterfly valve is closed. If a signal is applied to DI 1 (DI 2 with no signal), the butterfly valve moves to "low" position (ignition position and low-fire rate position). If a signal is applied to DI 2 (DI 1 with no signal), the butterfly valve moves to "high" position for pre-purge.

If a signal is applied to DI 1 and DI 2, the butterfly valve moves to "middle" position (high-fire rate).

DI 1/V1	DI 2/ air valve	Position IC 40	Valve position
Off	Off	closed	Closed
On	Off	low	Igniting position/low-fire rate
On	On	middle	High-fire rate
Off	On	high	Pre-purge

Example of application, see page 11 (IC 40, staged control with pre-purge)



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170


โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

**krom  
schroder**

IC 40 function > Standard operating modes 1 – 12

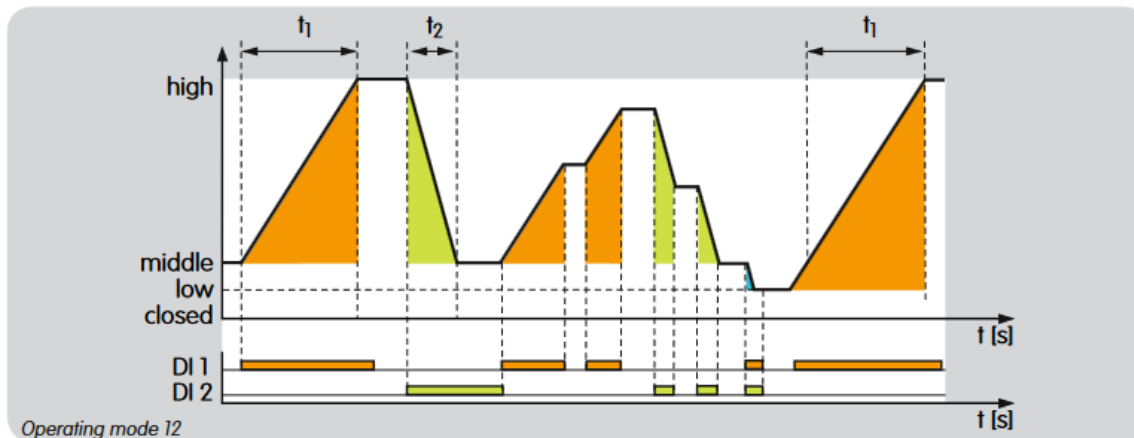

#### 4.5.12 3-point step operation with low position

Operating mode 12

If a three-point step signal is applied to DI 1 (DI 2 with no signal), the butterfly valve moves to “high” position.

If a three-point step signal is applied to DI 2 (DI 1 with no signal), the butterfly valve moves to “middle” position.

If no three-point step signal is applied to the inputs (DI 1 and DI 2 with no signal), the actuator stops and the butterfly valve remains in its current position.

If a three-point step signal is applied to inputs DI 1 and DI 2, the actuator moves from the low-fire rate position to “low” position.

DI 1	DI 2	IC 40 position	Valve position
Off	Off	Idle/Stop	Idle
On	Off	Open to high position	Open to high-fire rate
Off	On	Close to middle position	Close to low-fire rate
On	On	low	Valve closes further

Example of application, see page 10 (IC 40, continuous control by three-point step signal)



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170


โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

IC 40 function

The adjustment angle for the "open" position which can be set to high and closing travel. Accordingly, the closing speed is set to high and closing travel. Accordingly, the closing speed is set to high and closing travel.

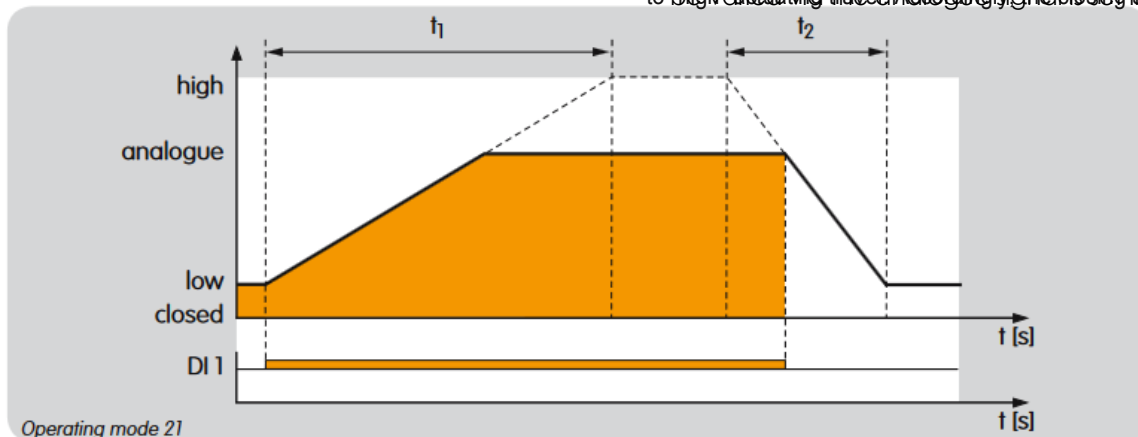

## 4.6 Analogue operating modes 21 – 27

General description, see page 22 (Operating modes).

### 4.6.1 2-point operation

Operating mode 21

In idle state (DI 1 with no signal), the actuator is in "low" position ("low" position may also be 0° = "closed" position).

If a signal is applied to digital input DI 1, the actuator moves to the position pre-set via analogue input 4 – 20 mA. When the signal at DI 1 drops, the actuator moves back to "low" position.

The actuator operates in circuit intermittent mode analogue/low (analogue/closed), whereby the analogue signal determines the adjustment angle for the "open" position (= setpoint).

Example: 4 mA for 60% opening and 20 mA for 100% opening.

If no analogue value is pre-set, the actuator remains in "low" position ("closed" position).

DI 1	Position
Off	low/closed
On	analogue

The opening speed is pre-set via the time  $t_1$  for the entire "low" to "high" actuating travel. Accordingly, the closing speed is set with  $t_2$  for the entire "high" to "low" actuating travel.



บริษัท เอดีดี เฟอร์เนส จำกัด


**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

IC 40 function > Analogue operating modes 21 – 27 > 2-point operation

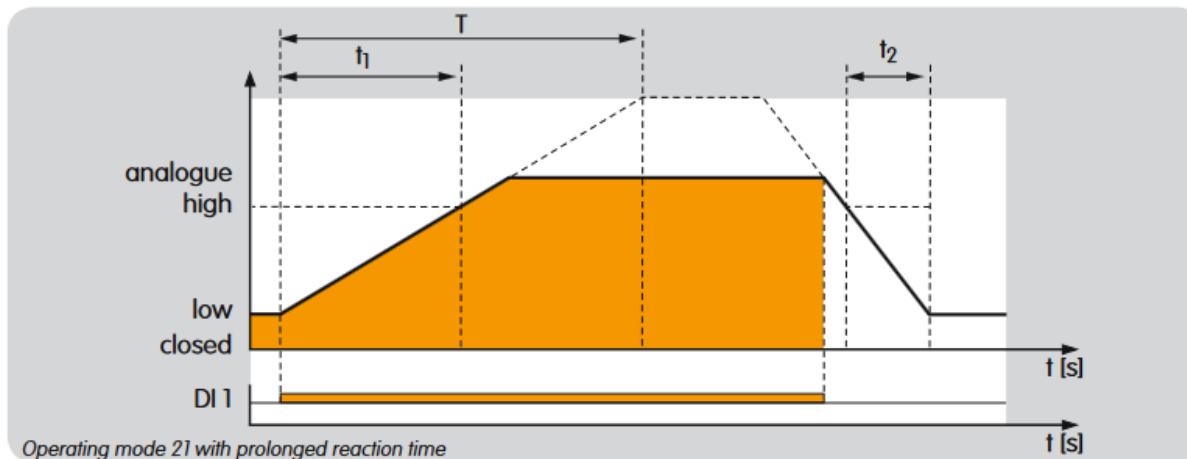

The "high" position can be selected correspondingly lower in order to obtain longer running times (> 25.5 s). The "high" position does not limit the adjustment angle for the "open" position but defines only the speeds here. Consequently, the "high" position may also be lower than the "analogue" position. The magnitude of the current signal is crucial as regards the "analogue" position.

Example for double running time T:

The "high" position is set to 50%.

$$T = t_1 \frac{100\%}{\text{high}}$$

$$T = 25.5 \text{ s} \frac{100\%}{50\%}$$

$$T = 51 \text{ s}$$

Possible parameter set for this operating mode:

P 68026, see page 54 (Parameter sets).Note:

The running time can be prolonged up to max. 150 s for the full adjustment range 0 – 90°. Running times outside of this permitted range are adapted automatically by BCSof®



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**


44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ: 08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

IC 40 function > Analogue operating modes 21 – 27

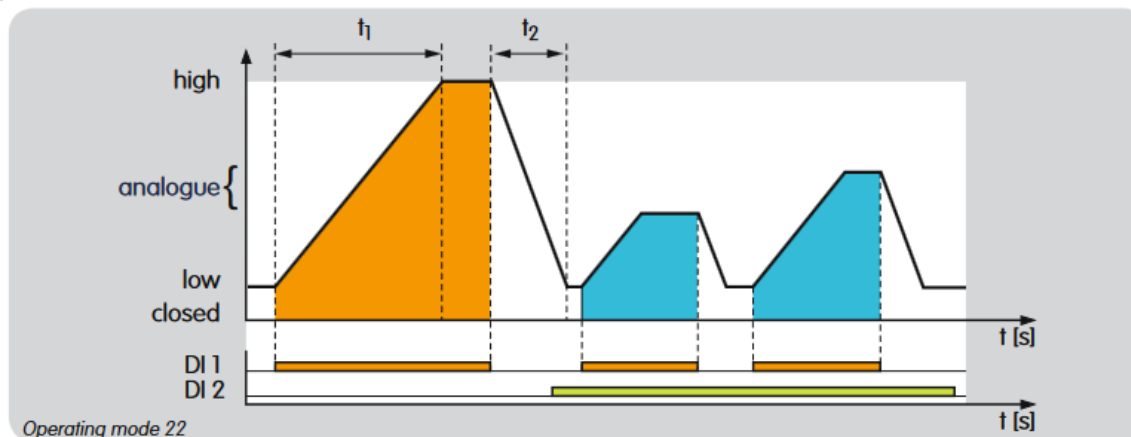

#### 4.6.2 2-point operation with switchover of the adjustment angle for the "open" position

Operating mode 22

In idle state (DI 1 and DI 2 with no signal), the actuator is in "low" position independently of the analogue signal ("low" position may also be 0° = "closed" position).

Signal at DI 1, DI 2 with no signal: The actuator operates in high/low (high/closed) intermittent mode via digital input DI 1. Digital input DI 1 functions as a pulse input.

Signal at DI 2:

Intermittent mode can switch in ongoing operation between high/low (high/closed) and analogue/low (analogue/closed). The adjustment angle for the "open" position is then approached with signal at DI 1 and switched over via DI 2.

The actuator now operates in analogue/low (analogue/closed) intermittent mode via digital input DI 1. The adjustment angle for the "open" position which can be varied via the analogue signal (position setpoint) is set in BCSof®. Example: 4 mA for 60% opening and 20 mA for 100% opening.

Depending on the adjustment angle for the "open" position, the heat output can be reduced and a uniform temperature distribution in the furnace or kiln can be achieved nevertheless owing to intermittent operation of the burner.



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**


44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

IC 40 function > Analogue operating modes 21 – 27

> 2-point operation with switchover of the adjustment angle for the “open” position

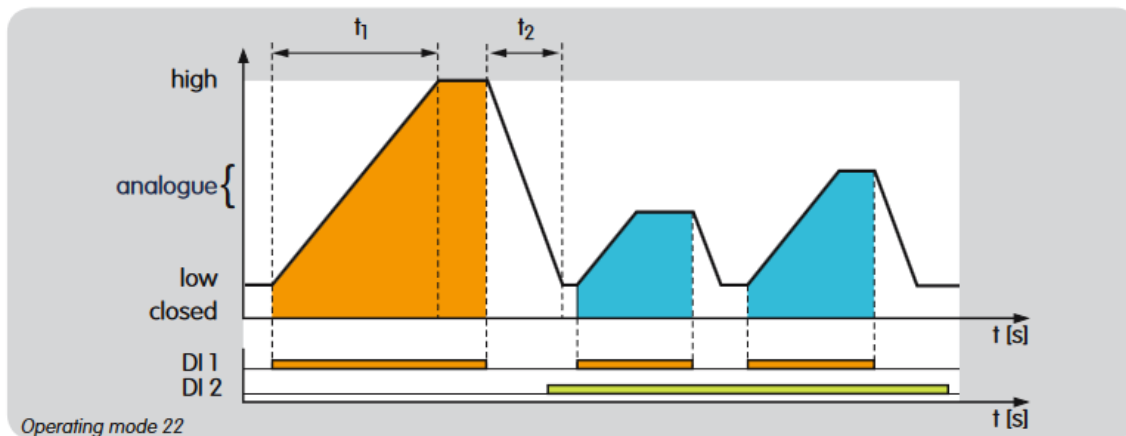

DI 1	DI 2	Position
Off	Off	low/closed
On	Off	high
Off	On	low/closed
On	On	analogue

Possible parameter set for this operating mode:  
P 68027, see page 54 (Parameter sets).


The opening speed is pre-set via the time  $t_1$  for the entire “low” to “high” actuating travel.

Accordingly, the closing speed is set with  $t_2$  for the entire “high” to “low” actuating travel.

The speeds are retained in both intermittent modes. The running times are changed accordingly if the “analogue” position (current signal) is moved. The “analogue” position may also be higher than the “high” position in this operating mode.



## IC 40 function > Analogue operating modes 21 – 27

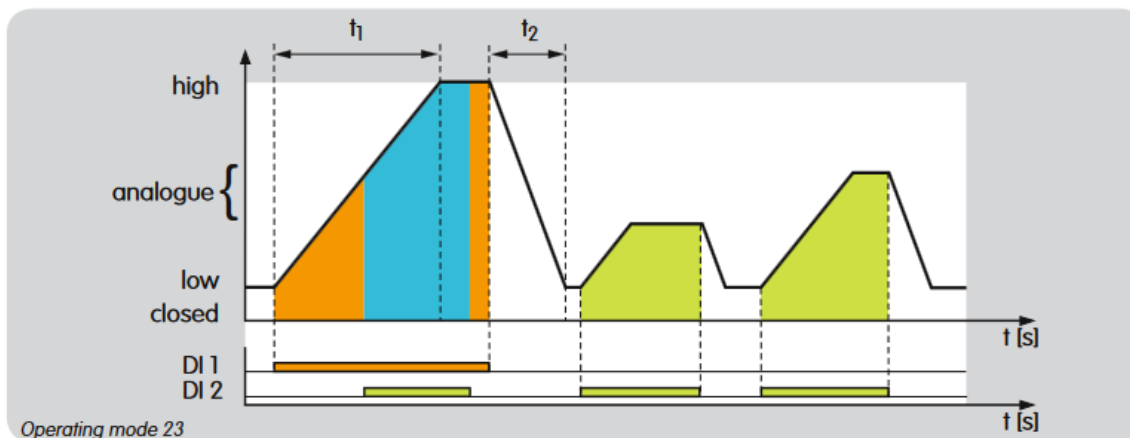

### 4.6.3 2-point operation with input-dependent adjustment angle for the “open” position

Operating mode 23

The function corresponds to operating mode 22 apart from the fact that both digital inputs function as pulse inputs.

The actuator operates in high/low (high/closed) intermittent mode via digital input DI 1.

The actuator operates in analogue/low (analogue/closed) intermittent mode via digital input DI 2. A signal at DI 1 (priority) always leads to approaching “high” position. This application can be used, for instance, for purging a furnace or kiln.

The adjustment angle for the “open” position which can be varied via the analogue signal is set in BCSoff®.

Example: 4 mA for 60% opening and 20 mA for 100% opening.

Depending on the adjustment angle for the “open” position, the heat output can be reduced and a uniform temperature distribution in the furnace or kiln can be achieved nevertheless owing to intermittent operation of the burner.

The “high” position may also be lower than the “analogue” position in this case.

DI 1	DI 2	Position
Off	Off	low/closed
On	Off	high
Off	On	analogue
On	On	high (DI 1 has priority)

Possible parameter set for this operating mode:

P 68028, see page 54 (Parameter sets).



บริษัท เอดีดี เฟอร์เนส จำกัด


**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

## IC 40 function > Analogue operating modes 21 – 27

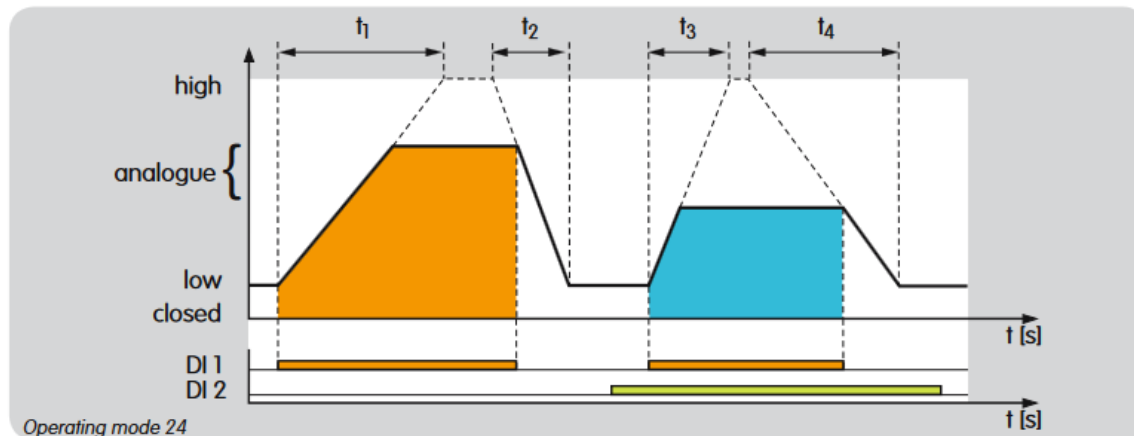

### 4.6.4 2-point operation with switchover of the running times

Operating mode 24

Digital input DI 1 functions as a pulse input. The actuator operates in analogue/low (analogue/closed) intermittent mode via DI 1.

In idle state (DI 1 with no signal), the actuator is in "low" position. ("low" position may also be  $0^\circ$  = "closed" position).

The adjustment angle for the "open" position which can be varied via the analogue signal is set in BCSofT®.

Example: 4 mA for 60% opening and 20 mA for 100% opening.

Depending on adjustment angle for the "open" position, the heat output can be reduced and a uniform temperature distribution in the furnace or kiln can be achieved nevertheless owing to intermittent operation of the burner.

DI 1	Position
Off	low/closed
On	analogue


The running times are switched over via DI 2.

DI 2	Opening time	Closing time
Off	$t_1$	$t_2$
On	$t_3$	$t_4$

The running times can also be switched over in ongoing operation



IC 40 function > Analogue operating modes 21 – 27  
> 2-point operation with switchover of the running times

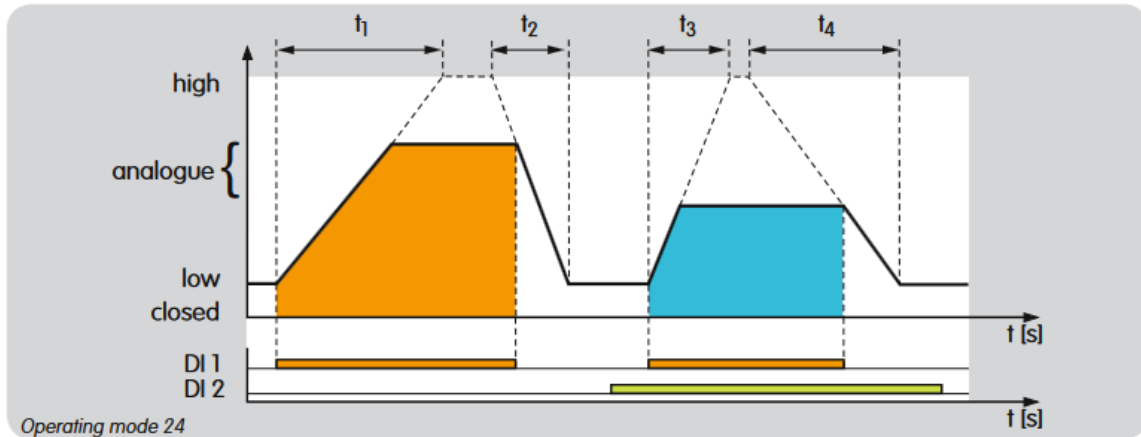

The “high” position can be selected correspondingly lower in order to obtain longer running times (> 25.5 s). The “high” position does not limit the adjustment angle for the “open” position but only defines the speeds.

Consequently, the “high” position may also be lower than the “analogue” position. The magnitude of the current signal is crucial as regards the “analogue” position. Possible parameter set for this operating mode: P 68029, see page 54 (Parameter sets).



บริษัท เอดีดี เฟอร์เนส จำกัด


**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ: 08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

## IC 40 function > Analogue operating modes 21 – 27

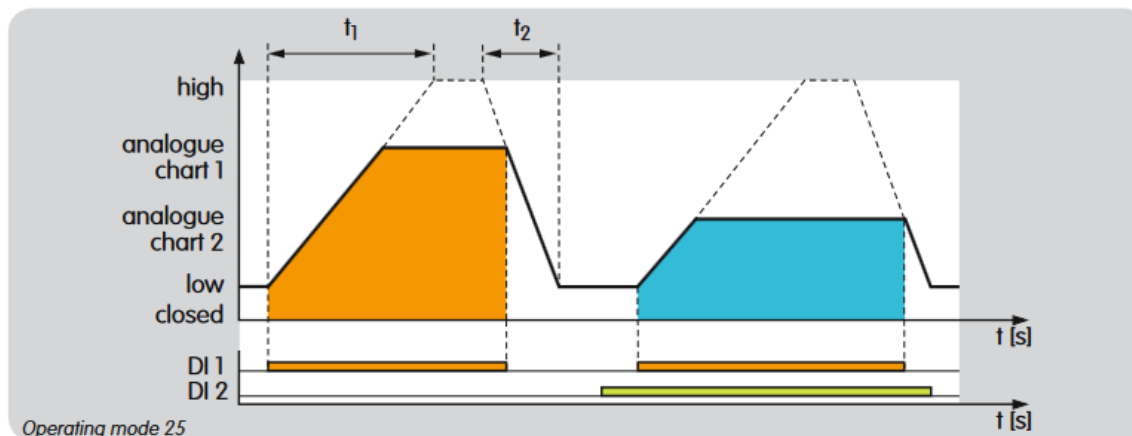

### 4.6.5 2-point operation with characteristic curve switchover I

Operating mode 25 In idle state (DI 1 and DI 2 with no signal), the actuator is in "low" position ("low" position may also be  $0^\circ$  = "closed" position).

DI 1 functions as a pulse input. The analogue characteristic curve (analogue chart 1/analogue chart 2) is switched over via DI 2 and the adjustment angle for the "open" position is pre-set by this. This angle is approached with signal at DI 1.

DI 2 with no signal:

The actuator operates in analogue chart 1/low (analogue chart 1/closed) intermittent mode via digital input DI 1.

Signal at DI 2:

The actuator operates in analogue chart 2/low (analogue chart 2/closed) intermittent mode via digital input DI 1.

This function allows the actuator to switch over its intermittent mode in ongoing operation. The adjustment angle for the "open" position is pre-set via two characteristic curves (charts), each with 5 interpolation points, see page 57 (Inputs). This allows the same current signal to be used for running through two different capacity ranges, for example for lambda adjustment or for hot-air compensation.

The adjustment angles for the "open" position of the characteristic curves chart 1 and chart 2 can be set mutually independently. The adjustment angle for the "open" position of chart 2 may thus also be higher than that of chart 1.



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**


44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

IC 40 function > Analogue operating modes 21 – 27  
>2-point operation with characteristic curve switchover I

**krom  
schroder**

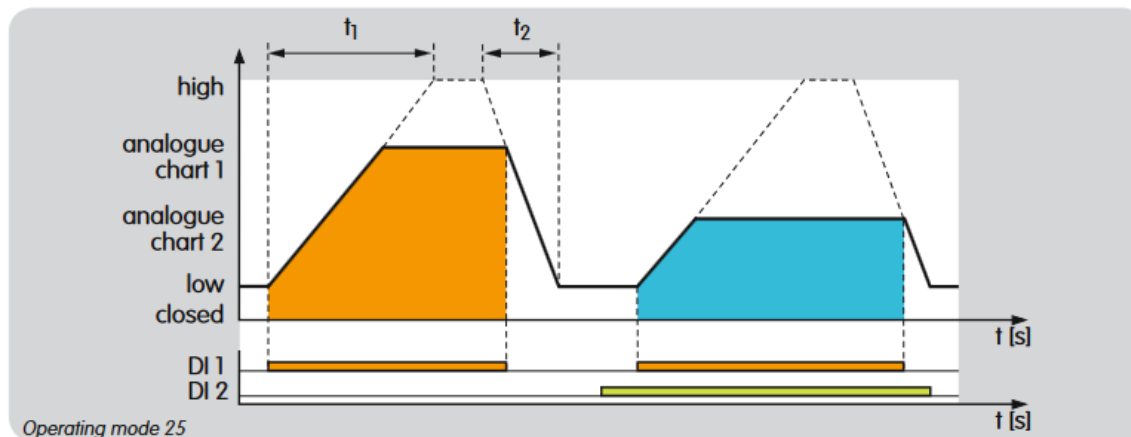

The burner continues to be operated in intermittent mode so as to ensure a uniform temperature distribution even with low heat output.

DI 1	DI 2	Position
Off	Off	low/closed
On	Off	analogue chart 1
Off	On	low/closed
On	On	analogue chart 2

The opening speed is pre-set via the time t1 for the entire "low" to "high" actuating travel.

Accordingly, the closing speed is set with t2 for the entire "high" to "low" actuating travel.

The speeds are retained in both intermittent modes.

The "high" position can be selected correspondingly lower in order to obtain longer running times (> 25.5 s). The "high" position does not limit the adjustment angle for the "open" position but only defines the speeds. The adjustment angles for the "open" position are pre-set by the current signal.

Consequently, "high" position may also be lower than the "analogue chart" positions. If no analogue value is pre-set, the actuator remains in "low" position ("closed" position). Possible parameter set for this operating mode: P 68030, see page 54 (Parameter sets).



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258


<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

IC 40 function > Analogue operating modes 21 – 27

A change in the circuit combination directly triggers the  
approach to the new position.

**krom  
schroder**

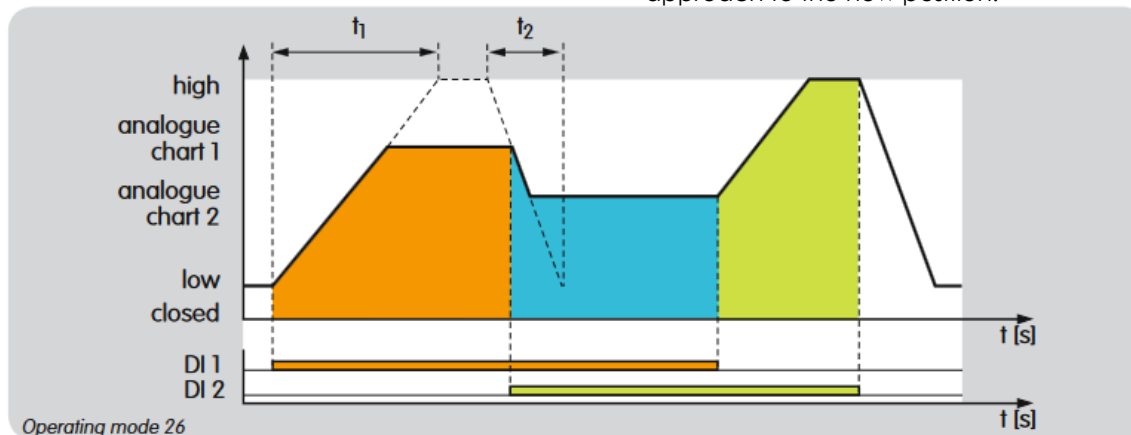

#### 4.6.6 2-point operation with characteristic curve switchover II

Operating mode 26

In idle state (DI 1 with no signal), the actuator is in "low" position ("low" position may also be 0° = "closed" position).

Each circuit combination of DI 1 and DI 2 determines precisely one actuator position:

DI 1	DI 2	Position
Off	Off	low/closed
ON	Off	analogue chart 1
Off	ON	high
ON	ON	analogue chart 2

"High" position may also be lower than the "analogue chart" positions in this case. The opening speed is pre-set via the running time  $t_1$  for the entire "low" to "high" actuating travel. Accordingly, the closing speed is set with  $t_2$  for the entire "high" to "low" actuating travel. The speeds are independent of the digital inputs and the analogue input in this case.

Two characteristic curves, each with 5 interpolation points, are available, see page 57 (Inputs).



บริษัท เอดีดี เฟอร์เนส จำกัด


**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

*IC 40 function > Analogue operating modes 21 – 27  
> 2-point operation with characteristic curve switchover II*

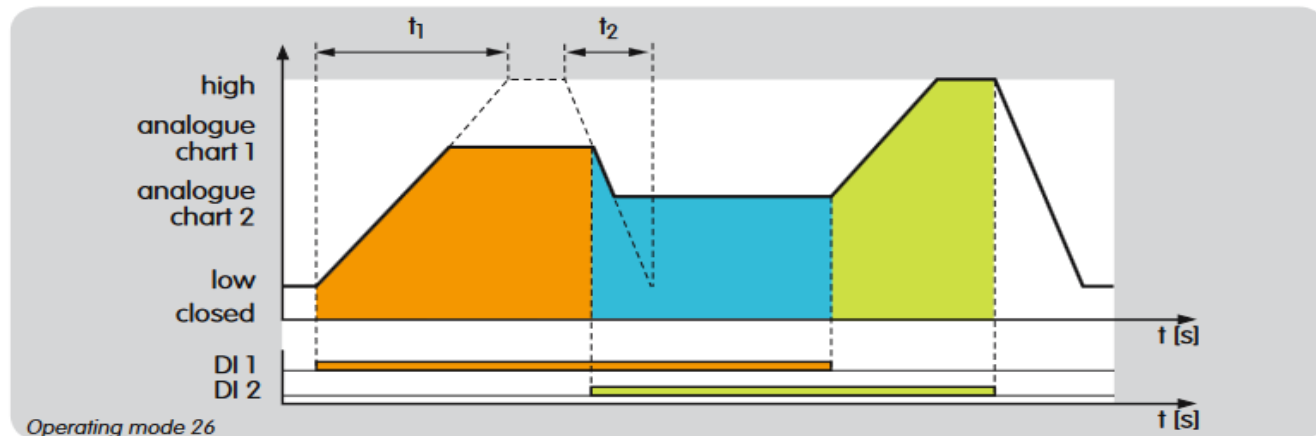

This allows the same current signal to be used for running through two different capacity ranges, for example for lambda adjustment or for hot-air compensation.

### Intermittent operation

DI 2 with no signal:

The actuator operates in analogue chart 1/low (analogue chart 1/closed) intermittent mode via digital input DI 1.

DI 1 with no signal:

The actuator operates in high/low (high/closed) intermittent mode via digital input DI 2.

DI 1 and DI 2 simultaneously with ON or OFF signal:

The actuator operates in analogue chart 2/low (analogue chart 2/closed) intermittent mode.

If all possible combinations of the two inputs are used, for instance by a PLC control system, this allows high/analogue chart 1/analogue chart 2/low (closed) intermittent mode to be implemented.

### Continuous operation

The actuator may also operate in continuous mode via current input 4 – 20 mA. In this case, it is possible to switch over between two characteristic curves via the digital inputs, see page 57 (Inputs).

As with operating mode 25, this allows lambda adjustment or hot-air compensation to be implemented.

Possible parameter set for this operating mode:

P 68031, see page 54 (Parameter sets)



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**


44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

## IC 40 function > Analogue operating modes 21 – 27

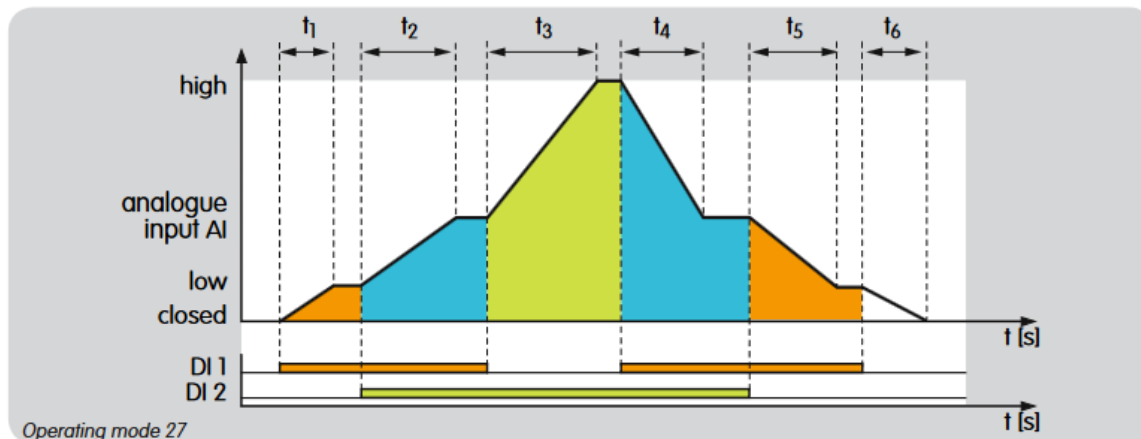

### 4.6.7 2-step operation with two digital inputs and variable adjustment angle

Operating mode 27 In idle state (DI 1 and DI 2 with no signal), the actuator is in “closed” position and the butterfly valve is closed.

If a signal is applied to DI 1 (DI 2 with no signal), the butterfly valve moves to “low” position (ignition position and low-fire rate position).

If a signal is applied to DI 2 (DI 1 with no signal), the butterfly valve moves to “high” position for pre-purge (high-fire rate).

If a signal is applied to DI 1 and DI 2, the butterfly valve can be moved steplessly between the low-fire rate position and the high-fire rate position via the analogue input AI. The adjustment angle for the “open” position which can be varied via the analogue signal is set in BCSoft®.

Example: 4 mA for 60% opening and 20 mA for 100% opening.

DI 1	DI 2	IC 40 position	Valve position
Off	Off	closed	Closed
On	Off	low	Ignition position/low-fire rate
On	On	AI	Any position between ignition position and pre-purge
Off	On	high	Pre-purge/high-fire rate

Example of application, see page 12 (IC 40, continuous control with defined ignition position)



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170


โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

IC 40 function > Analogue operating modes 21 – 27

**krom  
schroder**

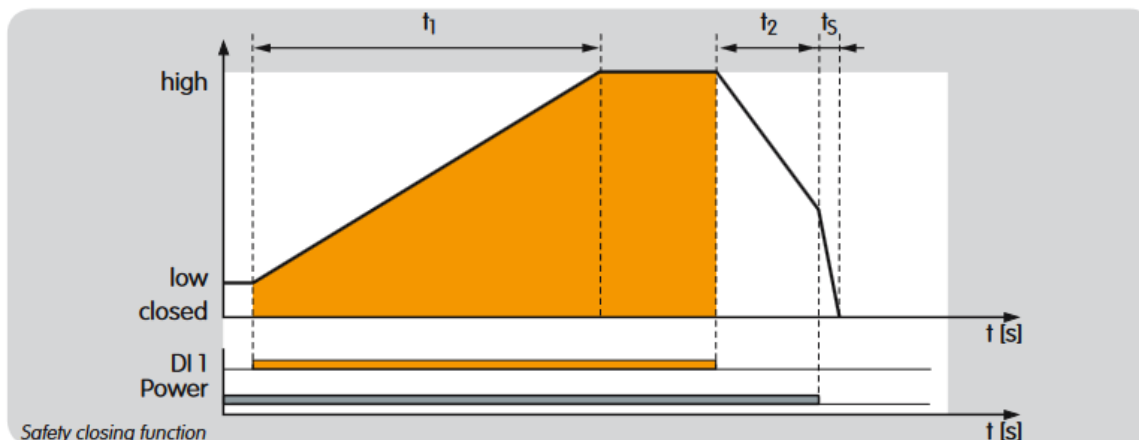

#### 4.6.8 Safety closing function

The safety closing function cuts in in the event of a fault or interruption of the continuous supply voltage (power) or, for instance, in the event of a motor defect.

A pre-tensioned spiral spring turns the drive shaft with valve disc against the mechanical stop of the butterfly valve to the “closed” position within the closing time  $t_S < 1$  s.

Fast and reliable closing prevents air being able to flow into the furnace or kiln chamber in uncontrolled manner if the installation is disconnected from the electrical power supply or in the event of a device defect. The

penetration of air may also lead to damage to the material in the furnace or kiln in extreme cases, besides changing the furnace or kiln atmosphere.

In order to maximize the service life of the parts subject to wear in the actuator and in the butterfly valve, the safety closing function should be used only for the scheduled closing

function and not for controlled shut-down or for intermittent switching of the burner.

The safety closing function is available as an option on the actuator IC 40S and can be implemented only in combination with the butterfly valve BVHS. Both actuator and butterfly valve must feature this function, see page 69 (Selection).



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

#### *IC 40 function*

---

### **4 .7 Parameters**

Various parameter sets are saved in the BCSOft® software to assist programming. Selecting a parameter set pre-selects the corresponding operating mode and assigns practical values to all parameters which can be set. Each parameter can be tailored to the individual requirements of the installation



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

IC 40 function > Parameters

### 4.7.1 Parameter sets

Parameter set	Operating mode	Function
P68001	6	3-step operation with one or two digital inputs, running time: 6 s
P68010	10	3-point step operation with running time fractions, running time: 51 s
P68011	10	3-point step operation with running time fractions, running time: 30 s
P68012	5	3-point step operation, running time: 15 s
P68013	5	3-point step operation, running time: 7.5 s
P68014	5	3-point step operation, running time: 4.5 s
P68015	3	2-step operation with one or two digital inputs, running time: 51 s
P68016	3	2-step operation with one or two digital inputs, running time: 30 s
P68017	1	2-point operation, running time: 15 s
P68018	1	2-point operation, running time: 7.5 s
P68019	1	2-point operation, running time: 4.5 s
P68020	10	3-point step operation with running time fractions, running time: 15 s
P68021	2	2-point operation with flame proving period, running time: 4.5 s
P68022	4	2-step operation with two digital inputs, running time: 5 s
P68023	7	2-point operation with switchover of the adjustment angle for the “open” position, running time: 4.5 s
P68024	8	2-point operation with input-dependent adjustment angle for the “open” position, running time: 4.5 s



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

*IC 40 function > Parameters > Parameter sets*

Parameter set	Operating mode	Function
P68025	9	2-point operation with switchover of the running times, running time: 4.5 s/15 s
P68026	21	2-point operation, running time: 7.5 s
P68027	22	2-point operation with switchover of the adjustment angle for the "open" position, running time: 7.5 s
P68028	23	2-point operation with input-dependent adjustment angle for the "open" position, running time: 7.5 s
P68029	24	2-point operation with switchover of the running times, running time: 4.5 s/ 15 s
P68030	25	2-point operation with characteristic curve switchover I, running time: 7.5 s
P68031	26	2-point operation with characteristic curve switchover II, running time: 7.5 s



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

#### 4.7.2 Factory default parameters

Factory default parameters are data saved permanently in the unit and which can be viewed in BCSoft®. This includes motor data and calibration data.

In addition, information on which parameter set was entered in the condition as delivered is also saved in the factory default parameters, see page 54 (Parameter sets). Certain special functions can be programmed with this, changing the behaviour of the digital inputs, see page 57 (Switching logic).



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

## IC 40 function

### 4.8 Inputs

#### 4.8.1 Digital

In the basic setting, the two digital inputs operate as universal inputs. If a voltage of 24 V DC or 100 – 230 V AC is applied to the input, this is recognized as "On" signal (positive logic).

#### Switching logic

The switching logic can be inverted for each individual digital input. An applied voltage is then recognized as "Off" signal while no voltage results in an "On" signal (negative logic). Inversion of the input switching logic in conjunction with the operating modes provides new options for defining the behaviour of the actuator.

#### 4.8.2 Analogue

The actuator can approach corresponding intermediate positions via a current signal to the additional input. This function can be used only if an actuator IC 40 with 4 – 20 mA analogue input is connected (option). The switch-on and switch-off threshold of the analogue input is defined at approx. 3 mA.

The assignment of current value to position can be freely de-fined via 5 pairs of values (interpolation points). One position which the actuator approaches when the corresponding current signal is applied can be assigned to each of the interpolation points at 4, 8, 12, 16 and 20 mA. The position is interpolated on the basis of a linear function in each case between the interpolation points. In the case of operating modes 25 and 26, 2 characteristic curves, each with 5 interpolation points, can be defined. In this case, the digital inputs define

which characteristic curve currently applies. This allows the same current signal to be used to run through two different capacity ranges, for example for lambda adjustment or for hot-air compensation, see page 47 (2-point operation with characteristic curve switchover

I) and see page 49 (2-point operation with characteristic curve switchover II).

#### Filtering and hysteresis of the current signal

In order to suppress noise of the current signal, the analogue input is sampled equidistantly every millisecond and a mean value is generated over 0.1 s. This filtering can be prolonged up to 1 s in the case of a very poor input signal. However, this also prolongs the response time to a change at the analogue input. The current input (4 – 20 mA) operates internally with a resolution of 10 bit (corresponding to 0.1% of the actuator). This allows the analogue input to detect a change of 0.02 mA (hysteresis). If the input signal fluctuates too greatly (owing to noise for instance), this high resolution results in constant corrections of the actuator and butterfly valve (when mounted onto BVA, BVAF, BVG, BVGF, BVH or BVHS). Consequently, the hysteresis may be increased to up to 0.2 mA. The resolution in this case is reduced down to 1% of the actuator accordingly. The maximum resolution is always set in each case as the basic setting.



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

## IC 40 function > Inputs > Analogue

### Priority and running time in operating modes 1 – 10

In operating modes 1 to 10, the actuator is positioned (0 – 100%) by both digital inputs DI 1 and DI 2. Alternatively, on the IC 40A..A, there is the option of positioning the actuator with a 4 – 20 mA current signal. Simultaneous presets via the analogue input and via the digital inputs necessitate defining a priority in BCSofT®. The digital inputs have priority by default.

Opening speeds and closing speeds between 0 and 25.5 s can be set for analogue mode. The time always relates to the distance between the positions at 4 and 20 mA. If the current signal changes more slowly than the set running time, the actuator follows more slowly accordingly through to step-by-step movement, see page 23 (Running times).



## IC 40 function

### 4.9 Outputs

Various, independent signalling functions can be assigned to the two outputs RO 1 and RO 2: closed position, low position, middle position and high position, fault signals and freely programmable positions.

2 relays with change-over contacts are available for signalling. The contacts are floating and are thus referred to as dry contacts. They can be integrated in automation processes.

For instance, reaching the pre-set position can be signalled back as a signal function. The range in which the output switches can be defined in BCSoft® using the relational operator. The range may be =,  $\geq$  or  $\leq$  of the set position. Thus, for instance, the behaviour of a cam disk can be simulated.

Example for output 1 (RO 1): if the condition is met, the output relay is energized. Terminals 10 and 12 are connected, see page 62 (IC 40 connection diagram).

The switching range can also be set individually via one minimum value and one maximum value. These settings are independent of the selected low position, middle position or high position.

A feedback signal can also be used as a fault signal. In BCSoft®, it is possible to select what status is to lead to setting of the output (relay energized).

Device defective:

An internal fault, such as a fault in the memory chip, leads to failure of the device.

Internal warning (reference switch):

Internal monitoring of the motor position has detected a fault. Recalibrate!

Internal temperature  $> 90^{\circ}\text{C}$ :

Warning! Attach heat deflectors.

Service note:

Number of cycles, changes of direction or relay switching operations greater than limit.

"Fault signals" also covers a "Device in Manual mode"

signal even though the signal is not actually a fault signal.

The precise cause of the signal is displayed in BCSoft® and saved in the statistics, see page 61 (Statistics).

The feedback signal of the IC 40 may not be used on its own for fail-safe signalling of a status or a fail-safe position, see page 70 (Project planning information).



บริษัท เอดีดี เฟอร์เนส จำกัด

ADD FURNACE CO.,LTD.

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

krom  
schroder

IC 40 function

## 4.10 Manual mode

For simplified commissioning, the actuator can be operated “by hand” via the BCSoft® software. Manual mode is activated via BCSoft®.

A distinction is made between two types of Manual-mode: **Direct position preset** and **Simulate inputs**. The related set-ting options are enabled after the required Manual mode is selected.

The exterior, applied input signals have no effect on the control element in both Manual operating modes. Instead, the device responds to the presets from the software.

Fast blinking of the blue LED indicates that the actuator is in Manual mode.

Only one Manual mode may be activated at any one time. If the Manual mode is to be changed, the existing Manual mode must first be deactivated before the other Manual mode can be activated.

### 4.10.1 Direct position preset

This Manual mode serves to determine the operating positions for the process, such as the low-fire rate (low) position, the ignition (middle position) and the high-fire rate (high) position.

For this purpose, the actuator can be moved to any position, regardless of the input signal. The position can be entered or changed directly in BCSoft®. The resolution is defined in ranges fine/medium/coarse, whereby “fine” allows any step of the step motor (< 0.05%). After transfer of the values from BCSoft® to the actuator, the actuator responds accordingly to the new presets. The new position is always approached at maximum speed in this case.

The operating position determined can be assigned in BCSoft® to a position, for example ignition position.

### 4.10.2 Simulate inputs

When this Manual mode is activated, the external inputs are deactivated. Instead, the signals of the two digital inputs can be pre-set “manually”. If the actuator has a 4 – 20 mA analogue input (option), this can also be simulated.

Switching the inputs allows the behaviour of the actuator to be tested. This allows the set running times to be checked and optimized in BCSoft®.



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

IC 40 function

## 4.11 Statistics

The statistical data stored in the unit, such as fault signals which have occurred, various counter readings and measured values, is displayed in statistics in BCSoft®.

The **counters** and **measured values** ranges are each split into overall data and customer data. The customer data is used for recording information over a specific period.

### 4.11.1 Counters

Actuating cycles (0–100–0%), changes of direction (Open/ Closed), switching of the output relays, "Power On" switching operations and mains operating hours are added in the statistics. Besides the total counters, there are customer counters for recording information over a specific period.

### 4.11.2 Measured values

The minimum and maximum internal housing temperatures are saved in statistics. In addition, the current internal temperature is displayed. Here as well, there is a customer memory for viewing a period.

## 4.11.3 Resetting statistics

All signals and customer data can be reset. The reset date is saved automatically and displayed together with the customer data.

Counters and measured values cannot be reset or deleted.

### 4.11.4 Resetting a signal

A fault signal is signalled by the red LED on the actuator. The detailed cause of the signal is displayed in BCSoft®. The cause must be remedied. The signal can then be acknowledged and reset with BCSoft®.



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**


44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom**  
**schröder**

IC 40 function

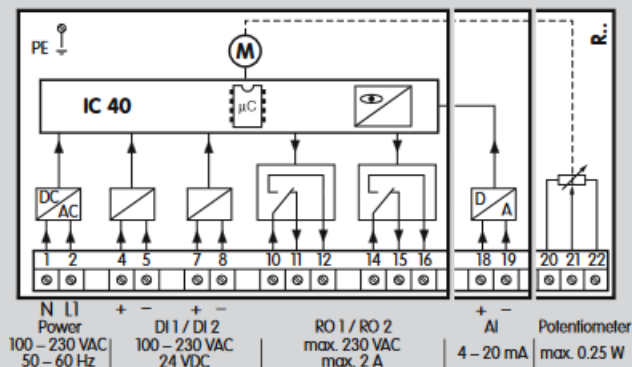

#### 4.12 IC 40 connection diagram

See page 70 (Project planning information).

See page 76 (Technical data).



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

IC 40 function

## 4.13 Display

### 4.13.1 During operation

Blue LED	Red LED	Operating state
Moderately flashing**	Off	Zero position
Slow flashing***	Slow flashing***	Calibration
On	Off	Device in Standby mode
Moderately flashing**	Off	Device in motion
Fast flashing	Off	Manual mode
Fast flashing	Off	Moving in Manual mode
Permanent light	see Fault signal	Fault

\* Fast: 5 times per second, \*\* moderately: 3 times per second, \*\*\* slow: once per second

### 4.13.2 Warnings and faults

Blue LED	Red LED	BCSoft® fault code	Warning/fault	Description	Cause
According to operating state	Flashing light (1×)	1	Warning	Internal temperature > 90°C	- High ambient temperature
According to operating state	Flashing light (2×)	4	Warning	Reference switch drift > 5%	- Mechanical valve offset - Valve moving against its stop
According to operating state	Flashing light (3×)	7	Warning	Reference switch drift > 10%	- Mechanical valve offset - Valve moving against its stop
According to operating state	Flashing light (4×)	8	Warning	Reference switch does not open	- Valve blocked - Large mechanical offset - Internal fault - Actuator offset
According to operating state	Flashing light (5×)	9	Warning	Reference switch does not close	- Valve blocked - Internal fault - Actuator offset, mechanical offset
According to operating state	Flashing light (6×)	10	Warning	Analogue input AI < 4 mA	- Signal interrupted - Signal not connected - Input defective



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

IC 40 function > Display > Warnings and faults

Blue LED	Red LED	BCSoft fault code	Warning/fault	Description	Cause
According to operating state	Flashing light (7×)	21	Warning	Service note: number of OPEN/CLOSE cycles > limit value	
According to operating state	Flashing light (8×)	22	Warning	Service note: number of changes of direction > limit value	
According to operating state	Flashing light (9×)	23	Warning	Service note: number of relay output RO 1 or RO 2 switching operations > limit value	
Flashing light (1×)	Permanent light	5	Fault	Internal fault	- e.g. EEPROM reading or writing error
Flashing light (2×)	Permanent light	11	Fault	Zero position: reference switch does not close	- Valve blocked - Internal fault - Actuator offset- Valve not closed (BVHS)
Flashing light (3×)	Permanent light	12	Fault	Zero position: reference switch does not open	- Valve blocked - Internal fault - Actuator offset
Flashing light (4×)	Permanent light	13	Fault	Zero position: reference switch opens too early (BVHS)	- Spring defective/not strong enough - Valve not closed tightly - Cam maladjusted
Flashing light (5×)	Permanent light	14	Fault	Zero position: reference switch opens too late (BVHS)	- Motor or gear defective - Cam maladjusted
Flashing light (6×)	Permanent light	30	Fault	Saving error for adjustable param- eters, etc.	
Flashing light (7×)	Permanent light	31	Fault	Saving error: factory default param- eters	
Flashing light (8×)	Perma-nent light	32	Fault	Saving error: user calibration	
Flashing light (9×)	Perma-nent light	33	Fault	Saving error: analogue parameters	



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

## IC 40 function

### 4.14 Relay outputs RO 1 and RO 2 function

The function of digital outputs RO 1 and RO 2 can be adjusted using BCSofT®.

Signal at RO 1 or RO 2	Further setting options	Remarks
CLOSED position	equal to =	
Low-fire rate position (low)	greater than or equal to > =	
Intermediate position (middle)	equal to or less than < =	
OPEN position (high)		
Freely programmable position	Minimum and maximum value [°, %]	Relay switches when valve between min. and max. position
Faults and warnings	Reference switch drift > 5%* Reference switch drift > 10%* Reference switch does not open* Reference switch does not close* Internal temperature > 90°C Analogue input AI < 4 mA Service note	Faults are always signalled, warnings are signalled depending on the selection in BCSofT® (see Inputs/Outputs, Display of warnings)
Fault		Only faults are displayed
Manual mode		Device is in Manual mode
Ready		Relay drops out in the event of: faults (not in the event of warnings), Manual-mode, zero position, calibration, no mains voltage
None		Relay output has no function

\* These warnings are displayed as positioning errors in BCSofT®



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

## 5 Replacement possibilities for actuators

### 5.1 GT 31 is to be replaced with IC 20



GT 31	Actuator	Actuator	IC 20
03			
07			07
15	Running time [s/90°]	Running time [s/90°]	15
30			30
60			60
H	Mains voltage: 24 V AC	Mains voltage: –	–
M	120 V AC	120 V AC, -15/+10%	Q
T	220/240 V AC	230 V AC, -15/+10%	W
1	Torque 1.2 Nm	–	–
2	Torque 2.5 Nm	Torque 2.5 Nm*	2
3	Torque 3.0 Nm	Torque 3.0 Nm*	3
●	Three-point step control	Three-point step control	●
R	Two-point control	Two-point control	E
E	Continuous control	Continuous control	E
G	Additional switches with gold contacts	–	–
○1)	1000 Ω feedback potentiometer	1000 Ω feedback potentiometer	R10
GT 31-30T3	Example	Example	IC 20-30W3

● standard, ○ available

1) See separate type label on the device

2) C 20-07: 2.5 Nm, IC 20-15/-30/-60: 3.0 Nm.



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

https://www.add-furnace.com E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

## Replacement possibilities for actuators

### 5.2 GT 31 is to be replaced with IC 40

GT 31	Actuator	Actuator	IC 40
03			
07			
15	Running time [s/90°]	Running time: 4.5 – 76.5 [s/90°] <sup>3)</sup>	●
30			
60			
H	Mains voltage: 24 V AC		
M	120 V AC	Mains voltage <sup>4)</sup> : 100 – 230 V AC, ±10%	A
T	220/240 V AC		
1	Torque: 1.2 Nm	–	–
2	Torque: 2.5 Nm	Torque 2.5: Nm <sup>2)</sup>	2
3	Torque: 3.0 Nm	Torque 3.0: Nm <sup>2)</sup>	3
●	Three-point step control	Three-point step control <sup>3)</sup>	D
R	Two-point control	Two-point control <sup>3)</sup>	D
E	Continuous control	4 – 20 mA analogue input	A
G	Additional switches with gold contacts	–	–
P	1000 Ω feedback potentiometer	1000 Ω feedback potentiometer	R10
GT 31-07T2E	Example	Example	IC 40A2A

with parameter set P 68013<sup>3)</sup>

●standard, ○available

<sup>1)</sup> See separate type label on the device

<sup>2)</sup> IC 40: 2.5 Nm, IC 40S: 3.0 Nm.

<sup>3)</sup> Various parameter sets can be pre-set ex-works.

<sup>4)</sup> Supply the IC 40 permanently with voltage.



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

*Replacement possibilities for actuators*

### 5.3 M5/M6 is to be replaced with IC 40

M	Solenoid actuator	Actuator	IC 40
●	Closed when de-energized	Safety closing function	S
5	Actuator size 5 for DN 40 – 8	–	–
6	Actuator size 6 for DN 100	–	–
R	Slow opening, slow closing	Running time: 4.5 – 76.5 [s/90°]	●
L	Slow opening, quick closing		
N	Quick opening, quick closing		
T	Mains voltage: 220/240 V AC	Mains voltage2): 100 – 230 V AC, ±10	A
	110 V AC	100 – 230 V AC, ±10	A
	24 V DC	–	–
●	Two-point contro	Two-point control1)	●
3	Terminal connection box, IP 54	IP 65	●
6	... Standard plug	–	–
M 6RT3	Example	Example	IC 40SA

with parameter set P 680191)

● standard, ○ available

1) Various parameter sets can be pre-set ex-works.

2) Supply the IC 40 permanently with voltage.



บริษัท เอดีดี เฟอ์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

## 6 Selection

### 6.1 IC 20, IC 40

	S <sup>2)</sup>	-07	-15	-30	-60	W	Q	A	2 <sup>3)</sup>	3 <sup>3)</sup>	E <sup>3)</sup>	T <sup>3)</sup>	A <sup>4)</sup>	D <sup>4)</sup>	R10 <sup>5)</sup>
IC 20	●	●	●	●	●	●	●		●	●	○	●			○
IC 40 <sup>1)</sup>	○							●	●	●				○	●

1) Please quote the required parameter set in your order.

Running time programmable between 4.5 and 76.5 s.

2) Only in conjunction with butterfly valve BVHS. If "none", this specification is omitted.

3) IC 20-07: 2.5 Nm, IC 20-15/-30/-60: 3.0 Nm, IC 40: 2.5 Nm, IC 40..S: 3.0 Nm.

4) If "none", this specification is omitted.

5) Can be retrofitted on IC 20. If "none", this specification is omitted.

● = standard, ○ = available

#### Example

IC 40A

### 6.1.1 Type code

Code	Description
IC 20	Actuator for basic applications
IC 40	Actuator for complex applications
S	Safety closing function
	Running time in s/90°:
-07	7.5
-15	15
-30	30
-60	60
	Mains voltage (50/60 Hz)
W	230 V AC, -15/+10%
Q	120 V AC, -15/+10%
A	100 – 230 V AC, ± 10%
	Torque:
2	2.5 Nm
3	3 Nm
E	Continuous control
T	Three-point step control
A	4 – 20 mA analogue input and digital inputs
D	Digital inputs
R10	Feedback potentiometer



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

## 7 Project planning information

### 7.1 Electrical connection

#### 7.1.1 Cable selection

Install supply and signal lines separately.

Cables should be installed well away from high-voltage lines

of other devices.

Observe EMC Directive for installation of signal lines.

#### 7.1.2 IC 20

When operating two or more actuators in parallel, they must

be electrically isolated to avoid leakage currents.

#### 7.1.3 IC 20..E

Position feedback at terminals 15 and 16:

Any interference suppression capacitors installed in the system

must only be used in conjunction with a series resistor so

as not to exceed the -maximum switch-on current, see page

76 (Technical data).

#### 7.1.4 IC 40

##### Digital inputs

The digital inputs require a current of  $3 \text{ mA} \pm 1.5 \text{ mA}$ . To avoid

interference, it may be necessary to increase the output current


by using an additional load resistor on the signal sensor.

Load resistors may not be fitted inside the IC 40 for reasons

relating to heat dissipation.

Example for 24 V DC and 10 mA:

Load resistor =  $3.3 \text{ k}\Omega$ , 0.6 W.

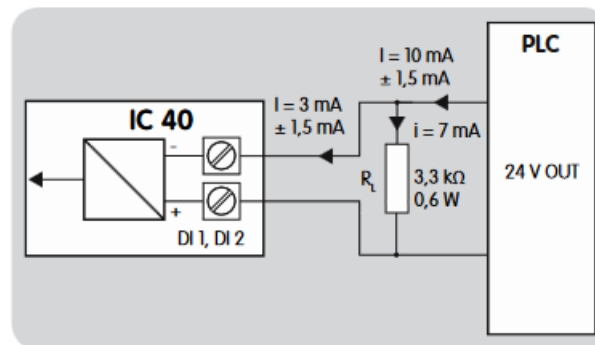



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

Project planning information > Electrical connection > IC 40

## Feedback signalling


The feedback signal function (relay contact) possible with the outputs may not be used on its own for fail-safe signalling of the status or of the position.

Please refer to the relevant Directives and Standards as to

whether and when a fail-safe signal is required.


As defined in European Standard EN 746-2 for instance, gating of two non-fail-safe sensors (signals) must be considered as a fail-safe equivalent array if the two sensors detect different physical variables.

Example 1:

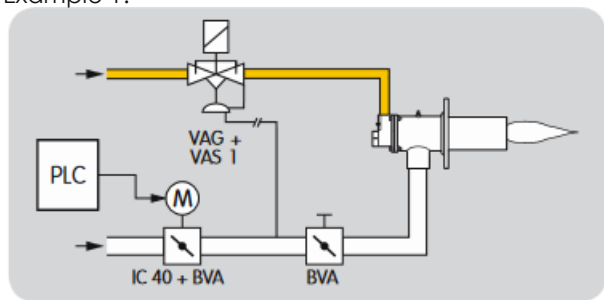

A fail-safe equivalent array for the ignition position of the butterfly valve for air may be series connection of a pressure switch signal with the feedback signal of the IC 40. In this application, the pressure switch monitors the maximum permitted air pressure so as to restrict the maximum permitted start fuel flow rate using the air/gas ratio control GIK.

Example 2:

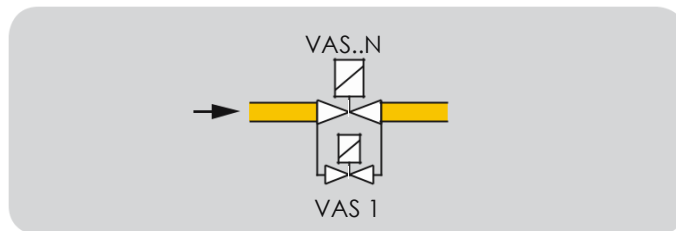

One other option of fail-safe limitation of the start fuel flow rate is utilization of a bypass in the gas circuit. A bypass valve can limit the amount of gas in fail-safe manner owing to its nominal cross-section. The maximum possible gas pressure must be allowed for when selecting the nominal cross-section.

At all events, the plant operator is responsible for assessing installation safety. Elster Kromschroder can, in this case, only provide its own estimates and resultant recommendations which do not reflect the individual situation of the particular installation.



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**



44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

## Project planning information

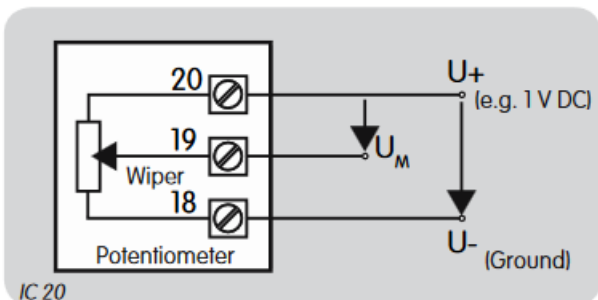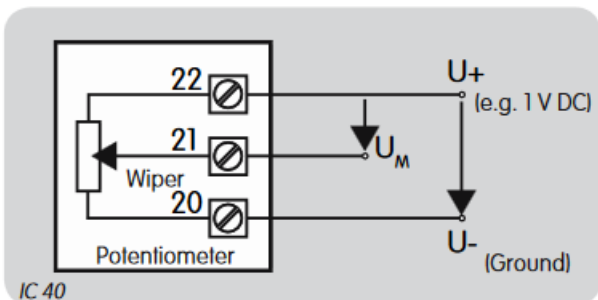

## 7.2 Feedback potentiometer

The feedback potentiometer offers the option of monitoring the current position of the actuator.

It must be utilized as a voltage divider. The change in position of the potentiometer wiper (which corresponds to the actuator position) can be measured as a changing voltage between  $U_+$  and  $U_M$ .

Other circuit layouts produce measurement results that are inaccurate and do not remain stable over a long period of time or are non-reproducible. They also reduce the service life of the feedback potentiometer.

The feedback potentiometer can be retrofitted on actuator IC 20, see page 74 (Accessories). On the IC 20..E, a 4 – 20 mA continuous signal is used for position feedback.

IC 40 cannot be retrofitted with a potentiometer. As an option, the actuator is available with fitted potentiometer.



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

## Project planning information

### 7.3 Installation

Installation position of actuators IC 20, IC 40:  
vertical or horizontal, not upside down.

If the actuator is used with hot air, the pipeline should be adequately insulated so as to reduce the ambient temperature. **Important!** In order to avoid over-heating, the flanges and butterfly valve must not be insulated.

In conjunction with butterfly valves BVH, BVHS, the actuator can be used in temperatures of up to 250°C, with additional heat deflectors it can be used in temperatures of up to 450°C, see page 74 (Accessories). In order to mount the actuator onto control elements other than DKL, DKG, BVA, BVAF, BVG, BVGF, BVH, BVHS or VFC, the attachment set for "single application" is required, see page 74 (Accessories).

### 7.4 IC 40 commissioning

When mains power is connected, the actuator IC 40 conducts a zero position check. To do this, the actuator opens the control element to approx. 30°. Then the actuator moves to the position specified by the operating mode and input signals.



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**


44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258


<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

## 8 Accessories

### 8.1 IC 20, IC 40 Heat deflectors

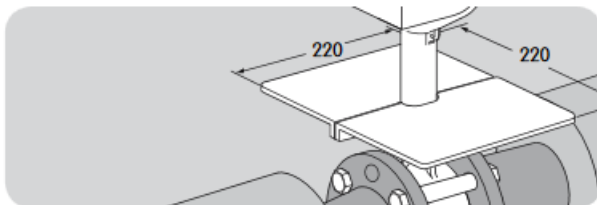


In conjunction with butterfly valves BVH, BVHS for hot air, the actuator can be used in temperatures of up to 250°C, with additional heat deflectors it can be used in temperatures of up to 450°C.

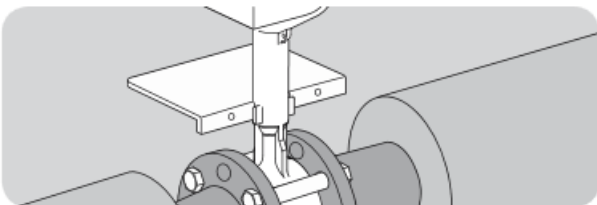


Order number: 74921670 If you are using an insulated pipeline, ensure that there is sufficient installation space to access the heat deflectors and the screw connectors near the valve

### 8.2 Adapter set for mounting an actuator IC 20, IC 40 onto a butterfly valve DKL, DKG

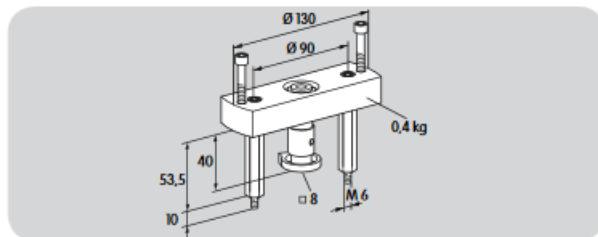

Order number: 74921672

### 8.3 IC 20, IC 40 "single application" attachment set

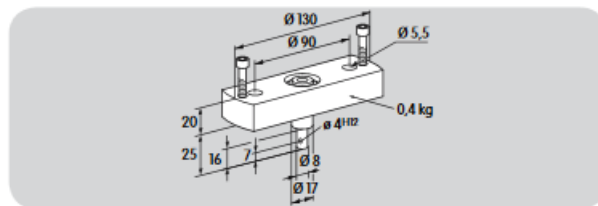

Order number: 74921671

This attachment set is required if the actuator is mounted onto control elements other than DKL, DKG, BVA, BVAF, BVG, BVGF, BVH, BVHS or VFC.



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170


โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

## Accessories

### 8.4 IC 20 potentiometer installation set

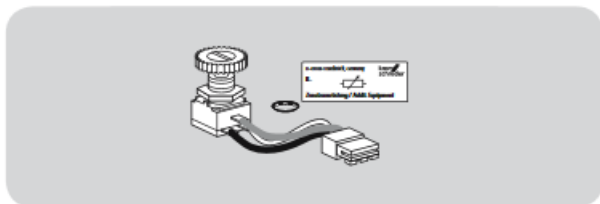

1000  $\Omega$  feedback potentiometer.  
The power consumption of the potentiometer is max. 0.5 W.  
Order number: 74921144

### 8.5 BCSof<sup>®</sup>

The current software can be downloaded from our Internet site at <http://www.docuthek.com>. To do so, you need to register in the DOCUTHEK.

### 8.5.1 Opto-adapter PCO 200



BCSoft<sup>®</sup> CD-ROM included,  
Order No.: 74960625.

### 8.5.2 Bluetooth adapter PCO 300



BCSoft<sup>®</sup> CD-ROM included,  
Order No.: 74960617.



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ: 08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

## 9 Technical data

### 9.1 IC 20, IC 20..E

Mains voltage:

120 V AC, -15/+10%, 50/60 Hz,

230 V AC, -15/+10%, 50/60 Hz.

Screw terminals using the elevator principles for cables up to 4 mm<sup>2</sup> (single core cables) and for cables up to 2.5 mm<sup>2</sup> with wire end ferrules.

Angle of rotation: 0 – 90°, adjustable.

Holding torque = torque.

Control by three-point step signal to terminals 1 and 2:

minimum pulse duration: 100 ms,

minimum pause between 2 pulses: 100 ms.

Switching capacity of the position switches:

Voltage	Resistive load	Incandescent lamp load	Inductive load
125 V AC	2 A	0.5 A	2 A
250 V AC	2 A	0.5 A	2 A
< 30 V DC	2 A	2 A	2 A
< 50 V DC	1 A	0.4 A	1 A
< 75 V DC	0.75 A	0.3 A	0.75 A
< 125 V DC	0.5 A	0.2 A	0.03 A
< 250 V DC	0.25 A	0.1 A	0.03 A
12–30 V AC/DC	10–100 mA	–	10–100 mA

Enclosure: IP 65 pursuant to IEC 529.

Safety class: I pursuant to EN 60335.

Line entrance for electrical connection:

3 × M20 plastic cable glands.

Ambient temperature: -20 to +60°C, no condensation permitted.

### 9.1.1 IC 20

Power consumption:

4.9 VA at 50 Hz, 5.8 VA at 60 Hz.

### 9.1.2 IC 20..E

Power consumption:

terminals 1, 2 and 5:

4.9 VA at 50 Hz, 5.8 VA at 60 Hz,

terminal 3:

8.4 VA at 50 Hz, 9.5 VA at 60 Hz,

in total not exceeding:

8.4 VA at 50 Hz, 9.5 VA at 60 Hz.

Position feedback output:

4–20 mA, electrically isolated, max. 500 Ω load impedance.

The output is always active when supply voltage is applied to terminals 3 and 4.

Input:

electrically isolated,

0 (4) – 20 mA: load impedance switchable between 50 Ω and 250 Ω,

0–10 V: 100 kΩ input resistance.



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ: 08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

## Technical data

### 9.2 IC 40

Mains voltage:

IC 40: 100–230 V AC,  $\pm 10\%$ , 50/60 Hz; the actuator auto-matically adjusts to the respective mains voltage.

Power consumption: 8.4 W,

switch-on peak current: max. 8 A for max. 10 ms.

Screw terminals using the elevator principles for cables up to 4 mm<sup>2</sup> (single core cables) and for cables up to 2.5 mm<sup>2</sup> with wire end ferrules.

Angle of rotation: 0–90°.

Holding torque = torque as long as permanent supply volt-age is applied.

2 digital inputs:

IC 40: 24 V DC or 100–230 V AC each.

Current requirement of digital inputs: 3 mA  $\pm$  1.5 mA.

1 analogue input (optional): 4–20 mA (internal load im-ped-

ance: max. 500  $\Omega$  at 20 mA).

Potentiometer (optional):

1000  $\Omega$   $\pm$  20%,

linearity tolerance  $\pm$  2%,

max. capacity 0.25 W,

conductive plastic element.

Important: tap wiper at high resistance, see page

70 (Project planning information)

2 digital outputs:

Signalling contacts designed as relay change-over contacts. Contact current of digital outputs: min. 5 mA (resistive) and max. 2 A.

The relay contacts can be connected to 100–230 V AC or

24 V DC. If the contacts have been connected with a volt-age > 24 V and a current > 0.1 A once, the gold plating on

the contacts will have been burnt through. This contact can then only be connected with this power rating or higher power rating.

2 LED status displays:

- Blue LED for operation “ON”;  
drive in motion = slow flashing light;  
manual operation = fast flashing  
light; drive stopped = permanent  
light.
- Red LED for warnings and  
faults; warning = permanent  
light; fault = flashing light.
- Red and blue LED simultaneously,  
calibration in progress = flashing  
light.

Enclosure: IP 65 pursuant to IEC 529.

Safety class: I pursuant to EN 60335.

Line entrance for electrical connection:

3  $\times$  M20 plastic cable glands.

Ambient temperature: -20 to +60°C, no condensation per-mitted.



บริษัท เอดีดี เฟอ์เรนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom**  
**schroder**

## Technical data

### 9.3 Running times and torques

Type	Running time [s/90°]		Torque [Nm]	
	50 Hz	60 Hz	50 Hz	60 Hz
IC 20-07	7.5	6.25	2.5	2
IC 20-15	15	12.5	3	3
IC 20-30	30	25	3	3
IC 20-60	60	50	3	3
IC 40	4.5–76.5	4.5–76.5	2.5	2.5
IC 40S	4.5–76.5	4.5–76.5	3	3

IC 20:

The running time per 90° depends on the required torque.

The running time is reduced by a factor of 0.83 at 60 Hz.

IC 40:

On the IC 40, the running time and torque are independent of the mains frequency. The running time can be freely programmed between the limits of 4.5–76.5 s.



บริษัท เอดีดี เฟอร์เนส จำกัด


**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

## Technical data

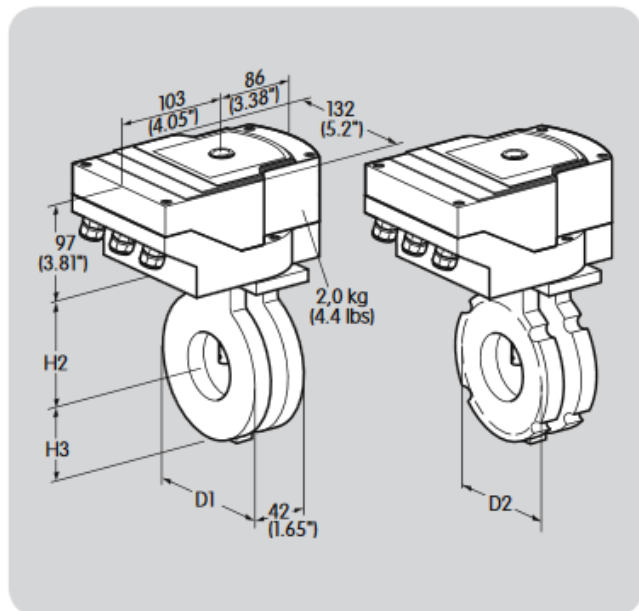

## 9.4 Dimensions of IBG/IBA (BVG/BVA + IC 20/IC 40)

Type	H2	H3	DIN	ANSI	
	mm (inch)	mm (inch)	D1 mm (inch)	D1 mm (inch)	D2 mm (inch)
IBG/IBA 40	96 (3.78)	52 (2.05)	92 (3.62)	92 (3.62)	85.7 (3.37)
IBG/IBA 50	100 (3.94)	59 (2.32)	107 (4.21)	107 (4.21)	105 (4.13)
IBG/IBA 65	108 (4.25)	69 (2.72)	127 (5)	127 (5)	124 (4.88)
IBG/IBA 80	115 (4.53)	76 (2.99)	142 (5.59)	142 (5.59)	137 (5.39)
IBG/IBA 100	125 (4.92)	86 (3.39)	162 (6.38)	162 (6.38)	—
IBG/IBA 125	138 (5.43)	101 (3.98)	192 (7.56)	192 (7.56)	—
IBG/IBA 150	150 (5.9)	114 (4.49)	218 (8.58)	218 (8.58)	—

### 9.4.1 With full bore = nominal diameter

Type	Weight kg (lbs)
IBG/IBA 40	2.7 (5.95)
IBG/IBA 50	2.8 (6.17)
IBG/IBA 65	3.0 (6.61)
IBG/IBA 80	3.2 (7.05)
IBG/IBA 100	3.3 (7.27)
IBG/IBA 125	3.6 (7.93)
IBG/IBA 150	3.9 (8.60)

### 9.4.2 With 1 × reduced bore

Type	Weight kg (lbs)
IBG/IBA 40/32	2.7 (5.95)
IBG/IBA 50/40	2.9 (6.39)
IBG/IBA 65/50	3.2 (7.05)
IBG/IBA 80/65	3.4 (7.49)
IBG/IBA 100/80	3.6 (7.93)
IBG/IBA 125/100	4.1 (9.04)
IBG/IBA 150/125	4.4 (9.70)

### 9.4.3 With 2 × reduced bore

Type	Weight kg (lbs)
IBG/IBA 40/25	2.8 (6.17)
IBG/IBA 50/32	3.0 (6.61)
IBG/IBA 65/40	3.2 (7.05)
IBG/IBA 80/50	3.5 (7.70)
IBG/IBA 100/65	3.8 (8.38)
IBG/IBA 125/80	4.4 (9.70)
IBG/IBA 150/100	4.9 (10.80)




บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

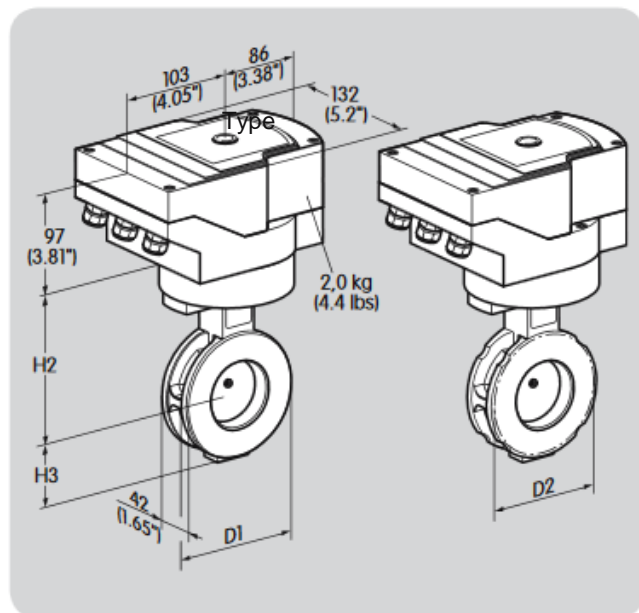

## 9.5 Dimensions of IBGF/IBAF (BVGF/BVAF + IC 20/IC 40)

Type	H2	H3	DIN	ANSI	
	mm (inch)	mm (inch)	D1 mm (inch)	D1 mm (inch)	D2 mm (inch)
IBGF/IBAF 40	134 (5.28)	52 (2.05)	92 (3.62)	92 (3.62)	85.7 (3.37)
IBGF/IBAF 50	138 (5.43)	59 (2.32)	107 (4.21)	107 (4.21)	105 (4.13)
IBGF/IBAF 65	146 (5.74)	69 (2.72)	127 (5.00)	127 (5.00)	124 (4.88)
IBGF/IBAF 80	153 (6.02)	76 (2.99)	142 (5.59)	142 (5.59)	137 (5.39)
IBGF/IBAF 100	163 (6.41)	86 (3.39)	162 (6.38)	162 (6.38)	—
IBGF/IBAF 125	176 (6.93)	101 (3.98)	192 (7.56)	192 (7.56)	—
IBGF/IBAF 150	188 (7.40)	114 (4.49)	218 (8.58)	218 (8.58)	—

### 9.5.1 With full bore = nominal diameter

Type	Weight kg (lbs)
IBGF/IBAF 40	3.5 (7.70)
IBGF/IBAF 50	3.6 (7.93)
IBGF/IBAF 65	3.8 (8.38)
IBGF/IBAF 80	4.0 (8.82)
IBGF/IBAF 100	4.1 (9.04)
IBGF/IBAF 125	4.4 (9.70)
IBGF/IBAF 150	4.7 (10.36)

### 9.5.2 With 1 × reduced bore

Type	Weight kg (lbs)
IBGF/IBAF 40/32	3.5 (7.70)
IBGF/IBAF 50/40	3.7 (8.16)
IBGF/IBAF 65/50	4.0 (8.82)
IBGF/IBAF 80/65	4.1 (9.04)
IBGF/IBAF 100/80	4.4 (9.70)
IBGF/IBAF 125/100	4.9 (10.80)
IBGF/IBAF 150/125	5.2 (11.46)

### 9.5.3 With 2 × reduced bore

Type	Weight kg (lbs)
IBGF/IBAF 40/25	3.6 (7.93)
IBGF/IBAF 50/32	3.8 (8.38)
IBGF/IBAF 65/40	4.0 (8.82)
IBGF/IBAF 80/50	4.3 (9.48)
IBGF/IBAF 100/65	4.6 (10.14)
IBGF/IBAF 125/80	5.2 (11.46)
IBGF/IBAF 150/100	5.7 (12.57)



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170


โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

## Technical data

### 9.6 Dimensions of IBH/IBHS (BVH/BVHS + IC 20/IC 40)

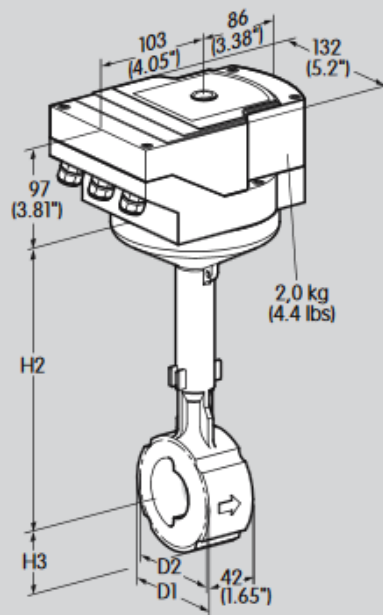

Type	H2	H3	DIN		ANSI		Weight
	mm (inch)	mm (inch)	D1 mm (inch)	D2 mm (inch)	D1 mm (inch)	D2 mm (inch)	kg (lbs)
IBH/IBHS 40	234 (9.2)	46 (1.8)	92 (3.6)	—	92 (3.6)	85.7 (3.4)	5.4 (11.9)
IBH/IBHS 50	239 (9.4)	54 (2.1)	107 (4.2)	—	107 (4.2)	105 (4.1)	5.9 (13.0)
IBH/IBHS 65	243 (9.5)	64 (2.5)	127 (5.0)	—	127 (5.0)	124 (4.9)	6.8 (15.0)
IBH/IBHS 80	254 (10)	71 (2.8)	142 (5.6)	—	142 (5.6)	137 (5.4)	7.3 (16.1)
IBH/IBHS 100	265 (10.4)	88 (3.4)	175 (6.9)	162 (6.4)	175 (6.9)	—	8.5 (18.7)



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170


โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

Technical data

**krom  
schroder**

## 9.7 Dimensions IFC, IFC..T (VFC + IC 20/IC 40)

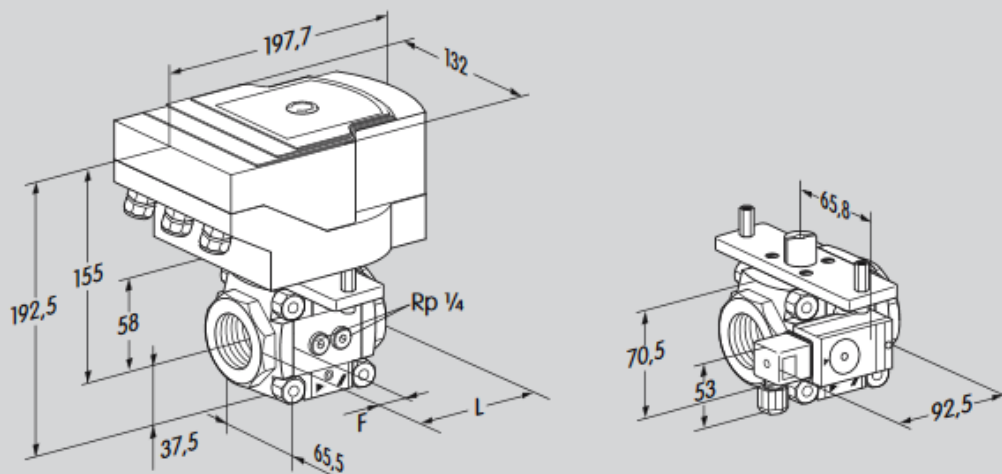

Type	Connection		L mm (inch)	F mm (inch)	Weight kg (lbs)
	Rp (NPT)	DN			
IFC 110 (IFC 1T10)	3/8 (3/8)	10	75 (2.95)	15 (0.59)	2.65 (5.83)
IFC 115 (IFC 1T50)	1/2 (1/2)	15	75 (2.95)	15 (0.59)	2.60 (5.72)
IFC 120 (IFC 1T20)	3/4 (3/4)	20	91 (3.58)	23 (0.91)	2.75 (6.05)
IFC 125 (IFC 1T25)	1 (1)	25	91 (3.58)	23 (0.91)	2.65 (5.83)



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

## 10 Maintenance cycles

The actuators IC 20, IC 40 suffer little wear and require little servicing.

We recommend a function check once a year.

### IC 40

A service note is issued after

3 million cycles (0 – 90 – 0°/0 – 100 – 0%),

3 million relay switching operations,

5 million changes of direction.



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)



## 11 Glossary

### 11.1 Start fuel flow rate

The start fuel flow rate is the quantity of fuel ignited by the ignition device on start-up of the burner.

### 11.2 Positions

Position is the angle (0–90° or 0–100%) which the actuator approaches. There are 4 positions, depending on the set operating mode:

Closed = 0° = 0%,

Low = low-fire rate,

Middle = intermediate,

High = open.

### 11.3 Adjustment angle for the “open” position

The adjustment angle for the “open” position indicates the approached position of the actuator and thus determines the maximum quantity in intermittent mode.



บริษัท เอดีดี เฟอร์เนส จำกัด

**ADD FURNACE CO.,LTD.**

44 ซอยบรมราชชนนี 70 ถนนบรมราชชนนี แขวงศาลาธรรมสพน์ เขตทวีวัฒนา กรุงเทพฯ 10170

โทร: 02-888-3472 โทร: ออกแบบ:08-08-170-170 แฟกซ์: 02-888-3258

<https://www.add-furnace.com> E-mail: [sales@add-furnace.com](mailto:sales@add-furnace.com)

**krom  
schroder**

## 12 Legend



Manual mode



Safety interlocks (Limits)



Start-up signal



High temperature mode



Ignition transformer



Gas valve



Air valve



Purge



Ext. air valve control



Flame signal



Operating signal

1, 2 Pilot and main burner



Fault signal



Reset



Closing time



Air pressure switch